




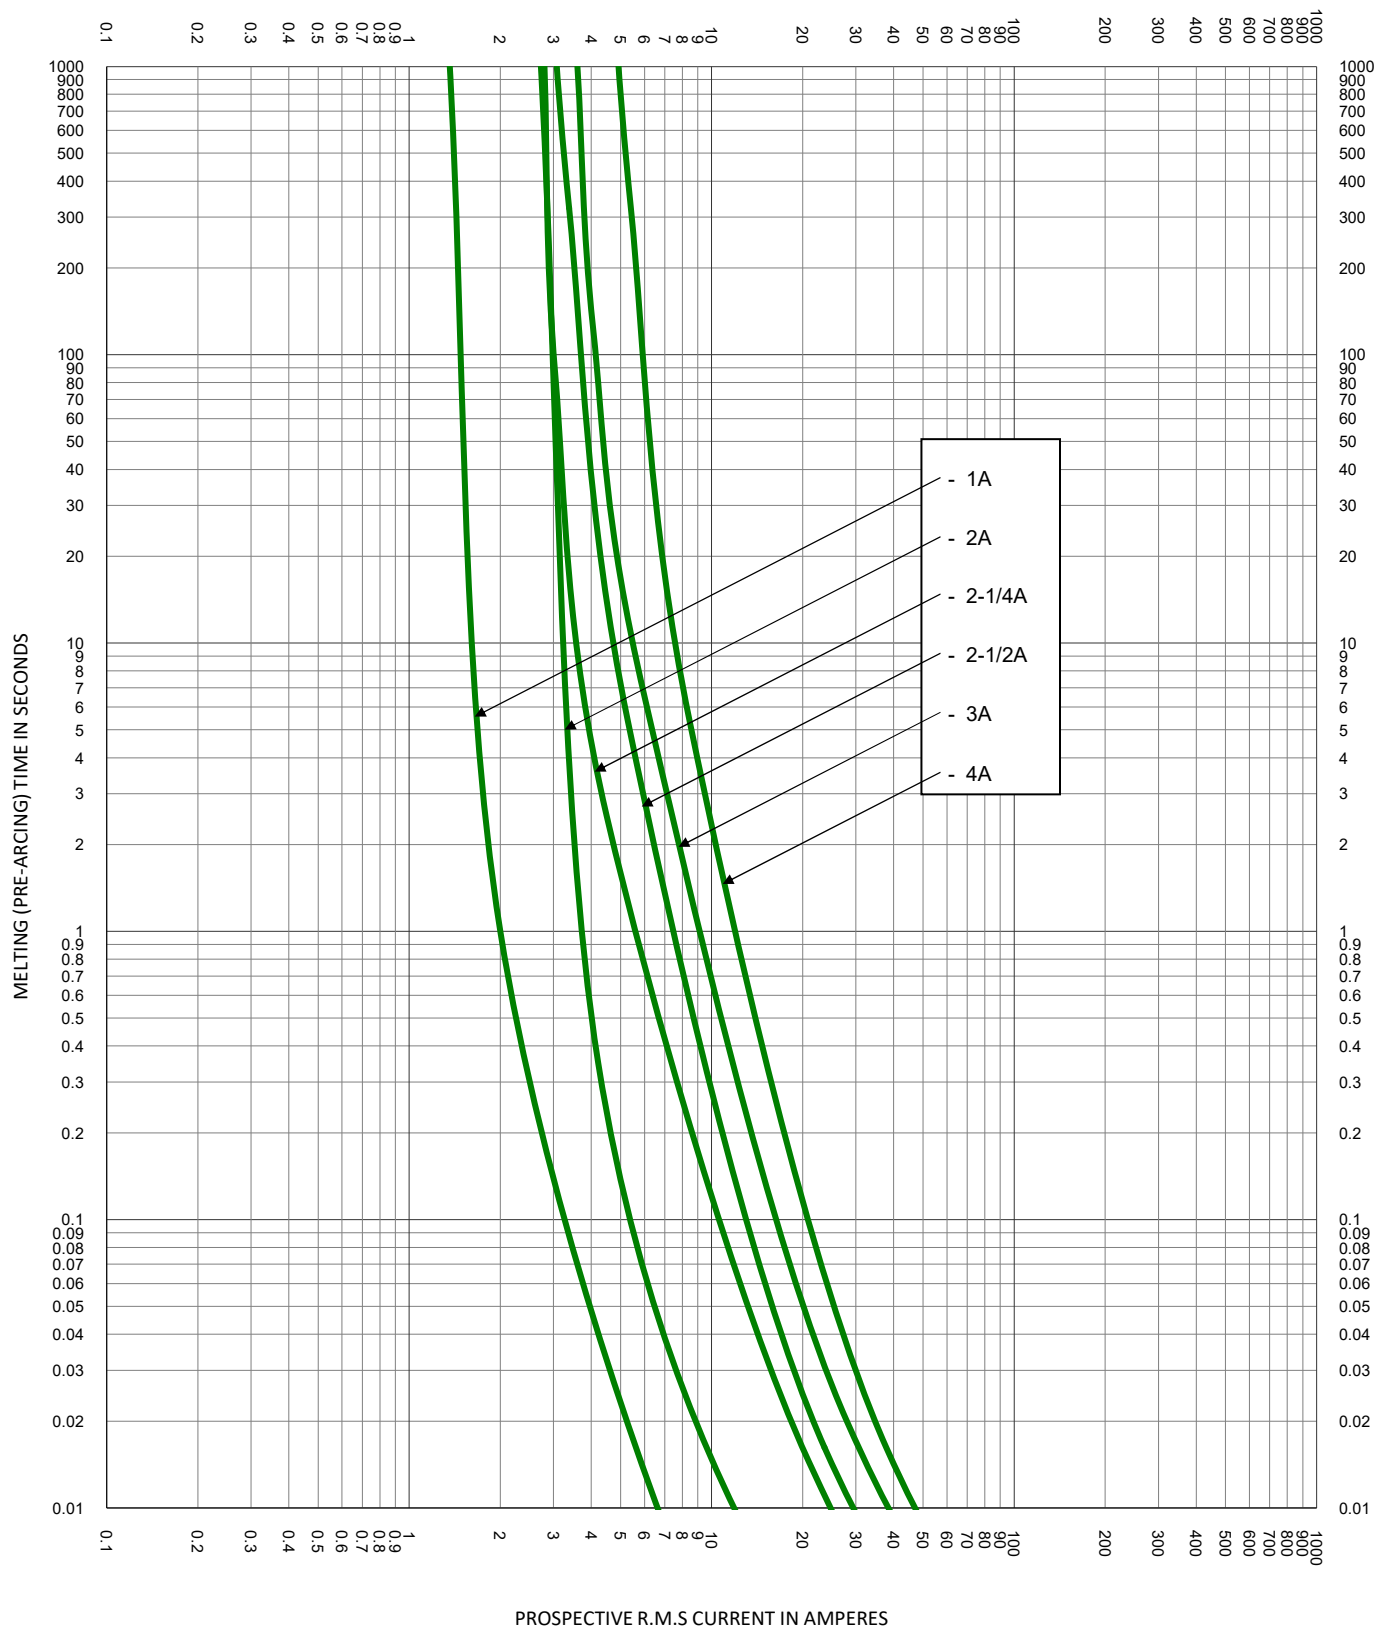


TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A	
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 03/15/2022	
TIME CURRENT CHARACTERISTIC CURVES		REVISION: J	
		DRAWING NO.:	SHEET 2 OF 6
		FCC01-SPXI	

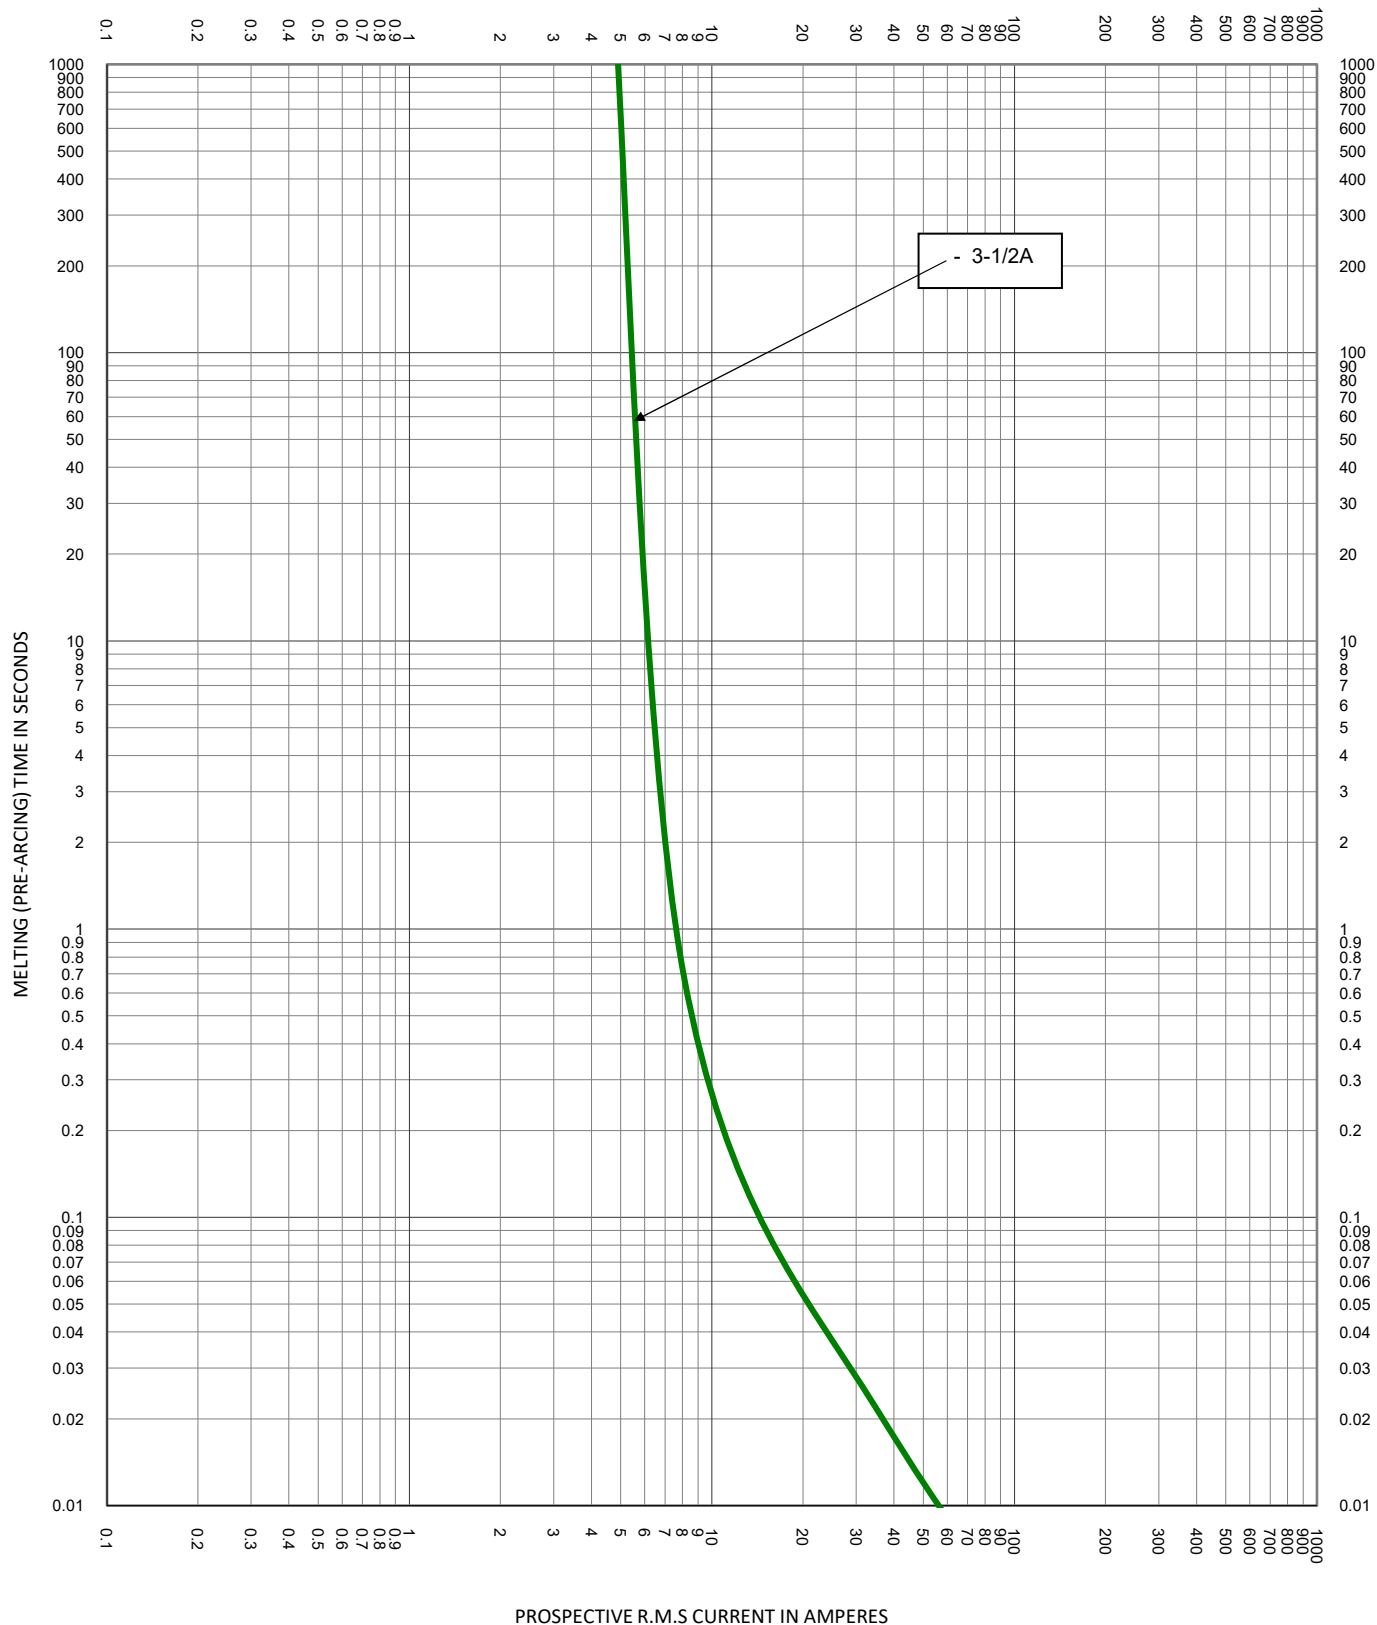


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 03/15/2022 REVISION: J
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 3 OF 6 FCC01-SPXI

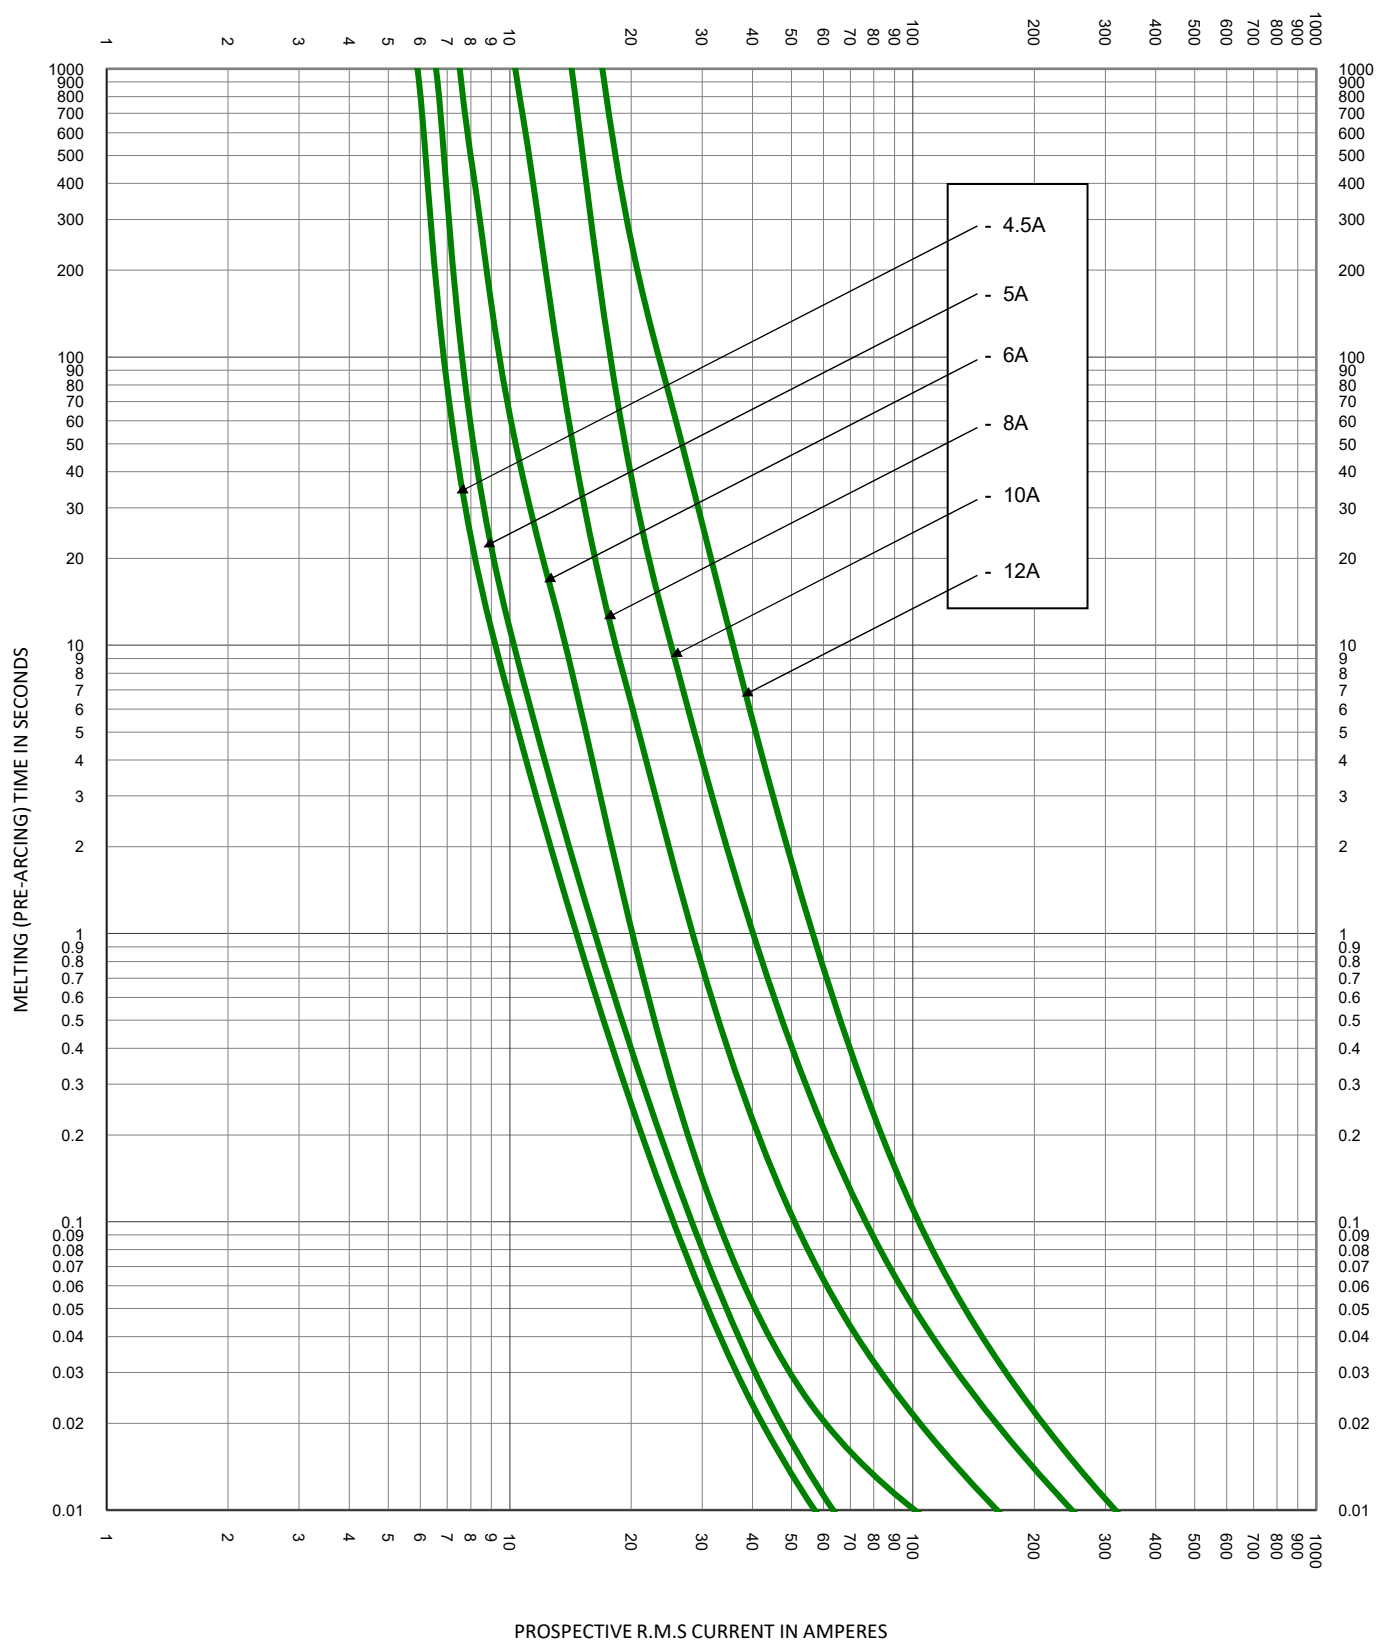

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 03/15/2022 REVISION: J
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 4 OF 6 FCC01-SPXI

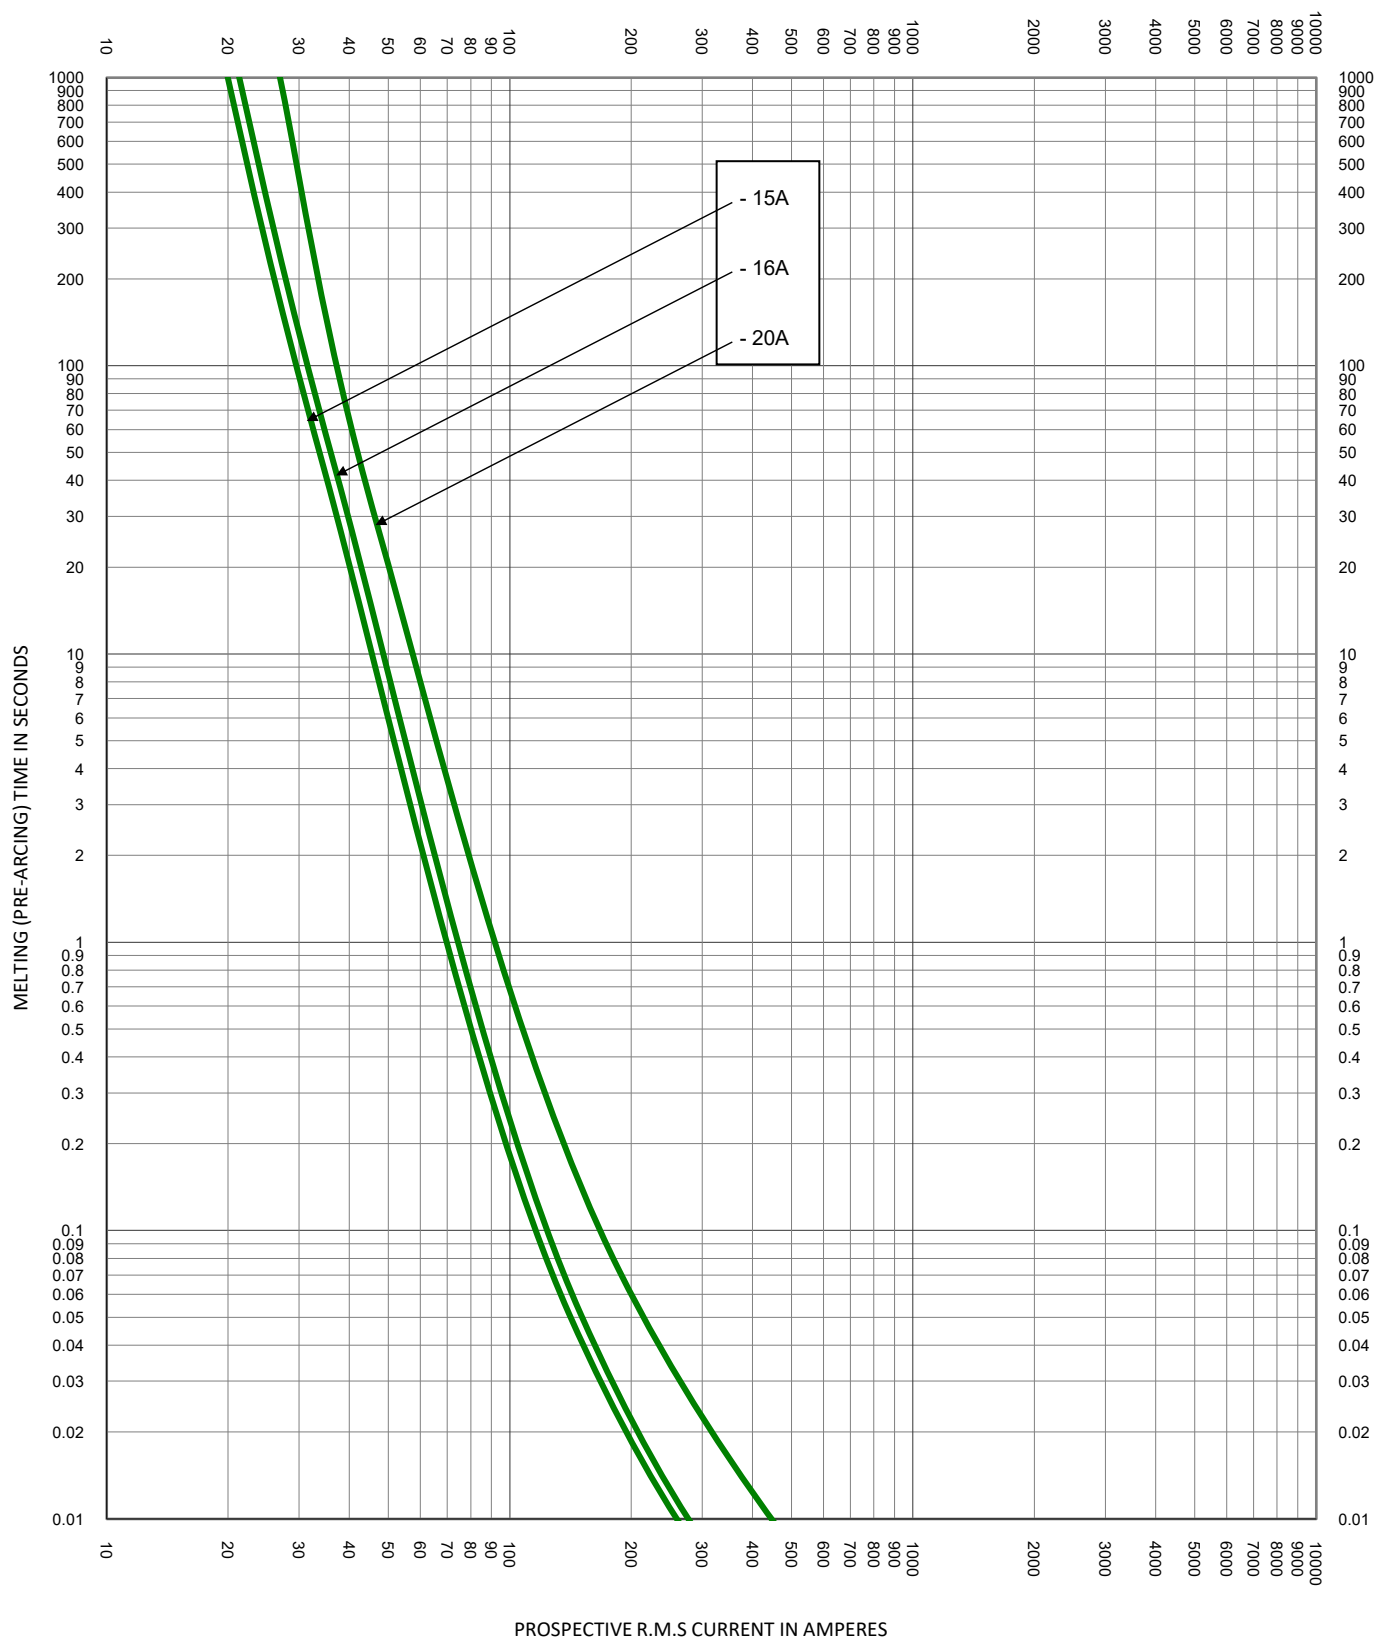

TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A	
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 03/15/2022	
TIME CURRENT CHARACTERISTIC CURVES		REVISION: J	
		DRAWING NO.:	SHEET 5 OF 6
		FCC01-SPXI	

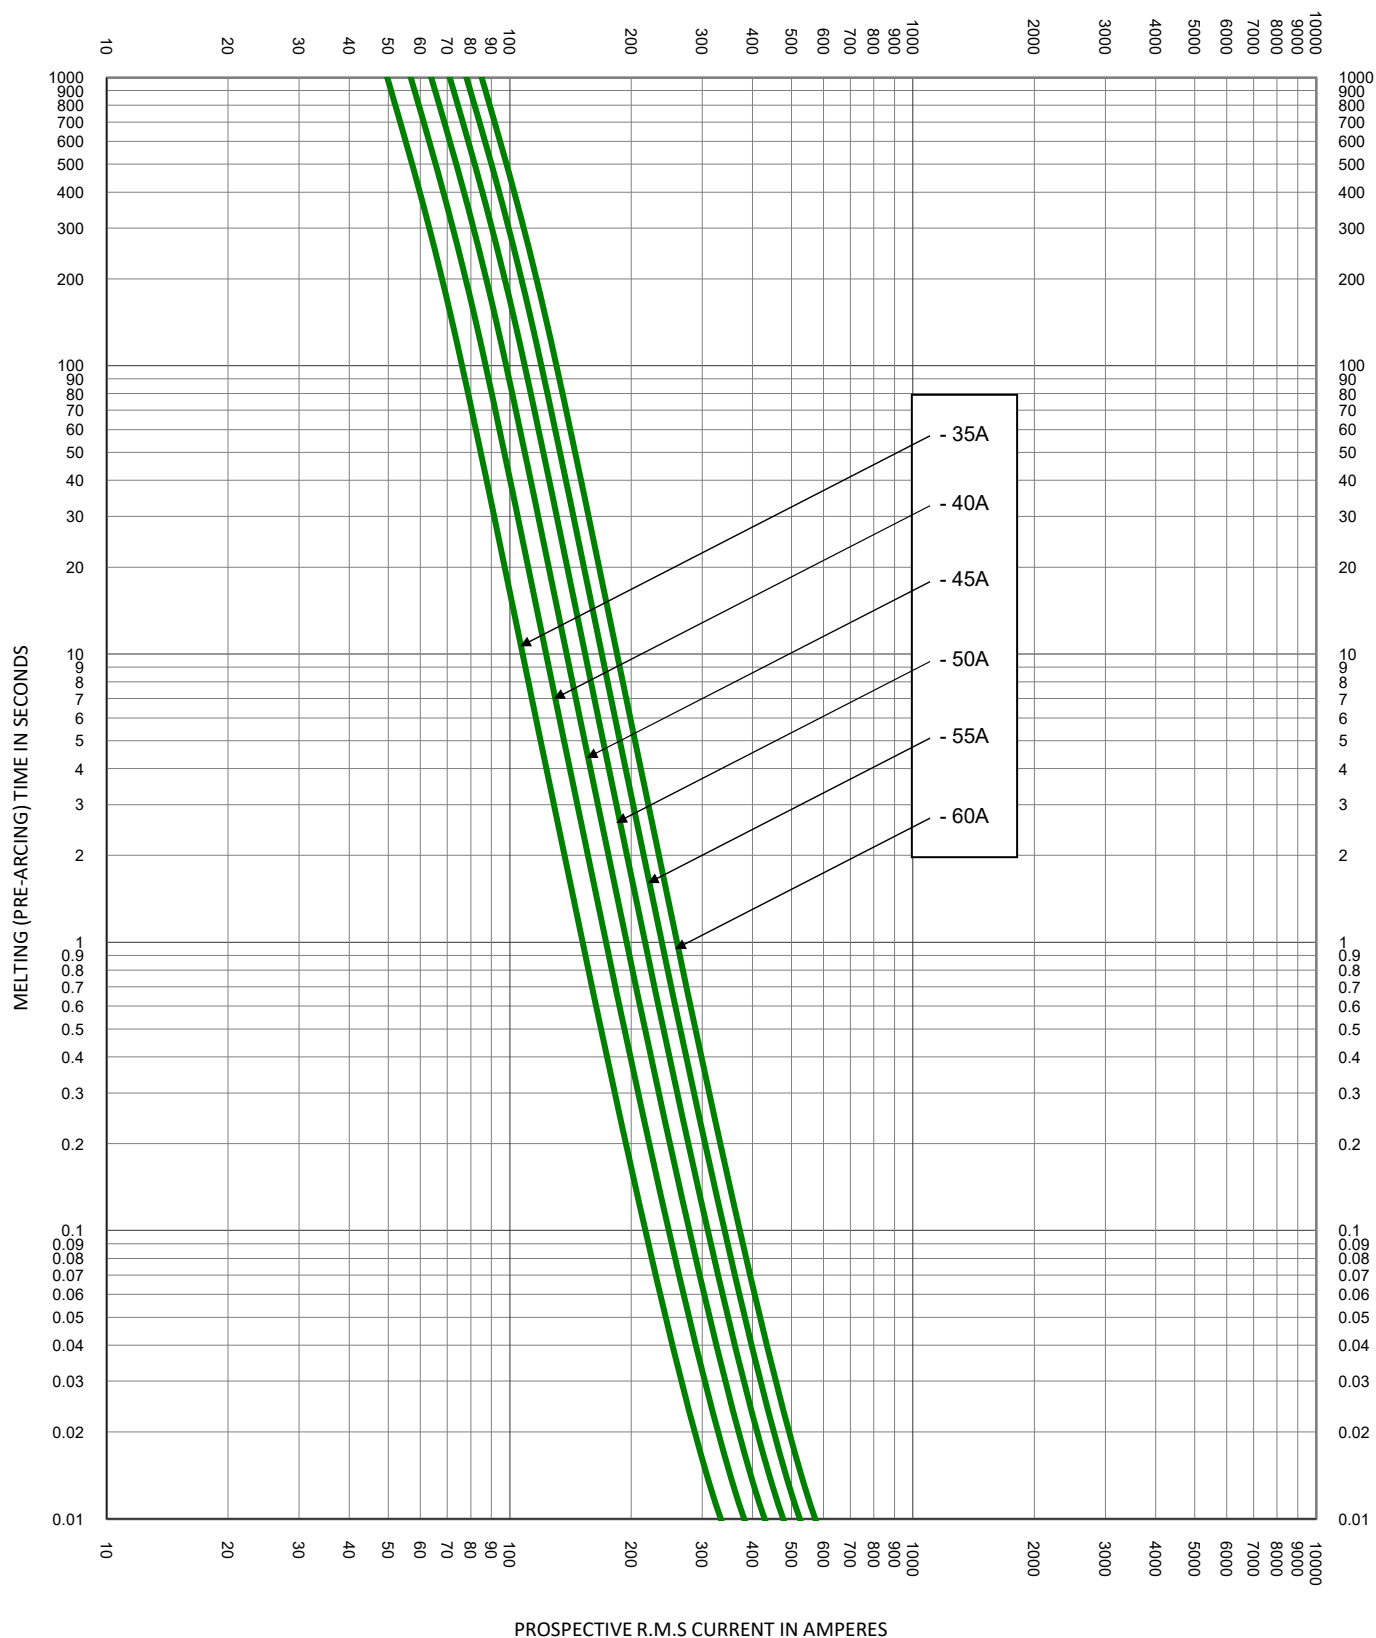

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		SPXI / SPXI-B 1A - 60A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 03/15/2022 REVISION: J
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 6 OF 6 FCC01-SPXI