



TIME IN SECONDS

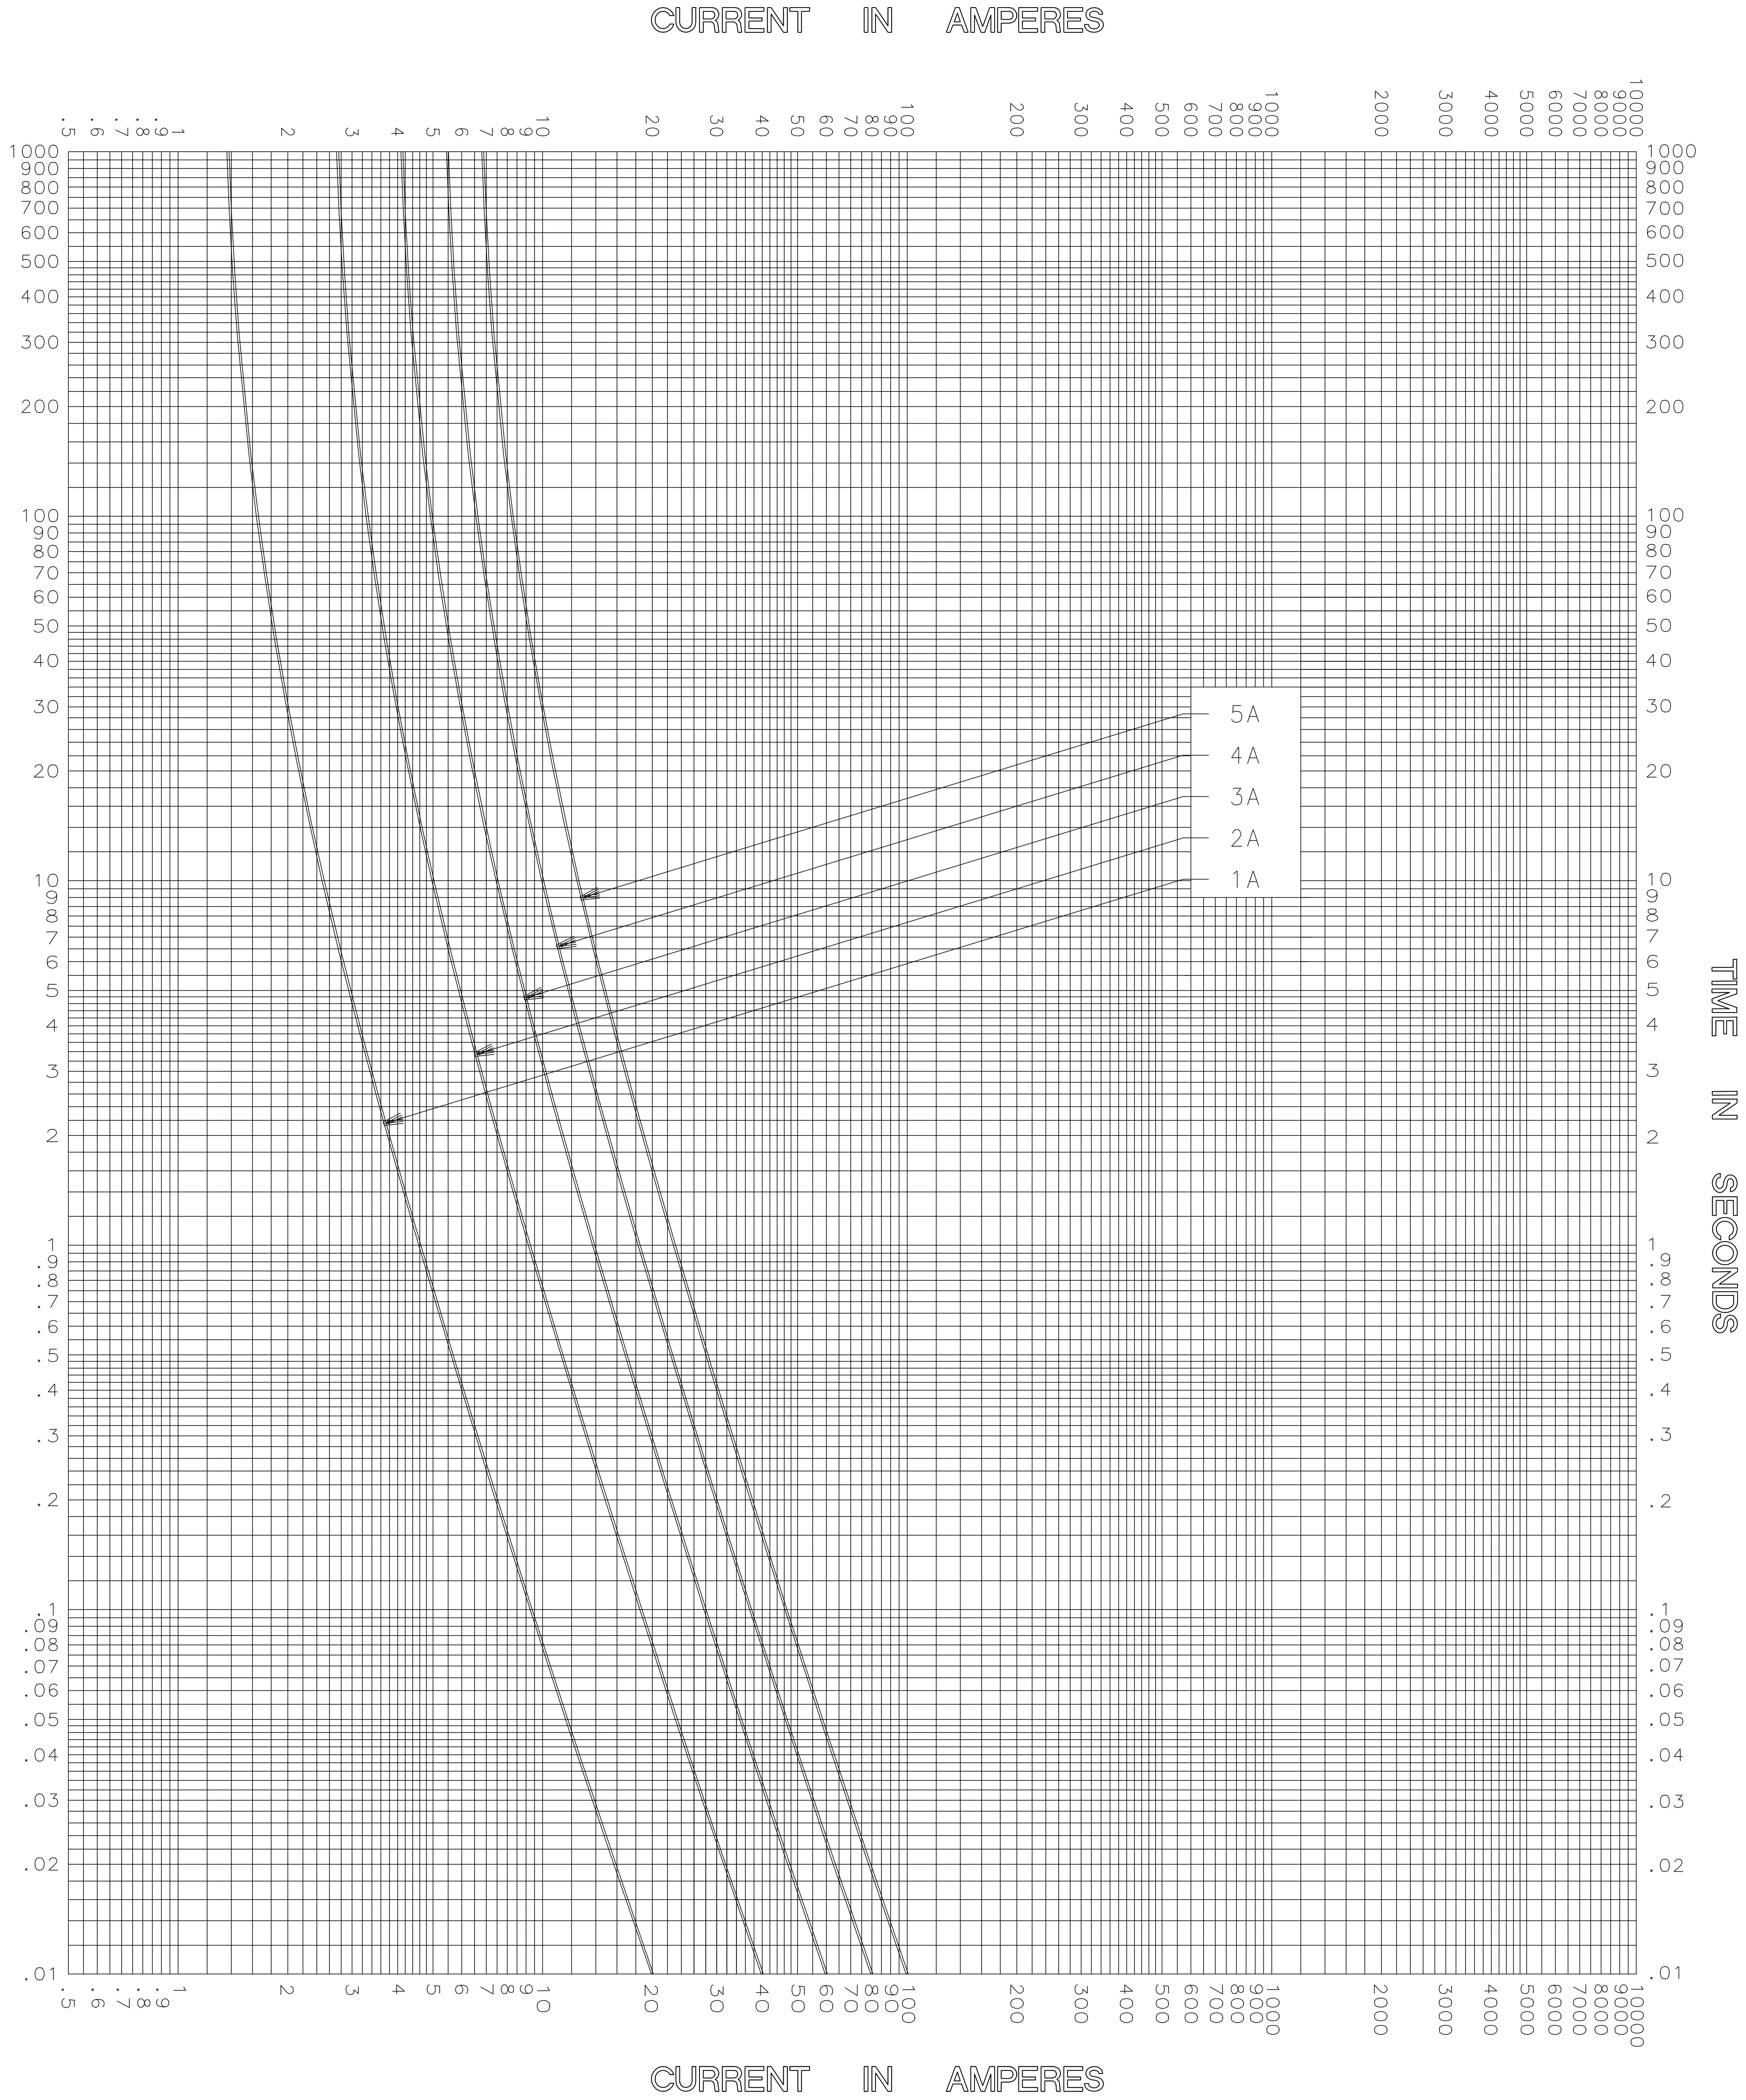

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
NLN (1A - 5A)

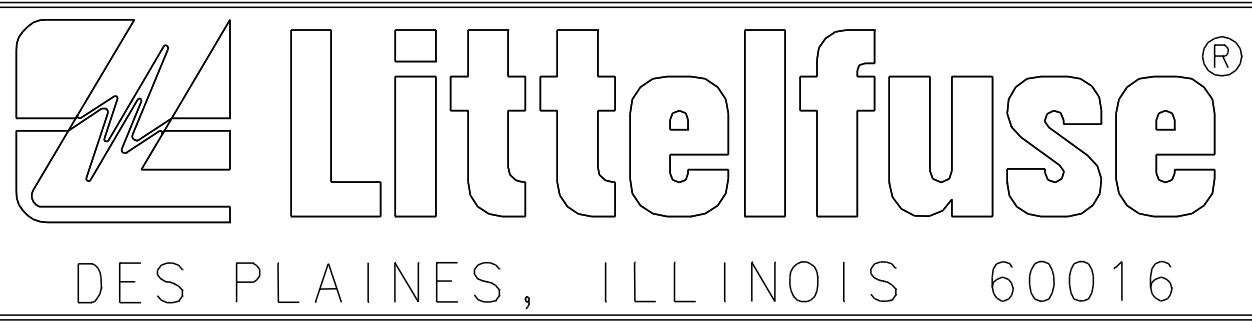


DRAWN BY LLL
DATE 08/18/04
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A - FCC01111001

-THIS DATA GENERATED ON CAD-


UNCONTROLLED
DOCUMENT

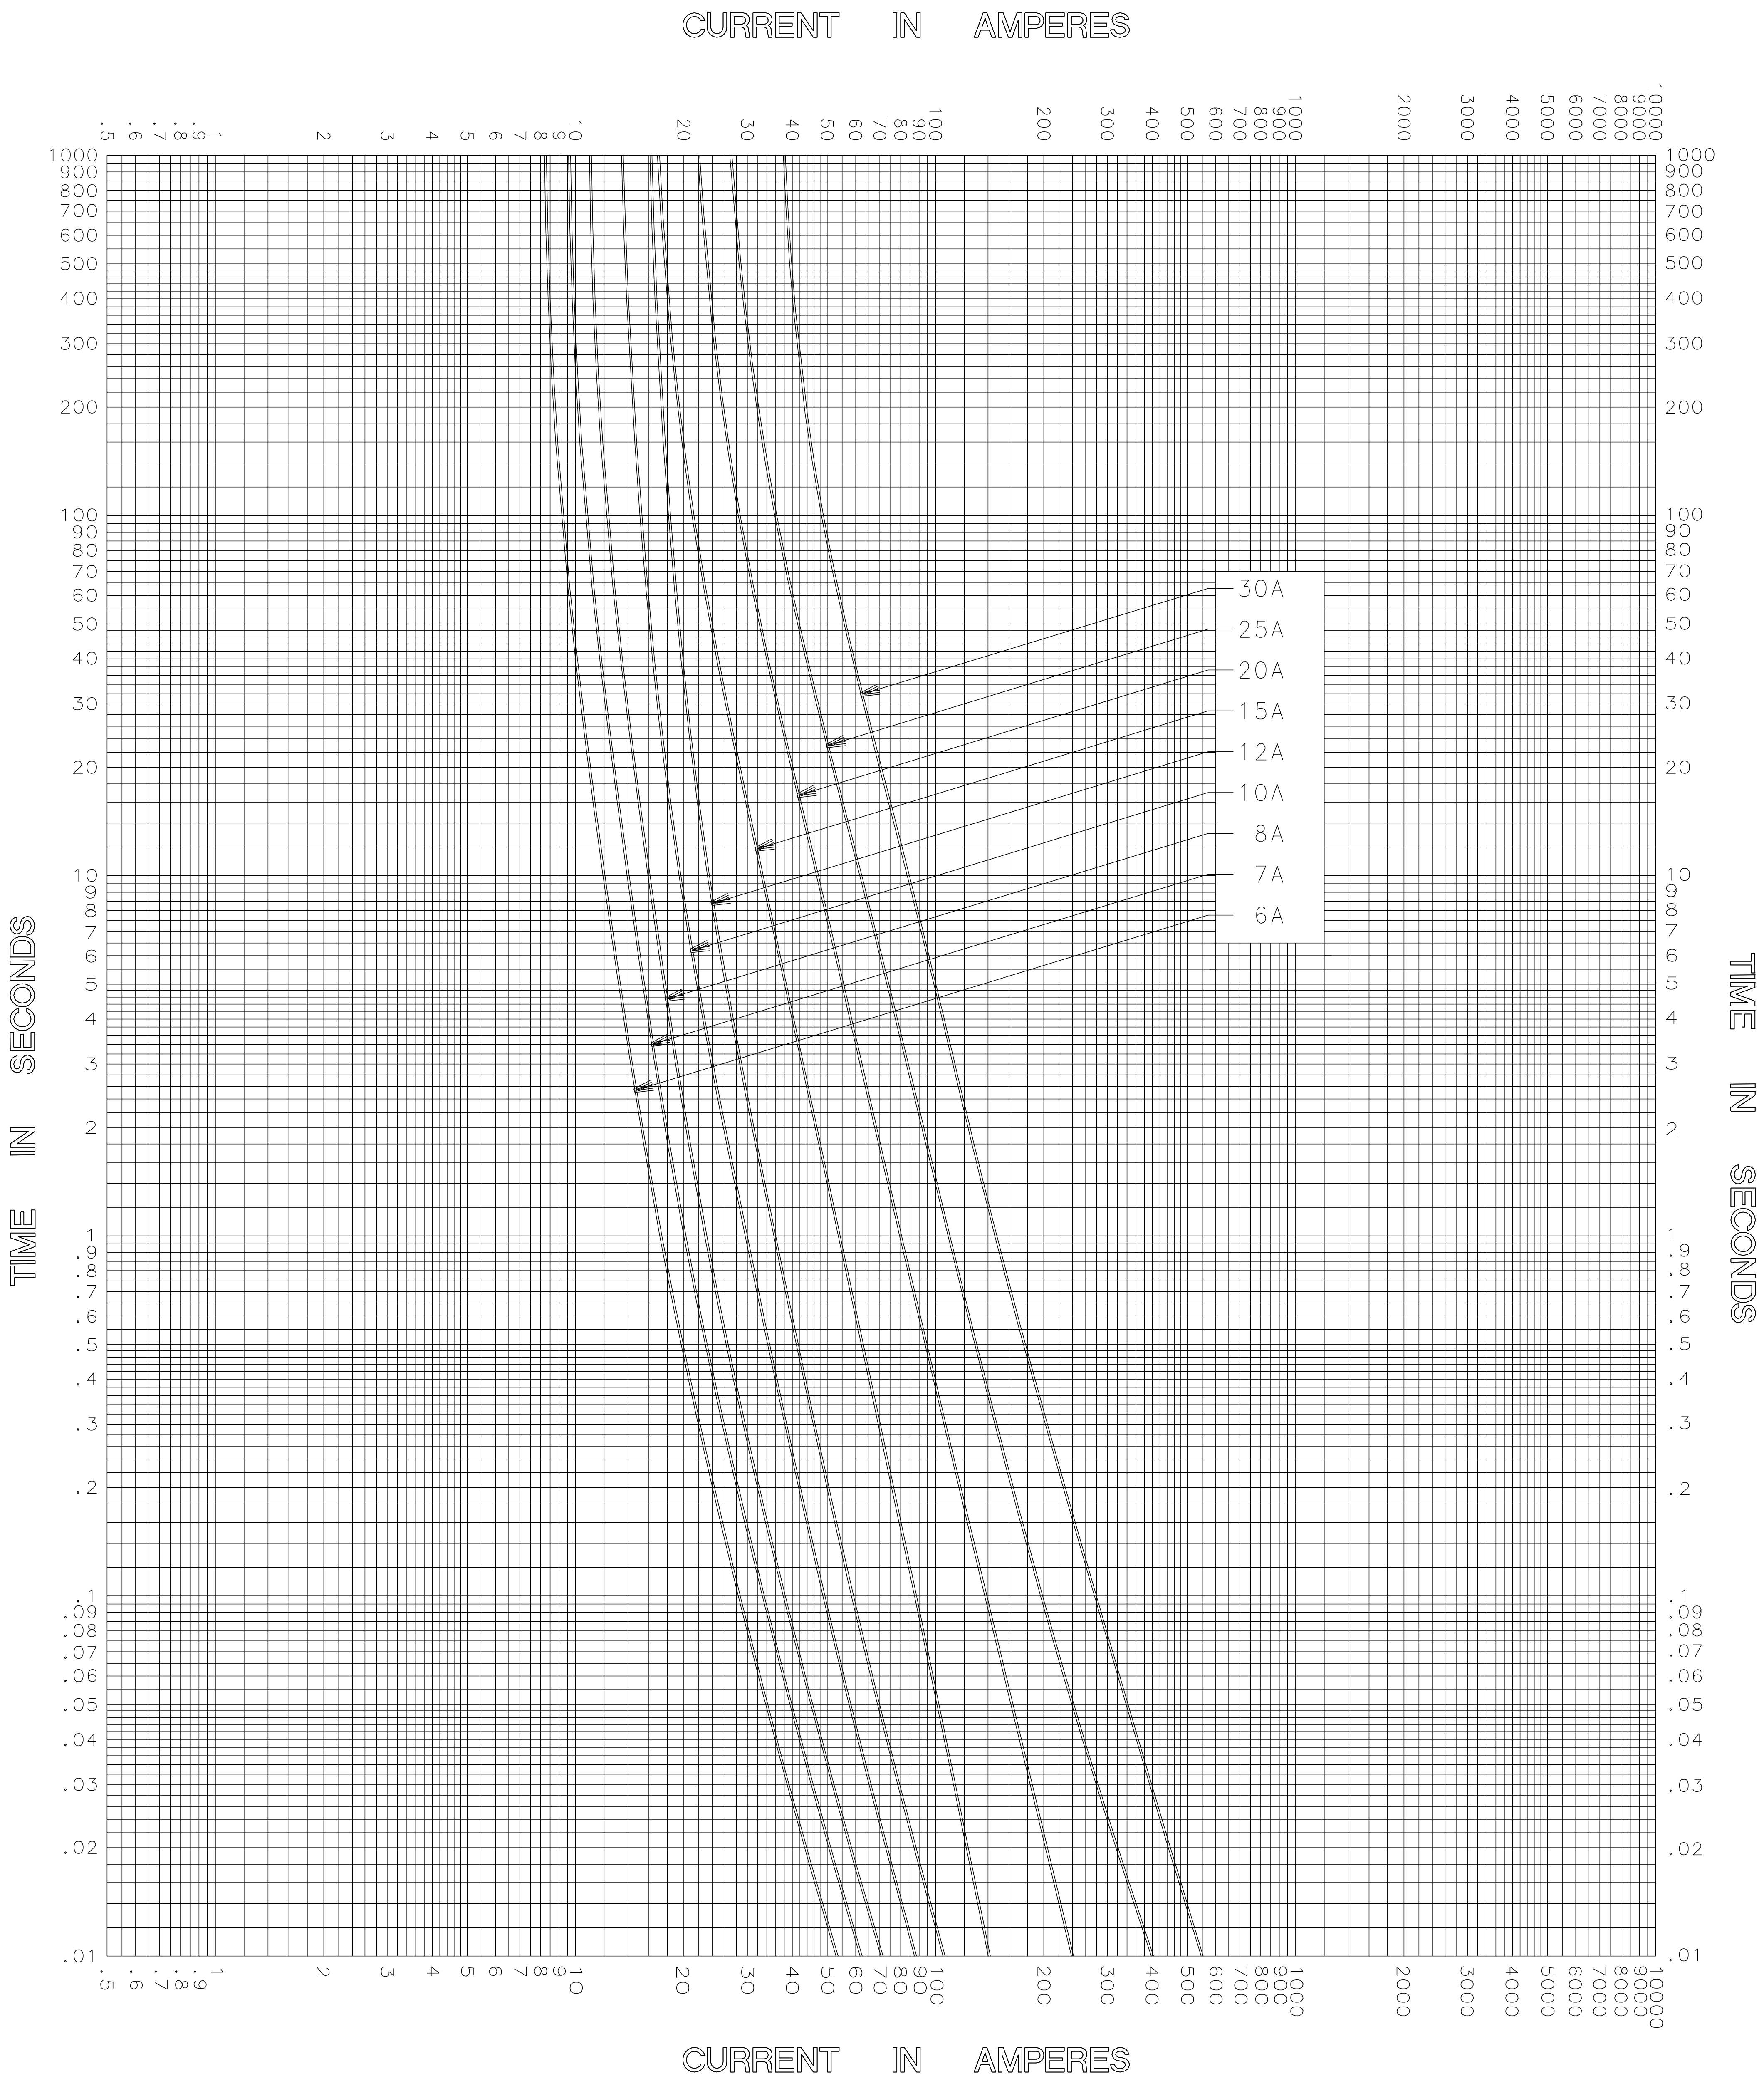


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER NLN (6A - 30A)
 Littelfuse [®] DES PLAINES, ILLINOIS 60016	DRAWN BY LLL DATE 08/18/04 CHECKED BY MP
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A - FCC0141102

-THIS DATA GENERATED ON CAD-


UNCONTROLLED
DOCUMENT

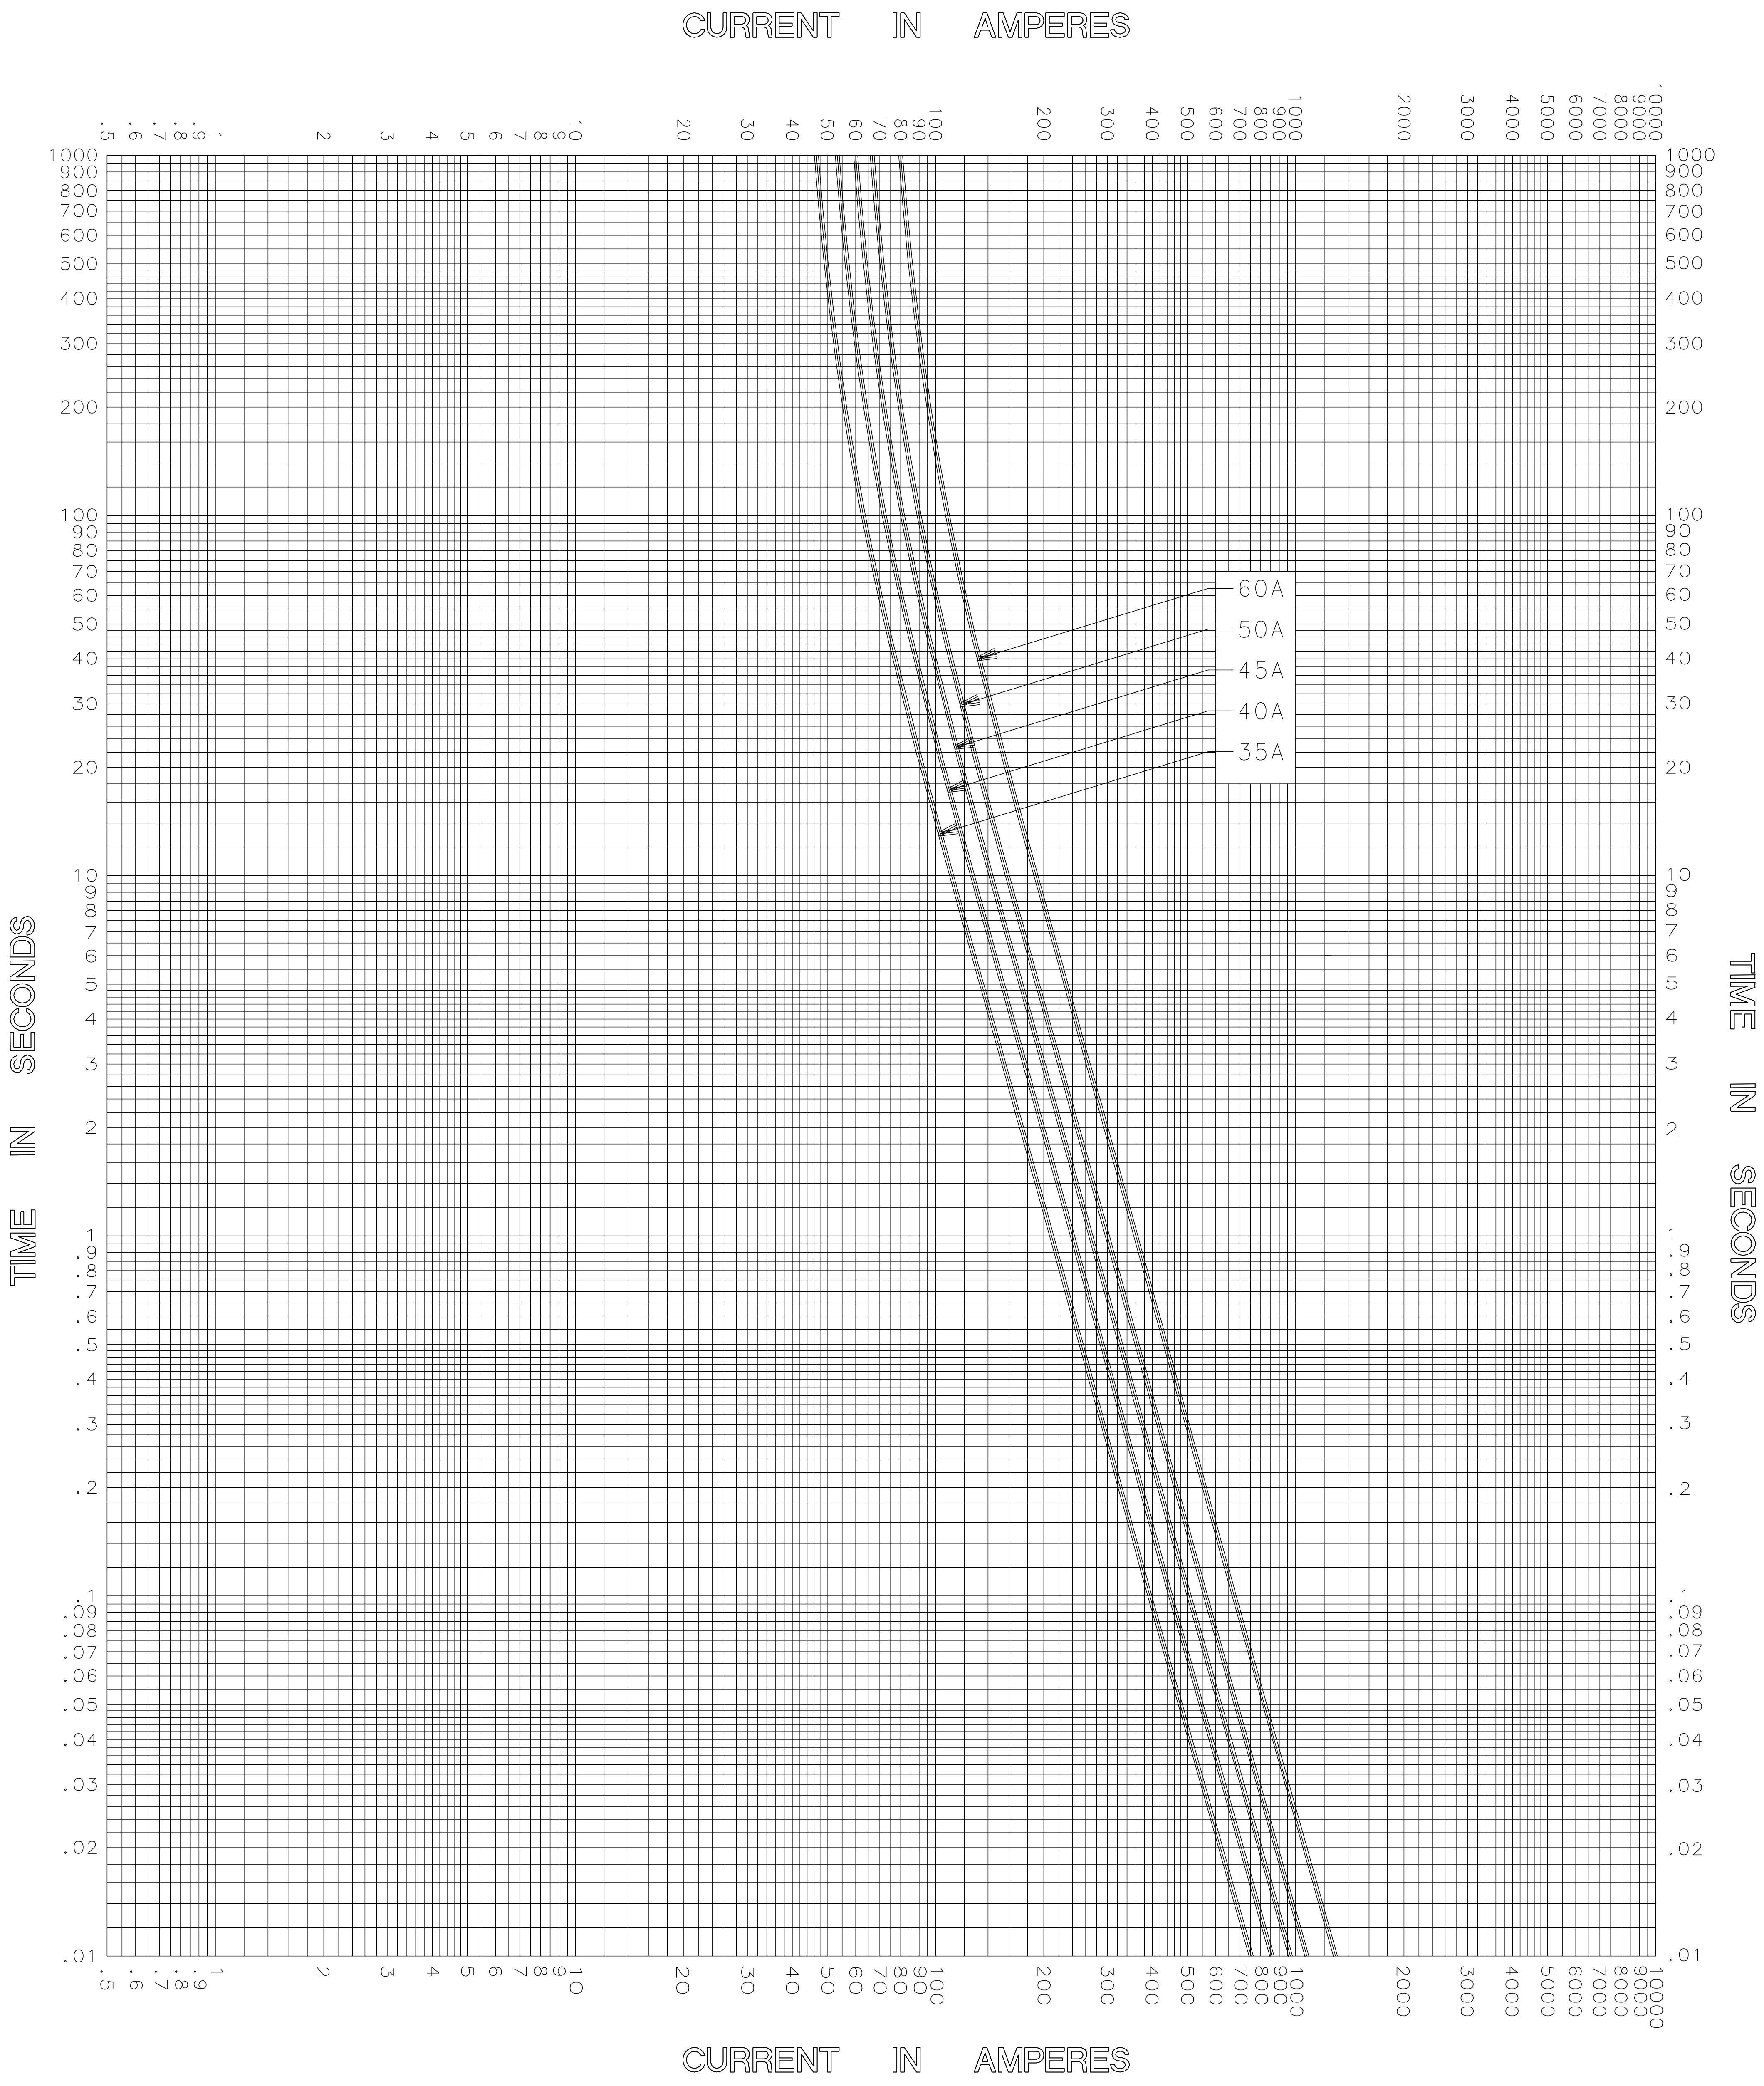


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____		FUSE CATALOG NUMBER
BASIS FOR DATA _____		NLN (35A - 60A)
 Littelfuse [®] DES PLAINES, ILLINOIS 60016		DRAWN BY <u>LLL</u>
		DATE <u>08/18/04</u>
TIME CURRENT CHARACTERISTIC CURVES		CHECKED BY <u>MP</u>
		DRAWING NO. <u>A - FCC01111003</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

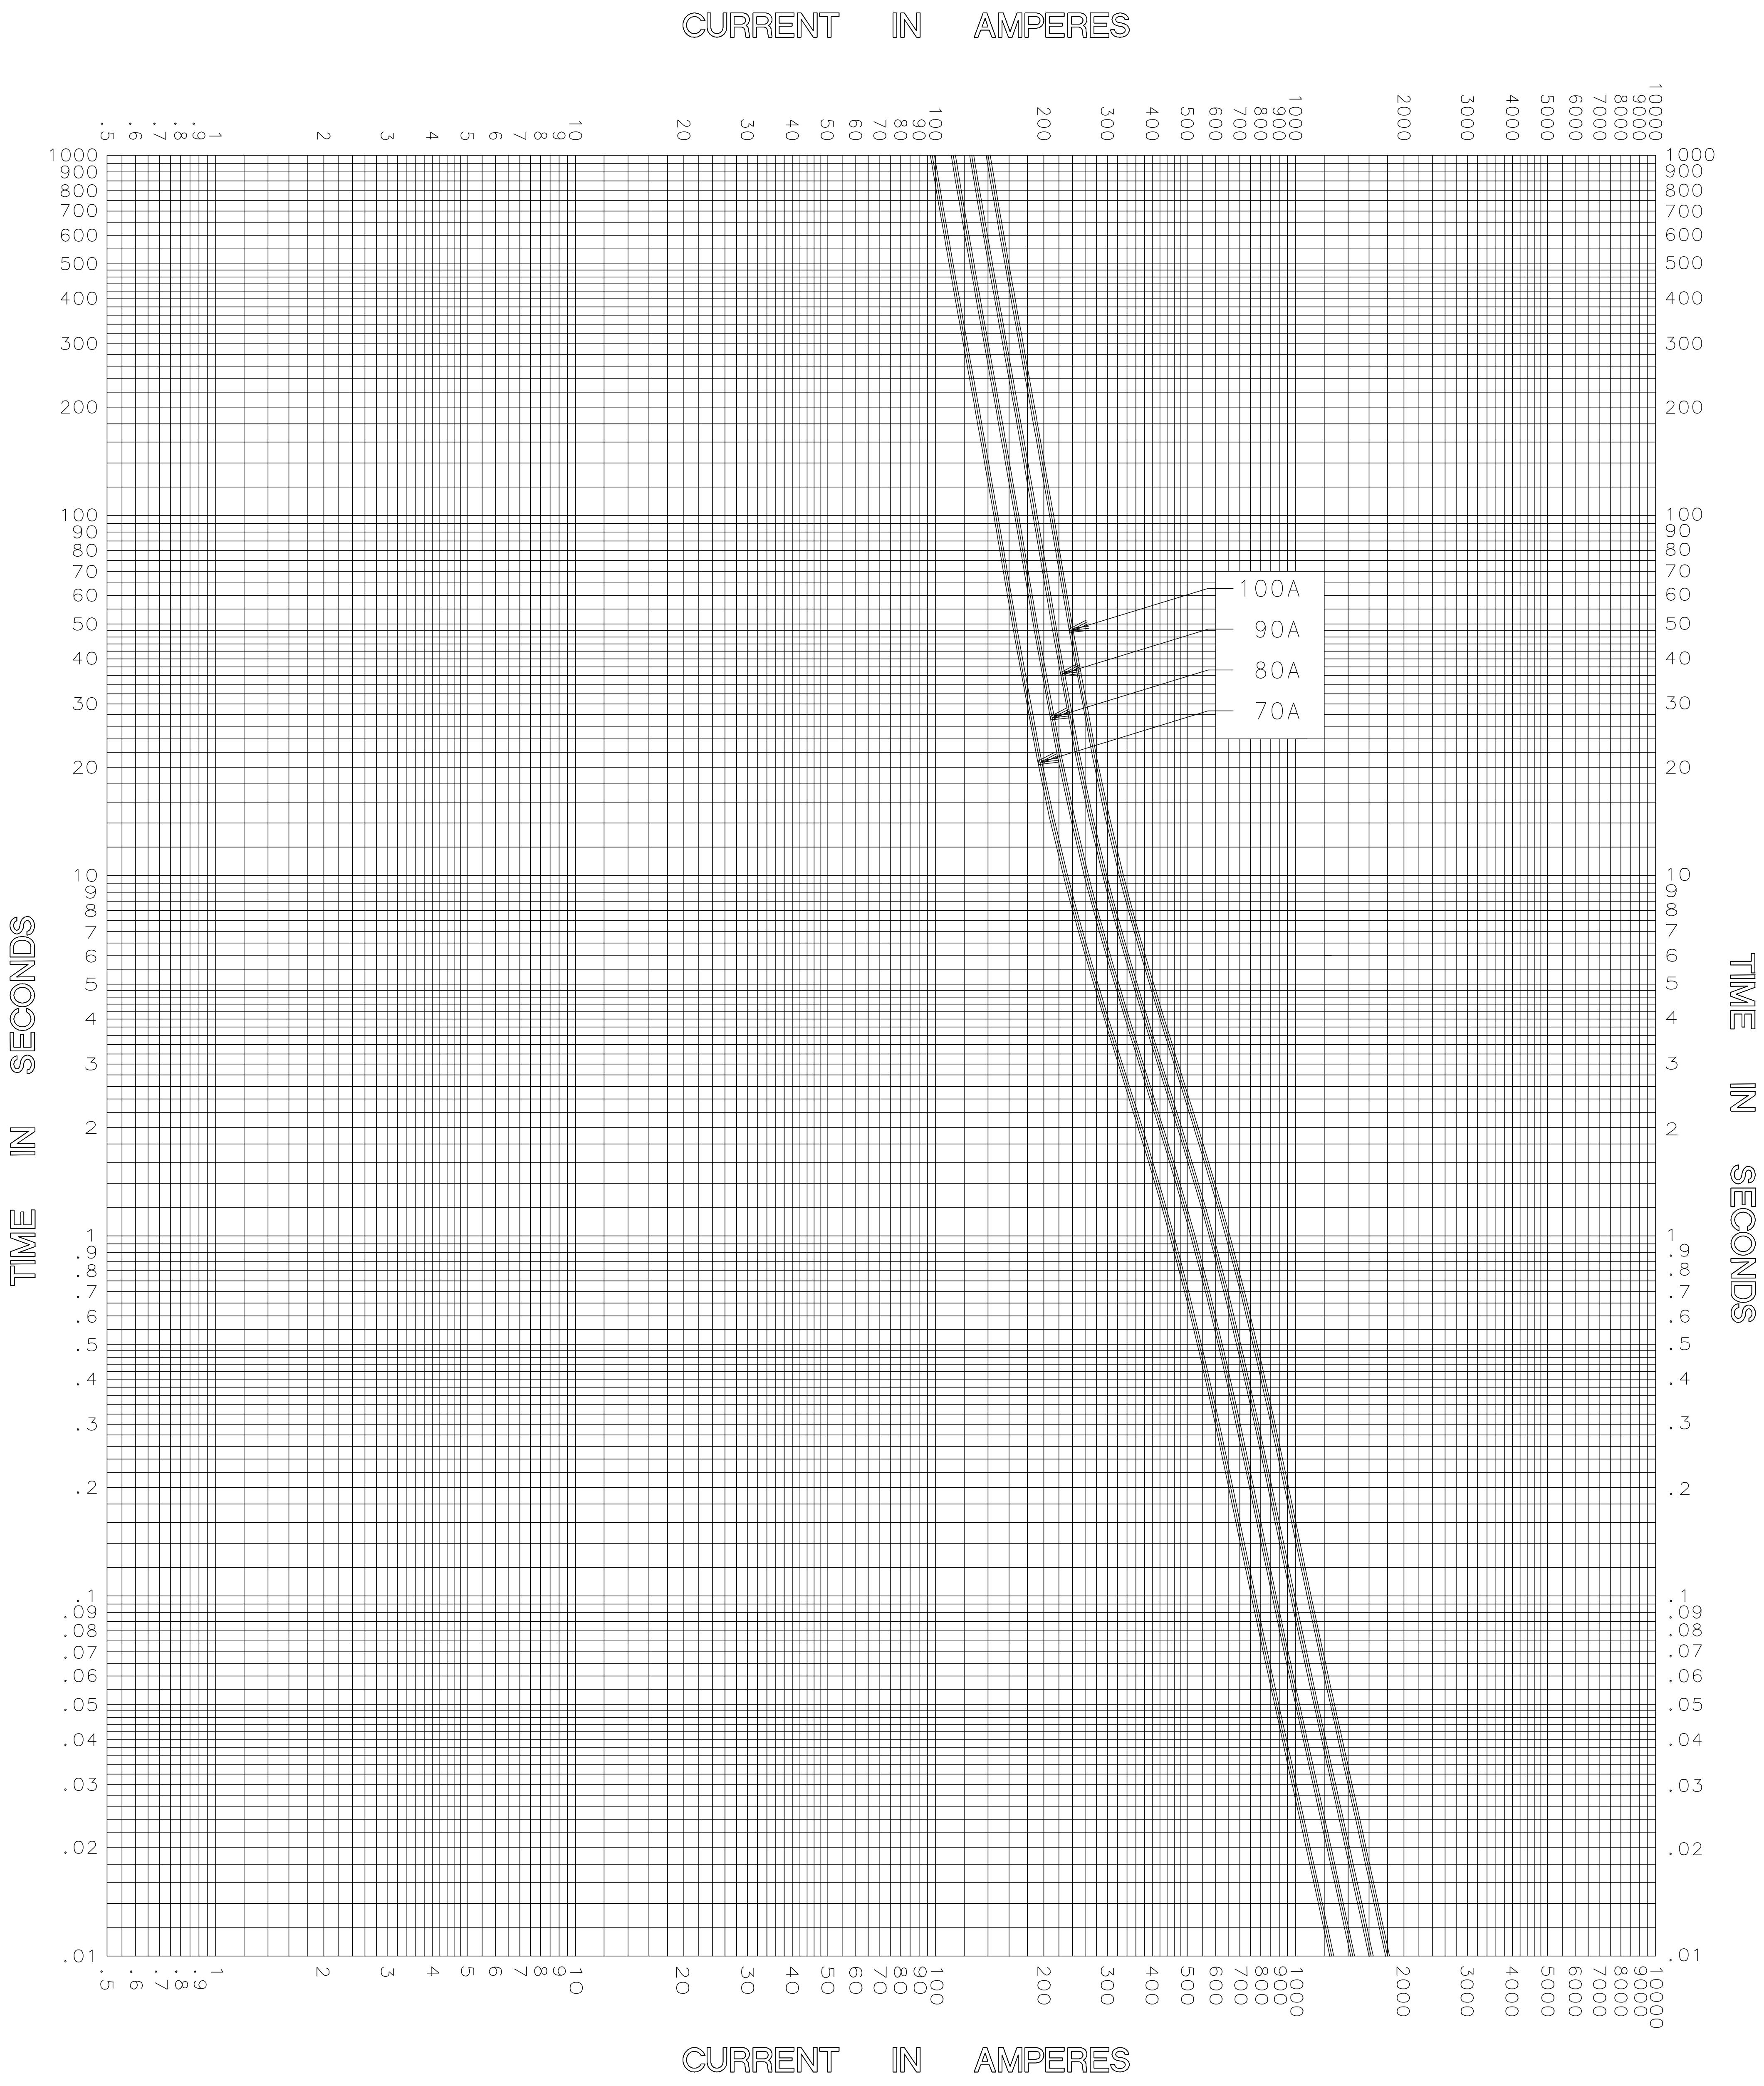


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		NLN (70A - 100A)

 Littelfuse® DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u> DATE <u>08/18/04</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A - FCC0111104

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

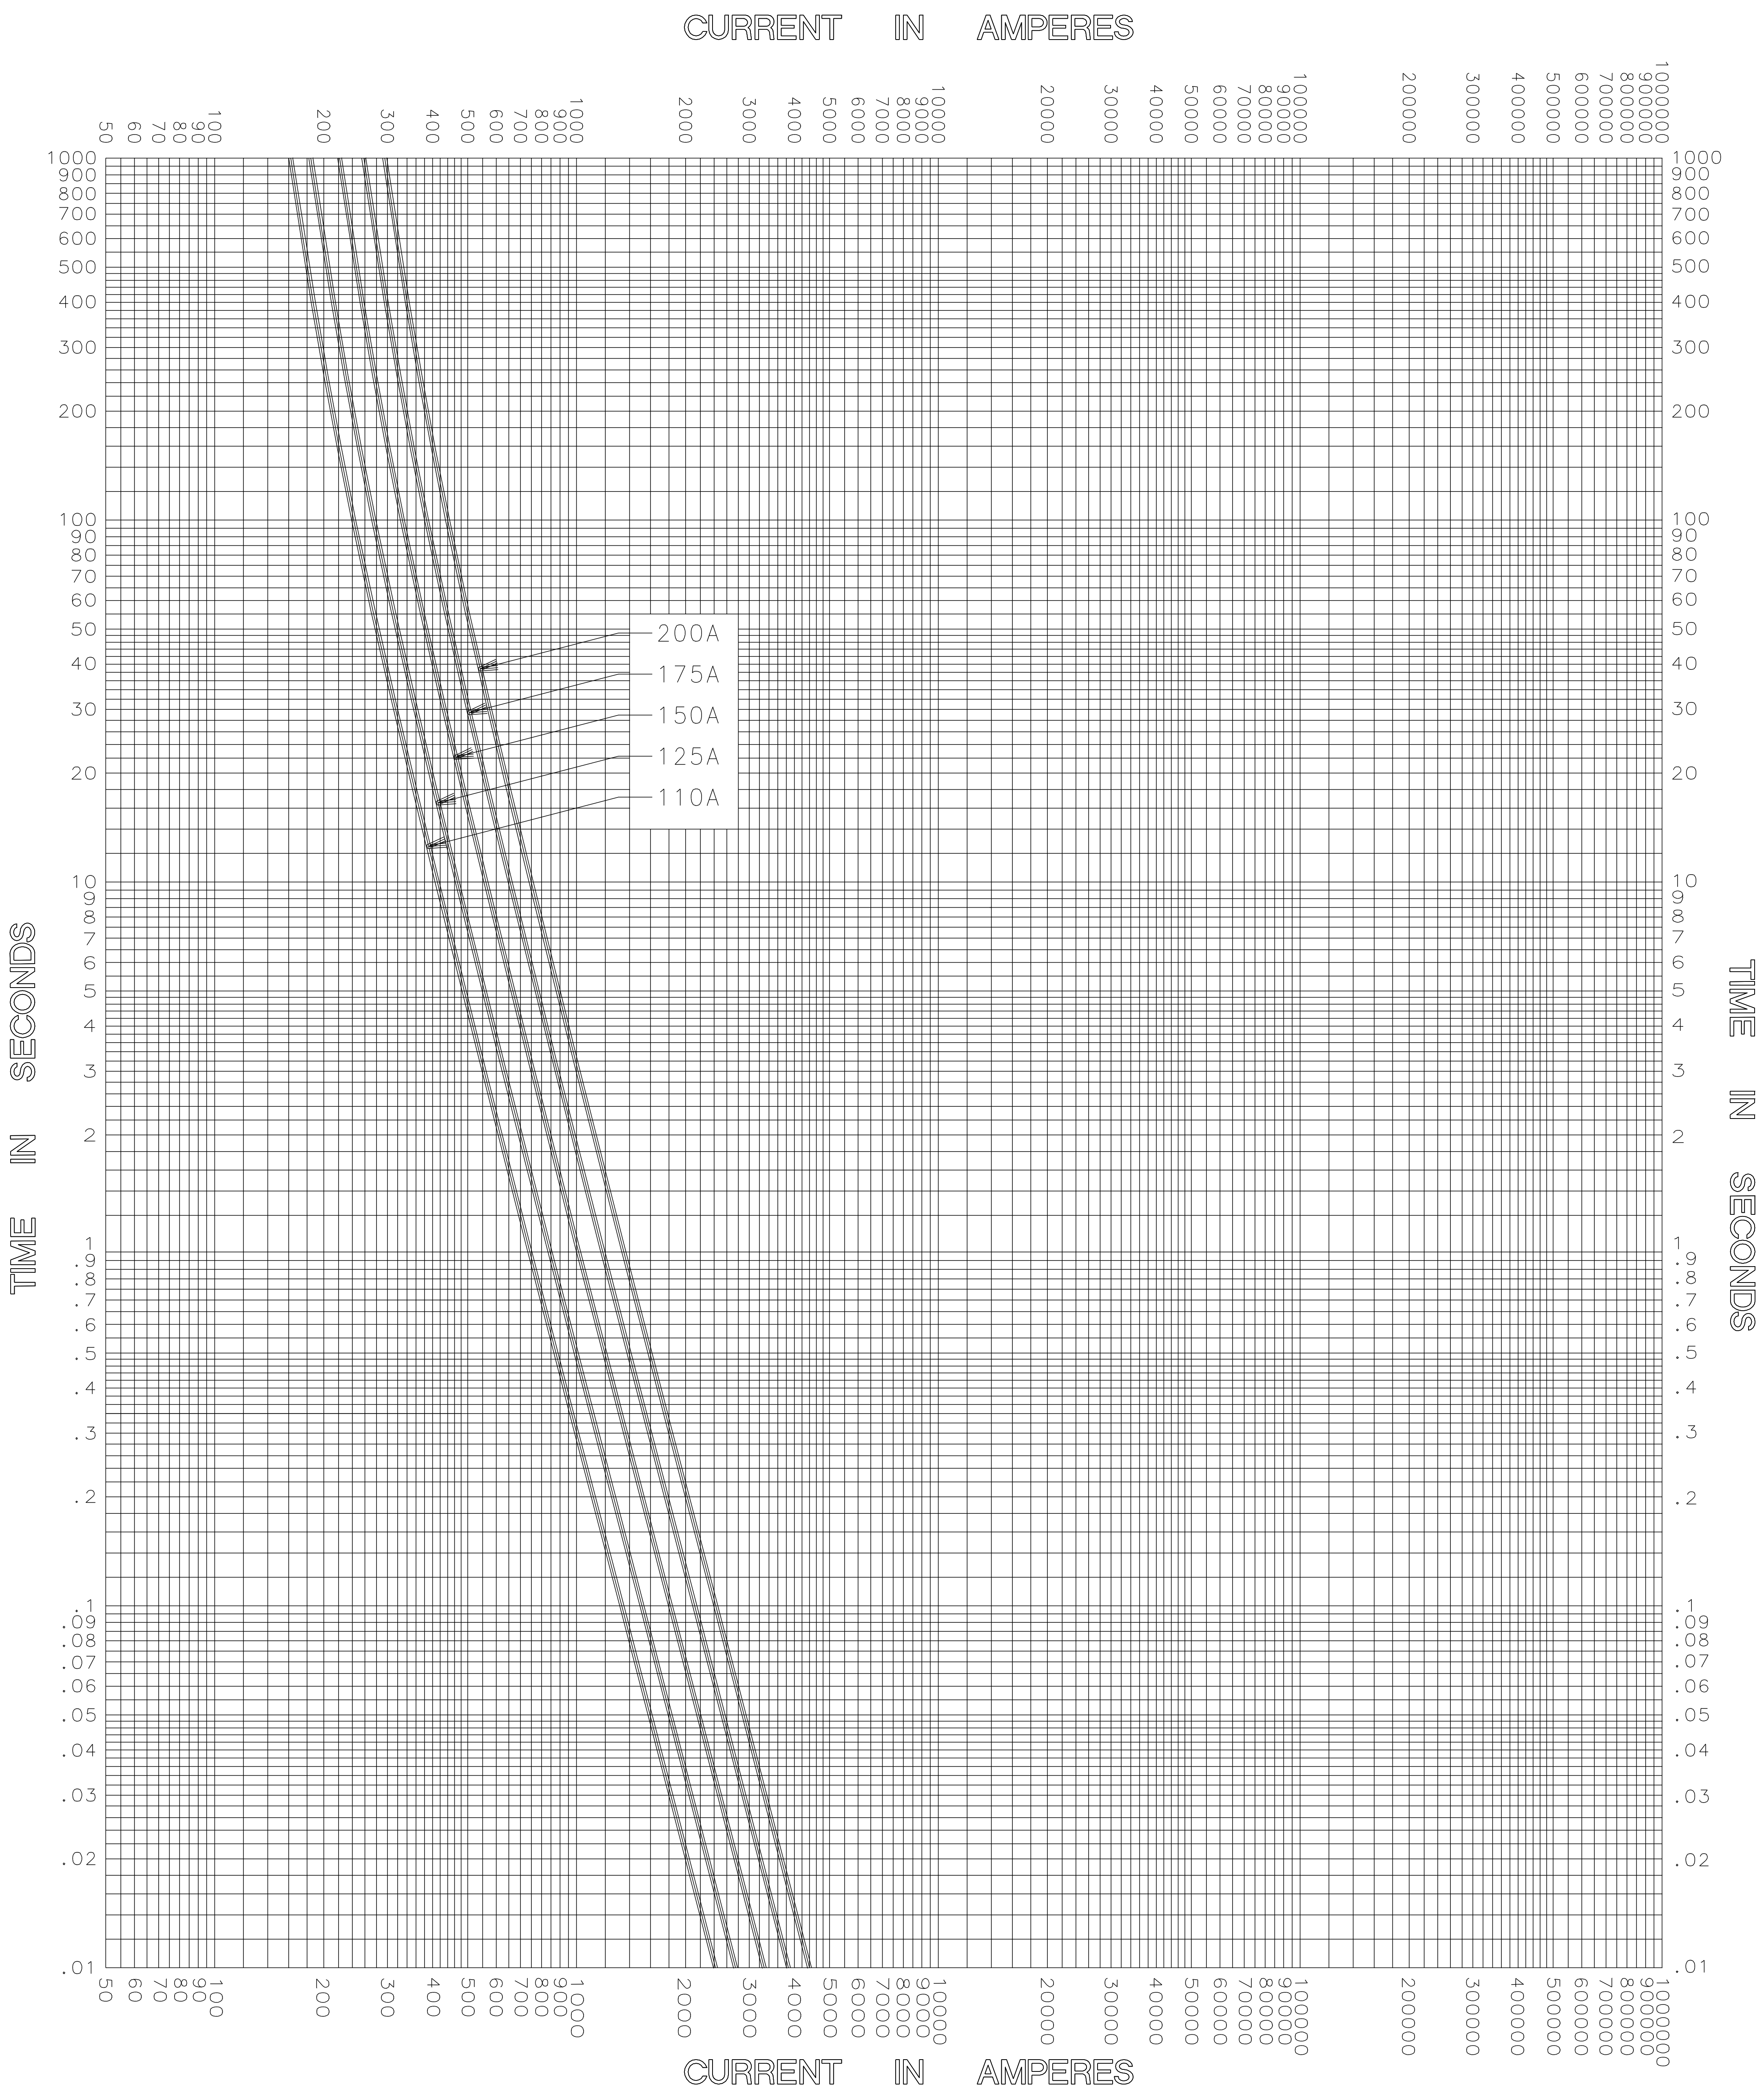

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
NLN (110A - 200A)




DRAWN BY LLL
DATE 08/18/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A FCC001 NLN 005

UNCONTROLLED
DOCUMENT

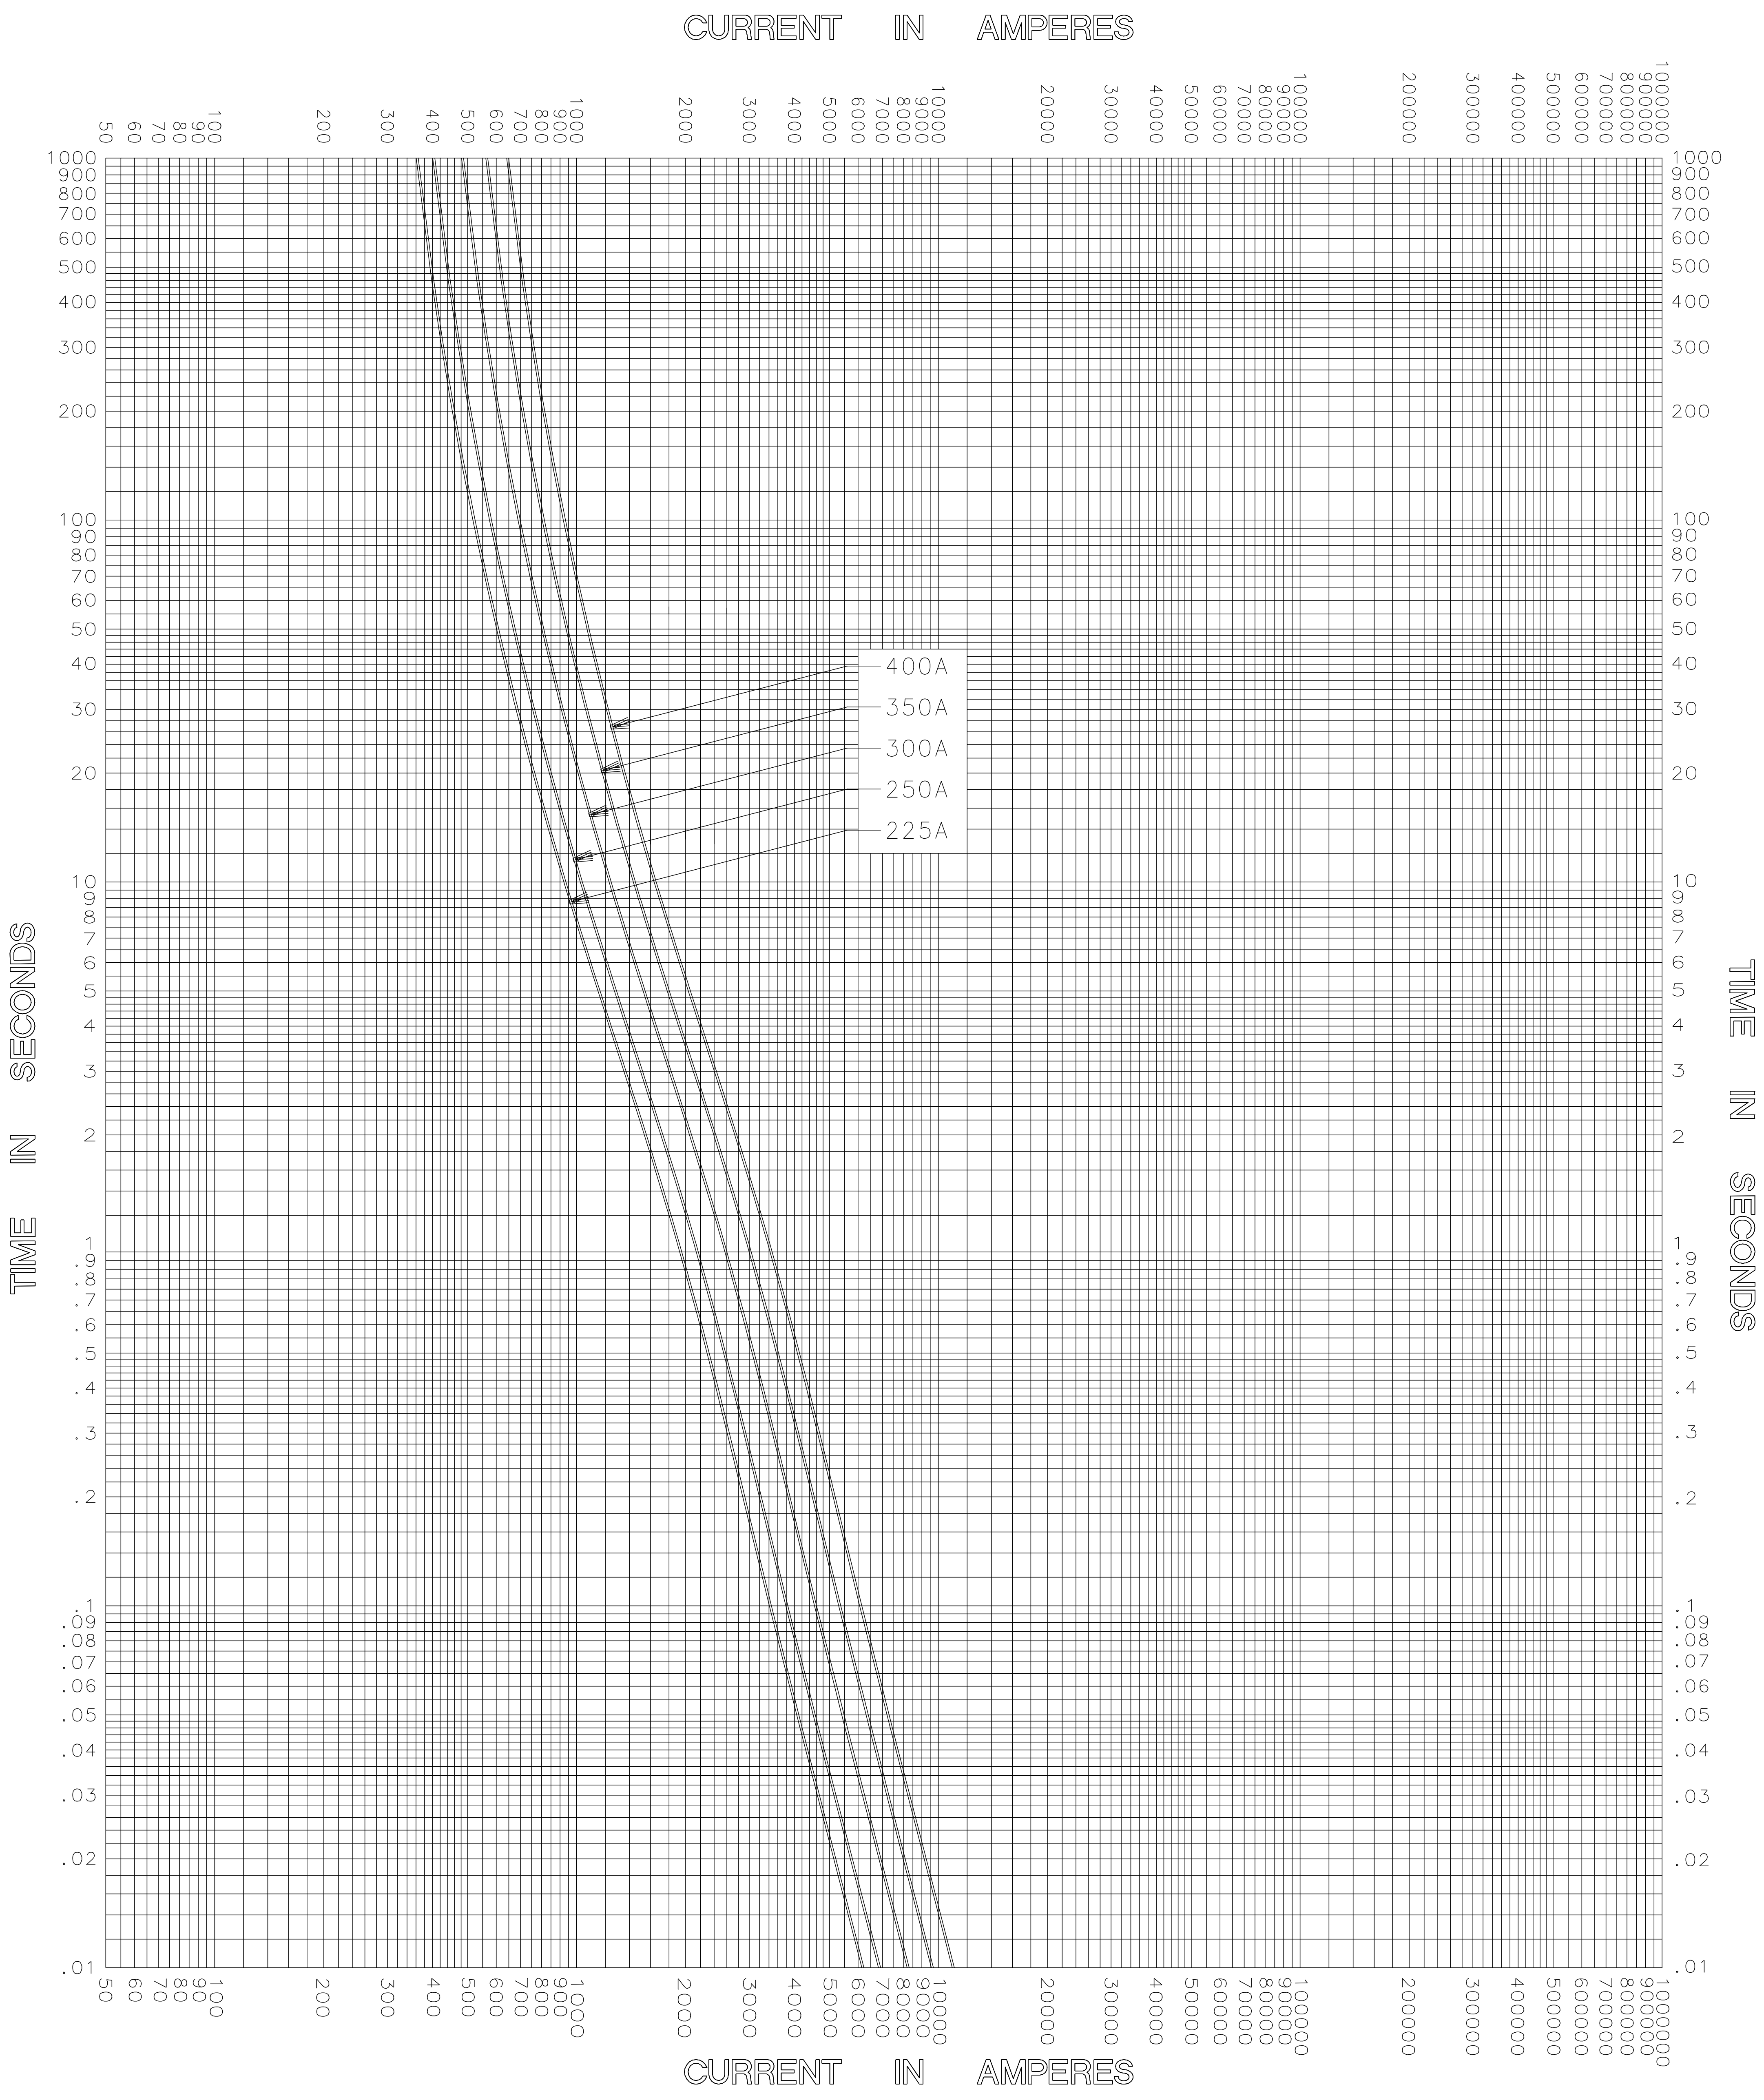

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		NLN (225A - 400A)




DRAWN BY	LLL
DATE	08/18/04
CHECKED BY	MP
DRAWING NO.	A FCC01 NLN 006

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

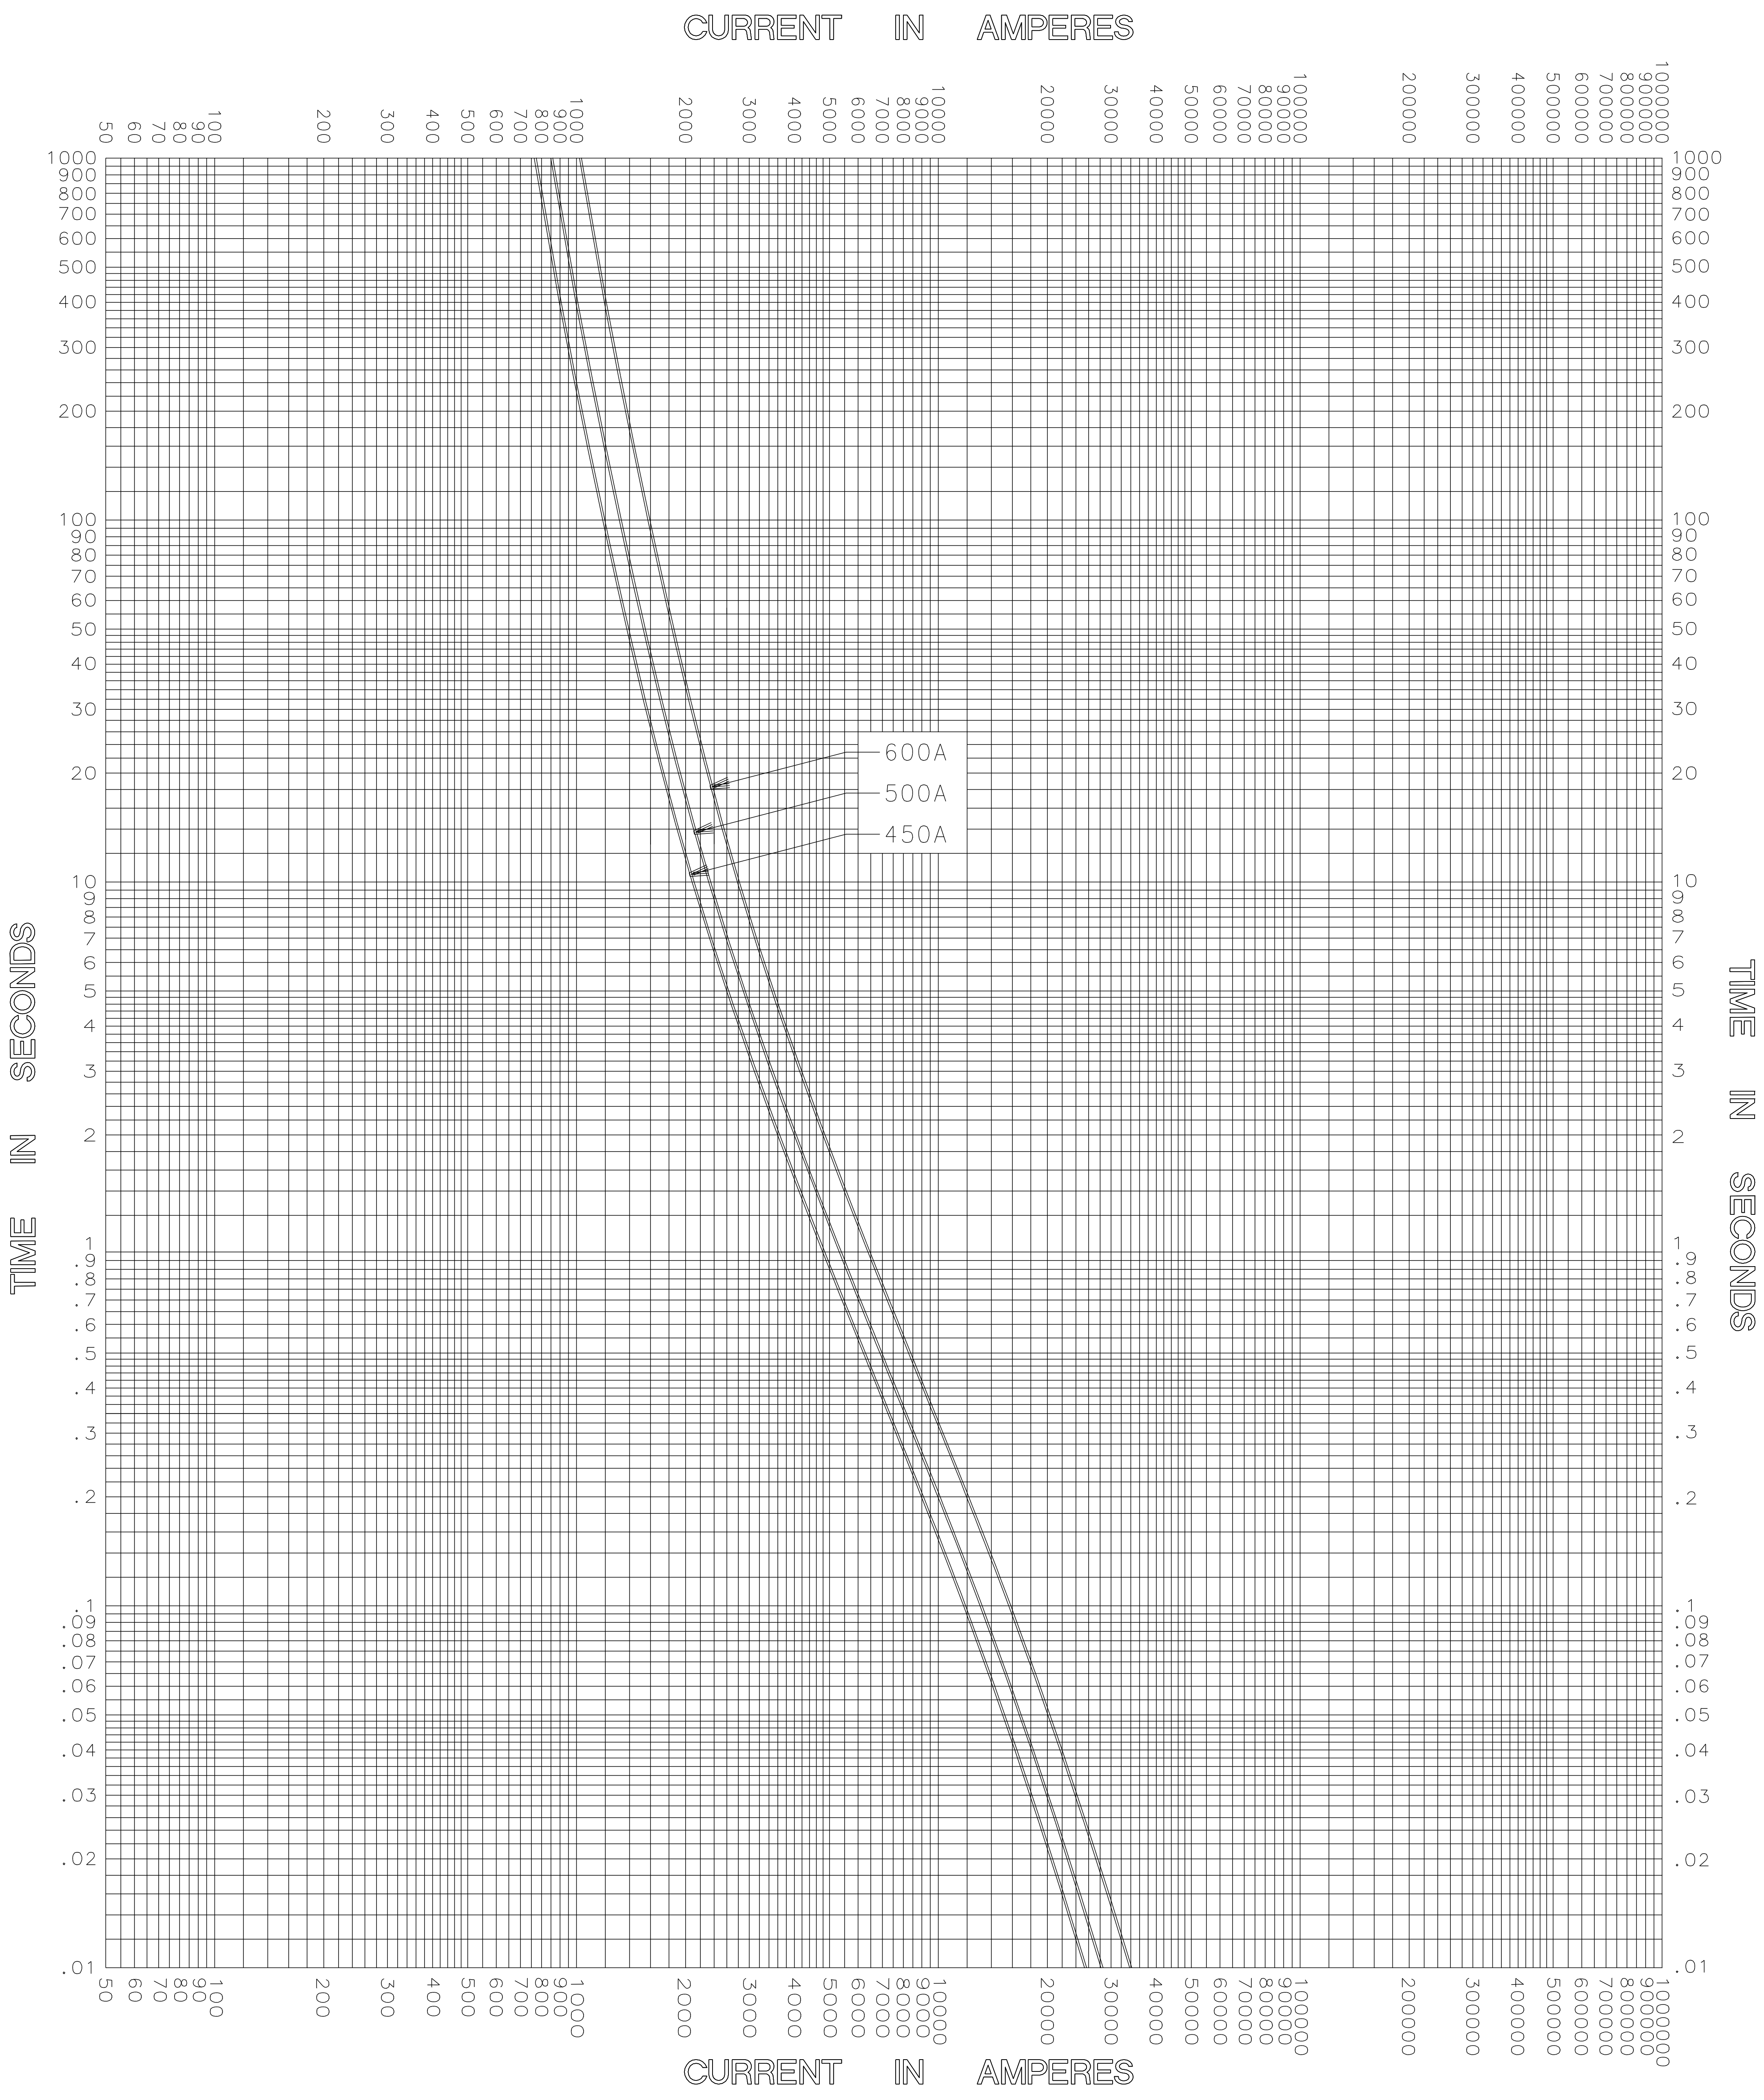

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		NLN (450A - 600A)




DRAWN BY	LLL
DATE	08/18/04
CHECKED BY	MP
DRAWING NO.	A FCC001411007

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-


UNCONTROLLED DOCUMENT

TIME IN SECONDS

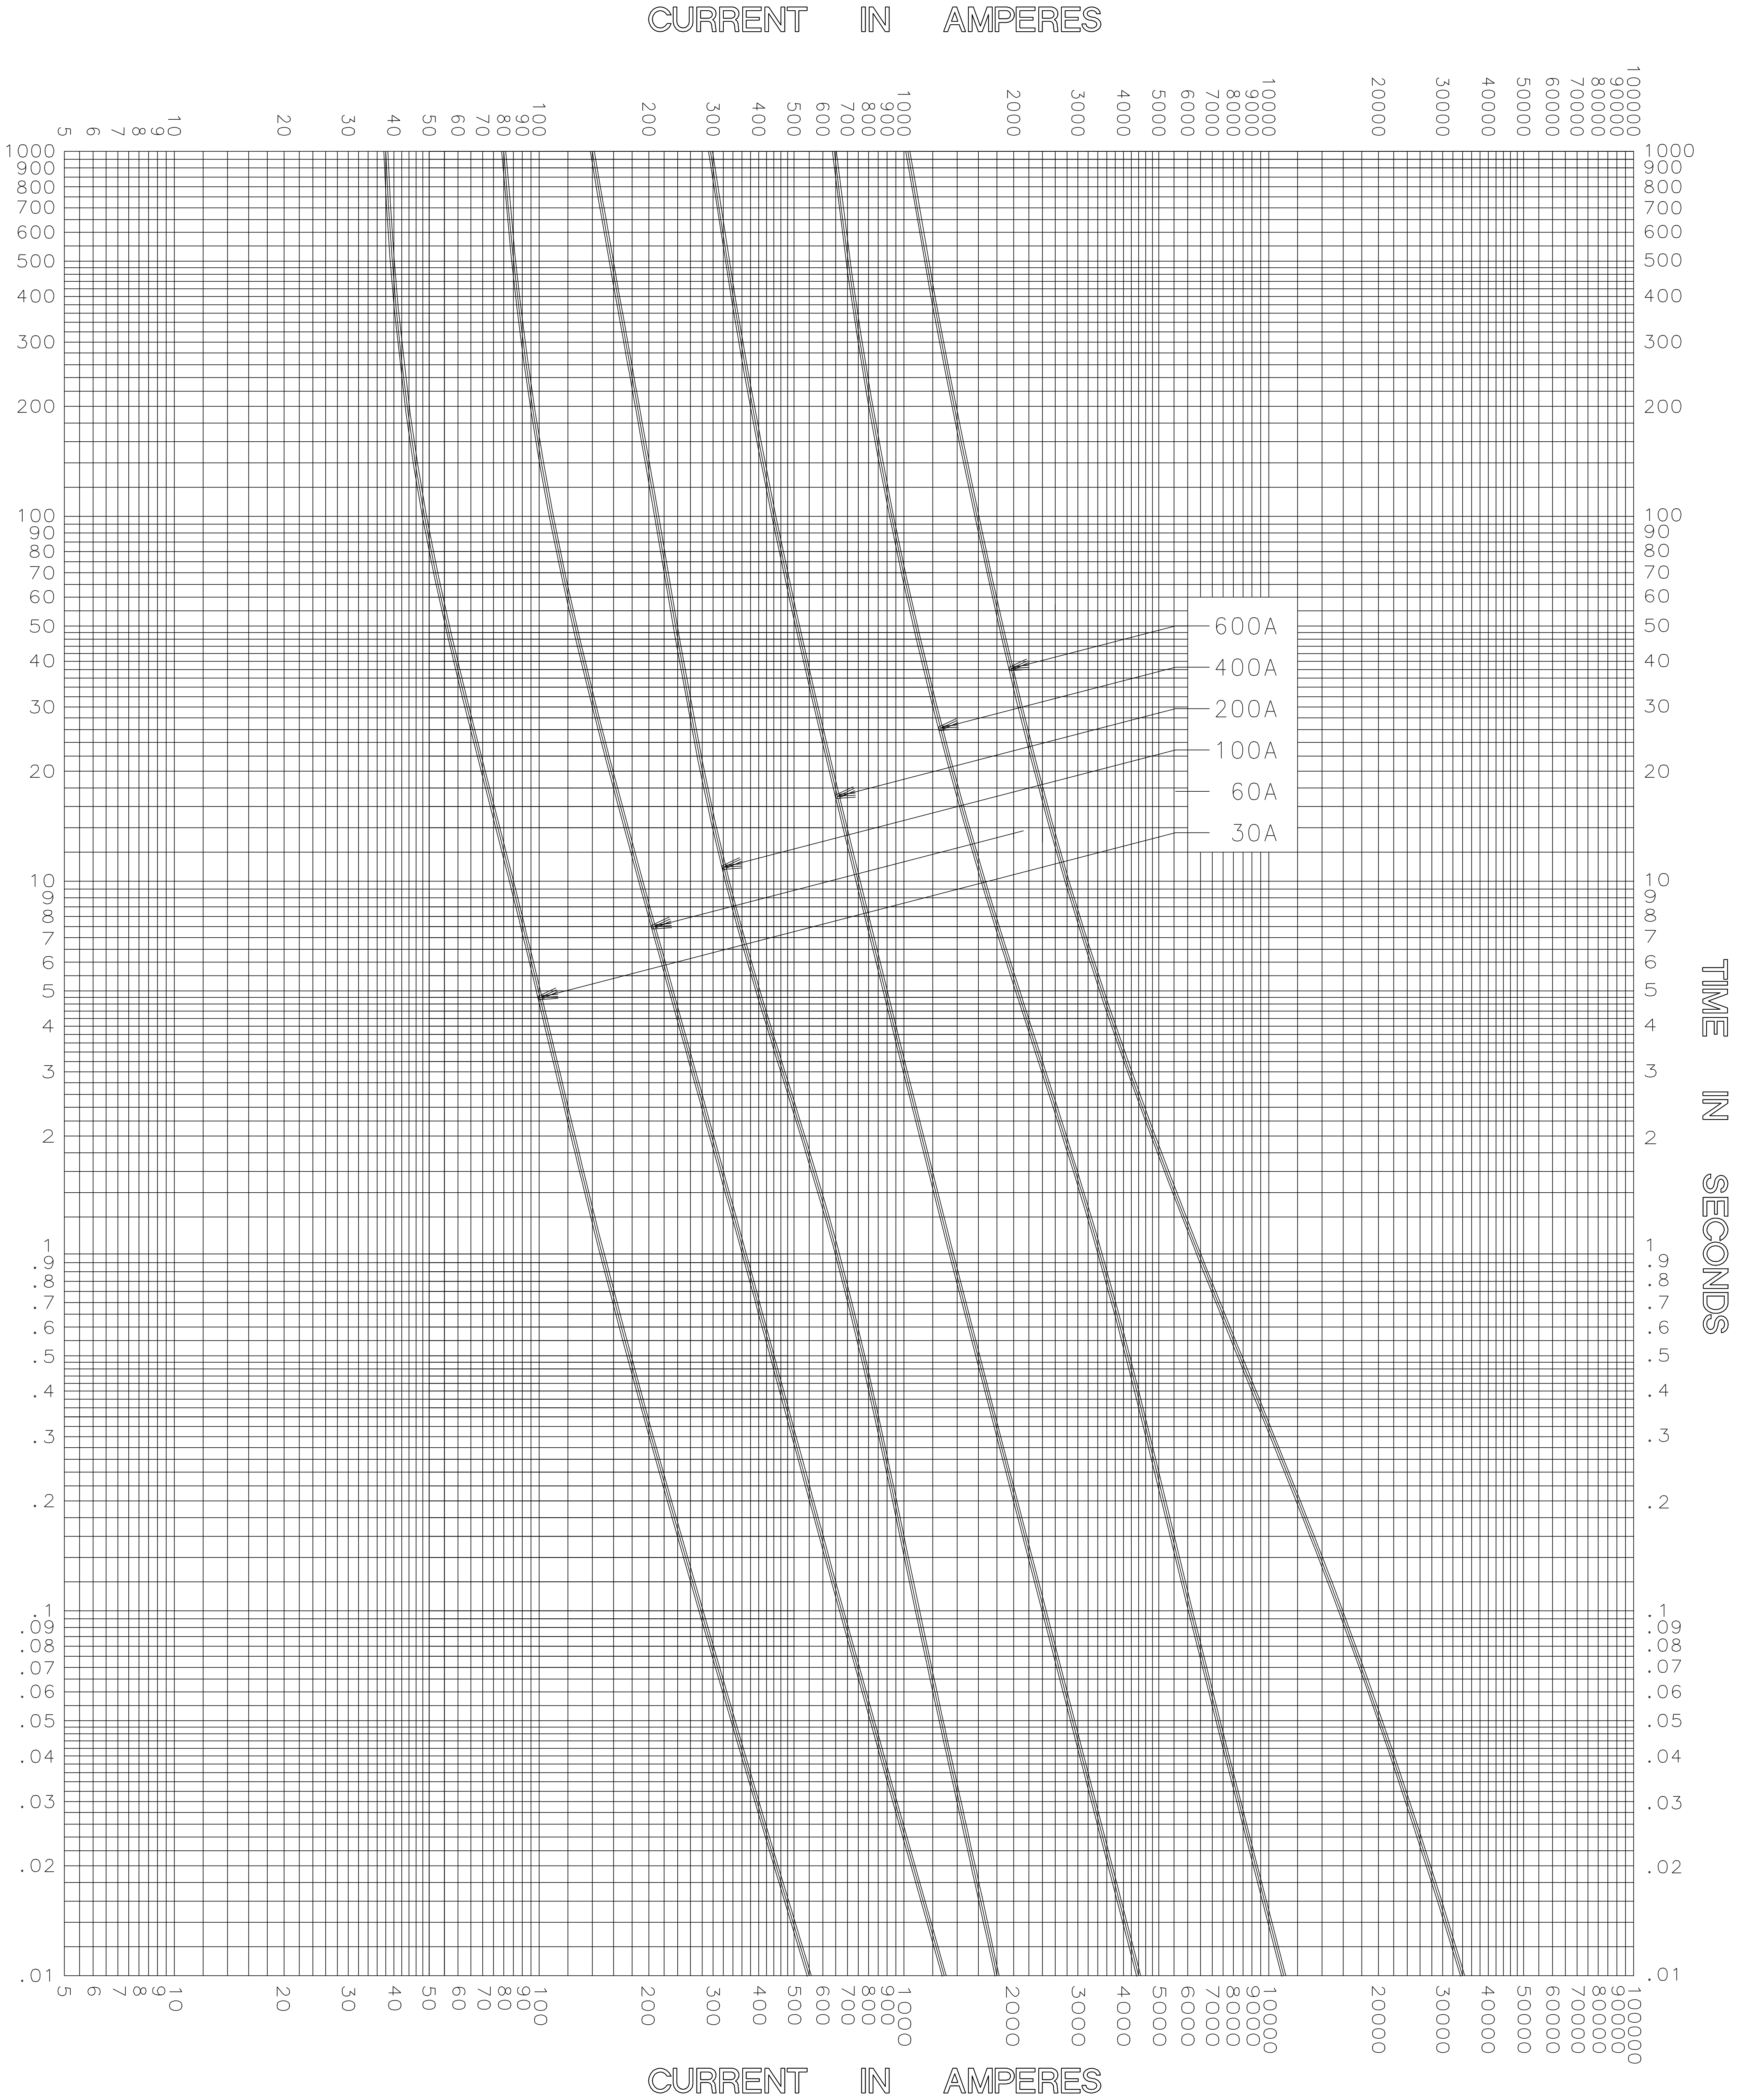

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
NLN (30A - 600A)

 **Littelfuse®**
DES PLAINES, ILLINOIS 60016

DRAWN BY LLL
DATE 08/18/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A FCC001 NLN 003

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT