



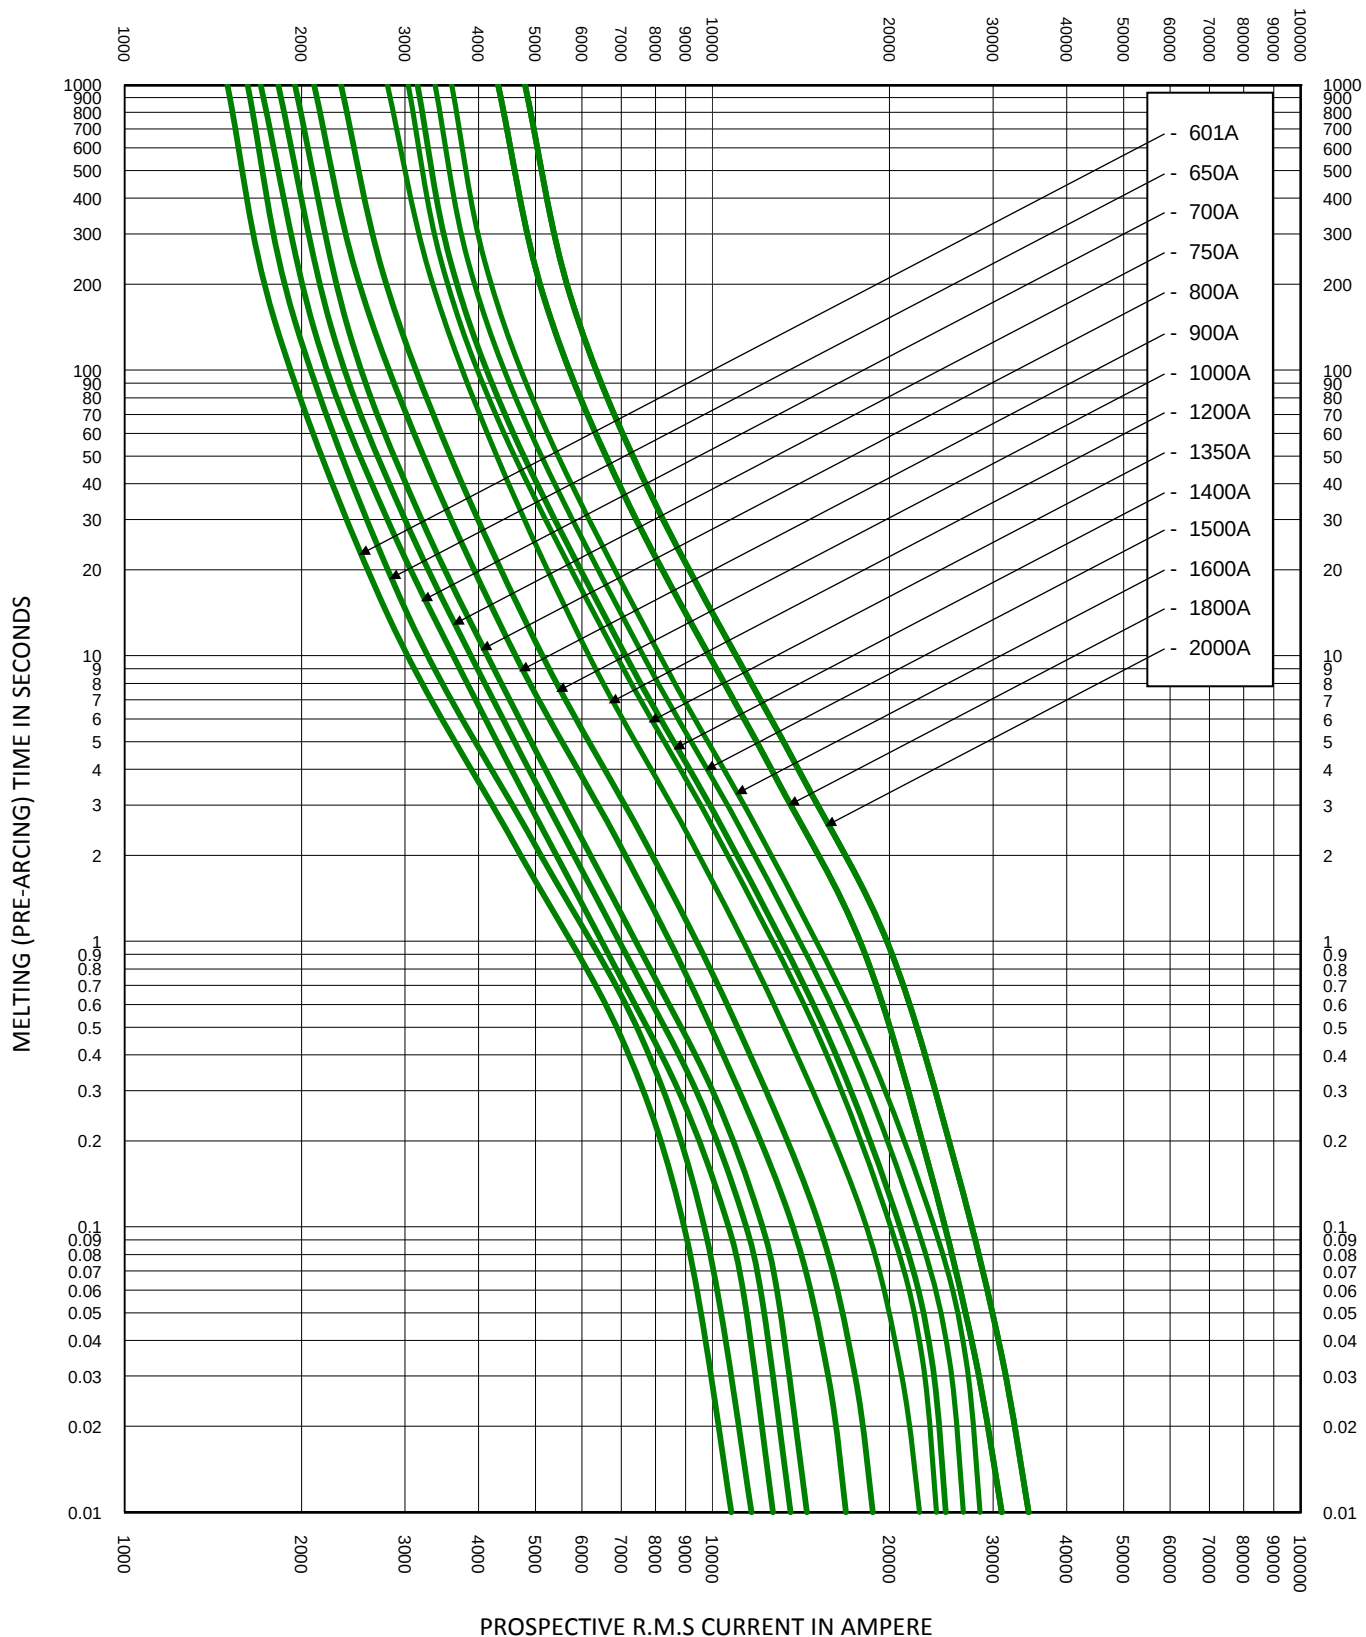

TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLLU 601A - 4000A	
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 05/31/2017	
TIME CURRENT CHARACTERISTIC CURVES		REVISION: A	
		DRAWING NO.: FCC01-KLLU	SHEET 2 OF 3

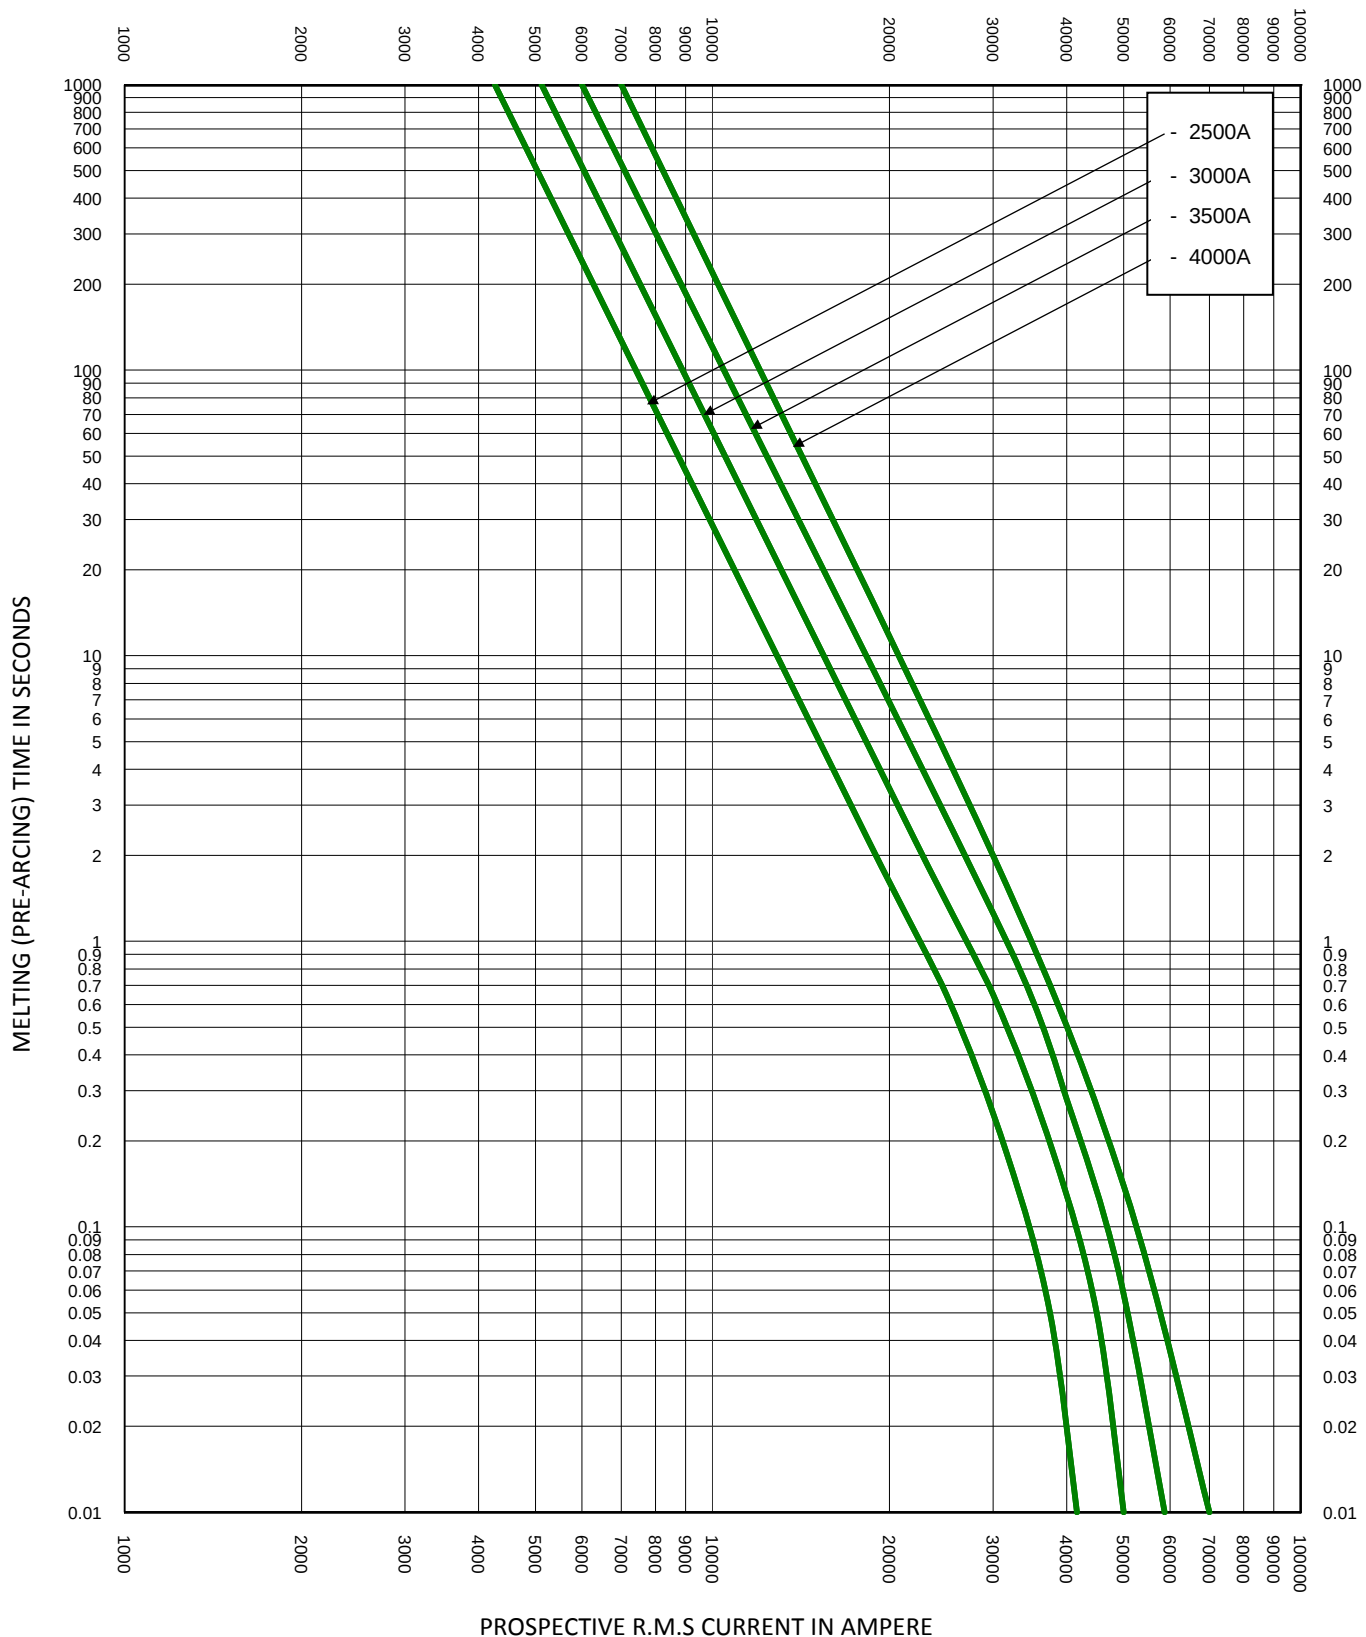

TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		KLLU 601A - 4000A	
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 05/31/2017	
TIME CURRENT CHARACTERISTIC CURVES		REVISION: A	
		DRAWING NO.: FCC01-KLLU SHEET 3 OF 3	