


CURRENT IN AMPERES

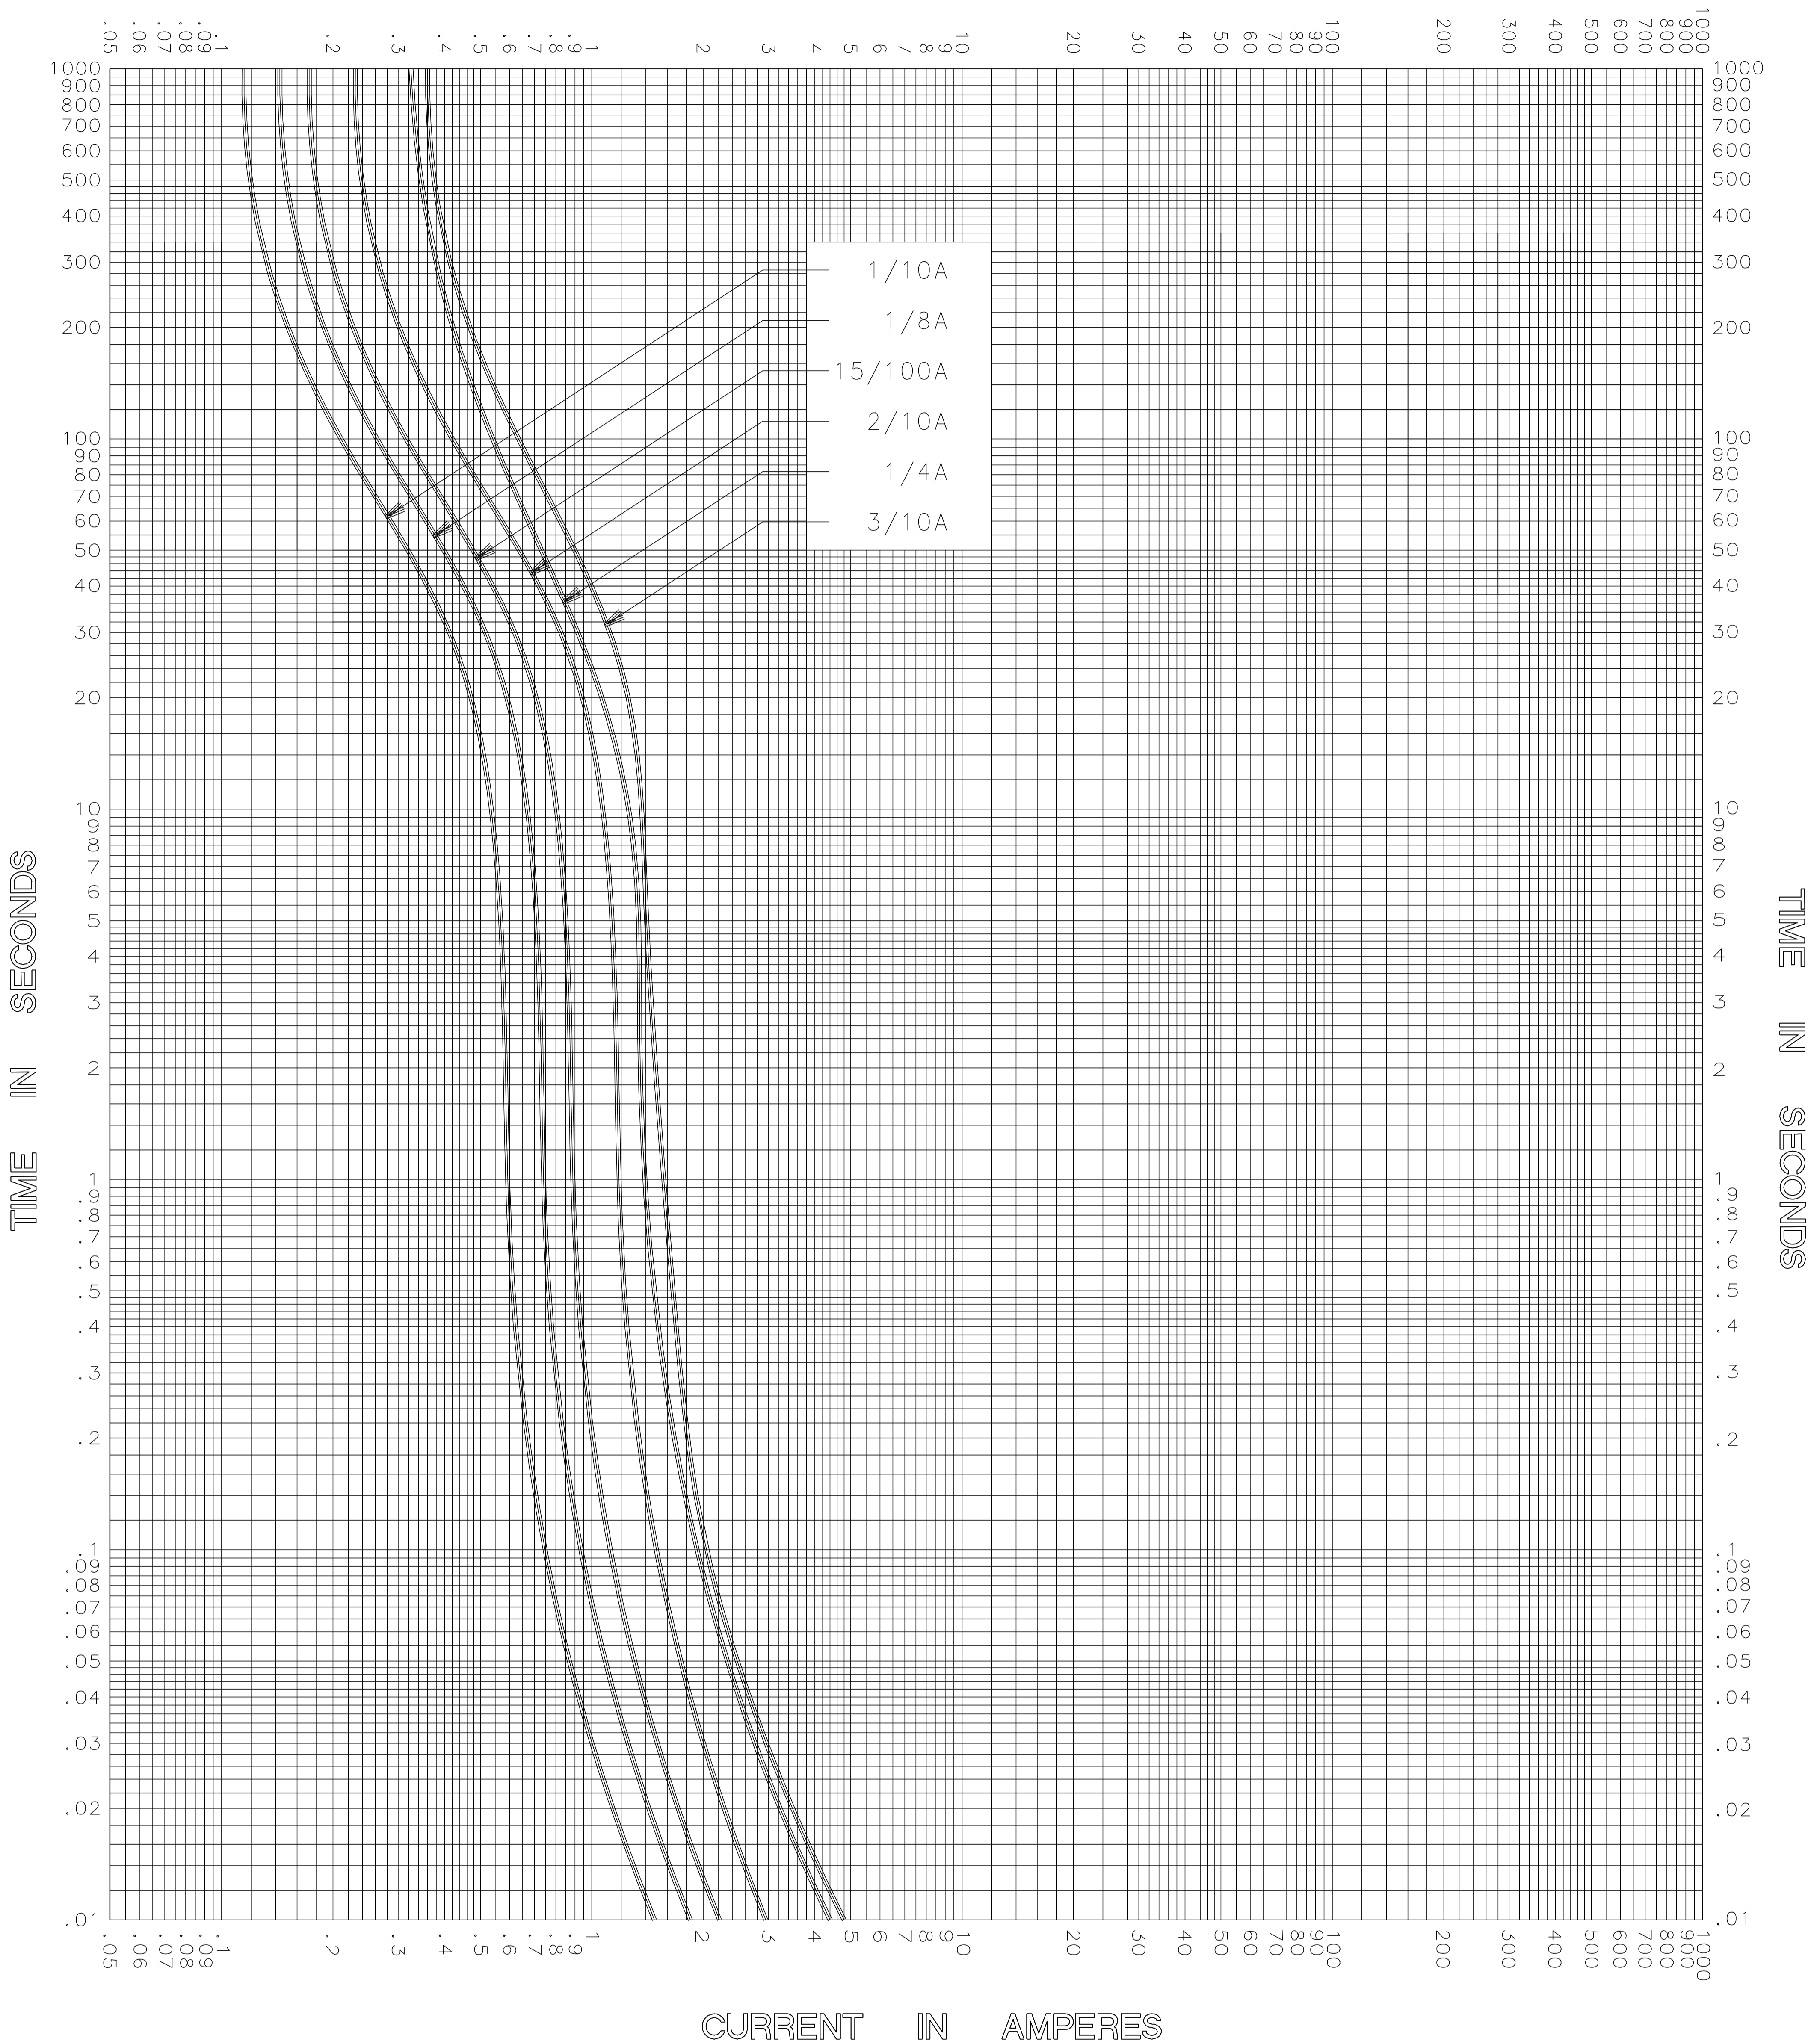

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (1/10A - 3/10A)
BASIS FOR DATA _____	


 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY MRD
	DATE 02/03/04
	CHECKED BY MP
	DRAWING NO. B-FCC01-11R-001

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

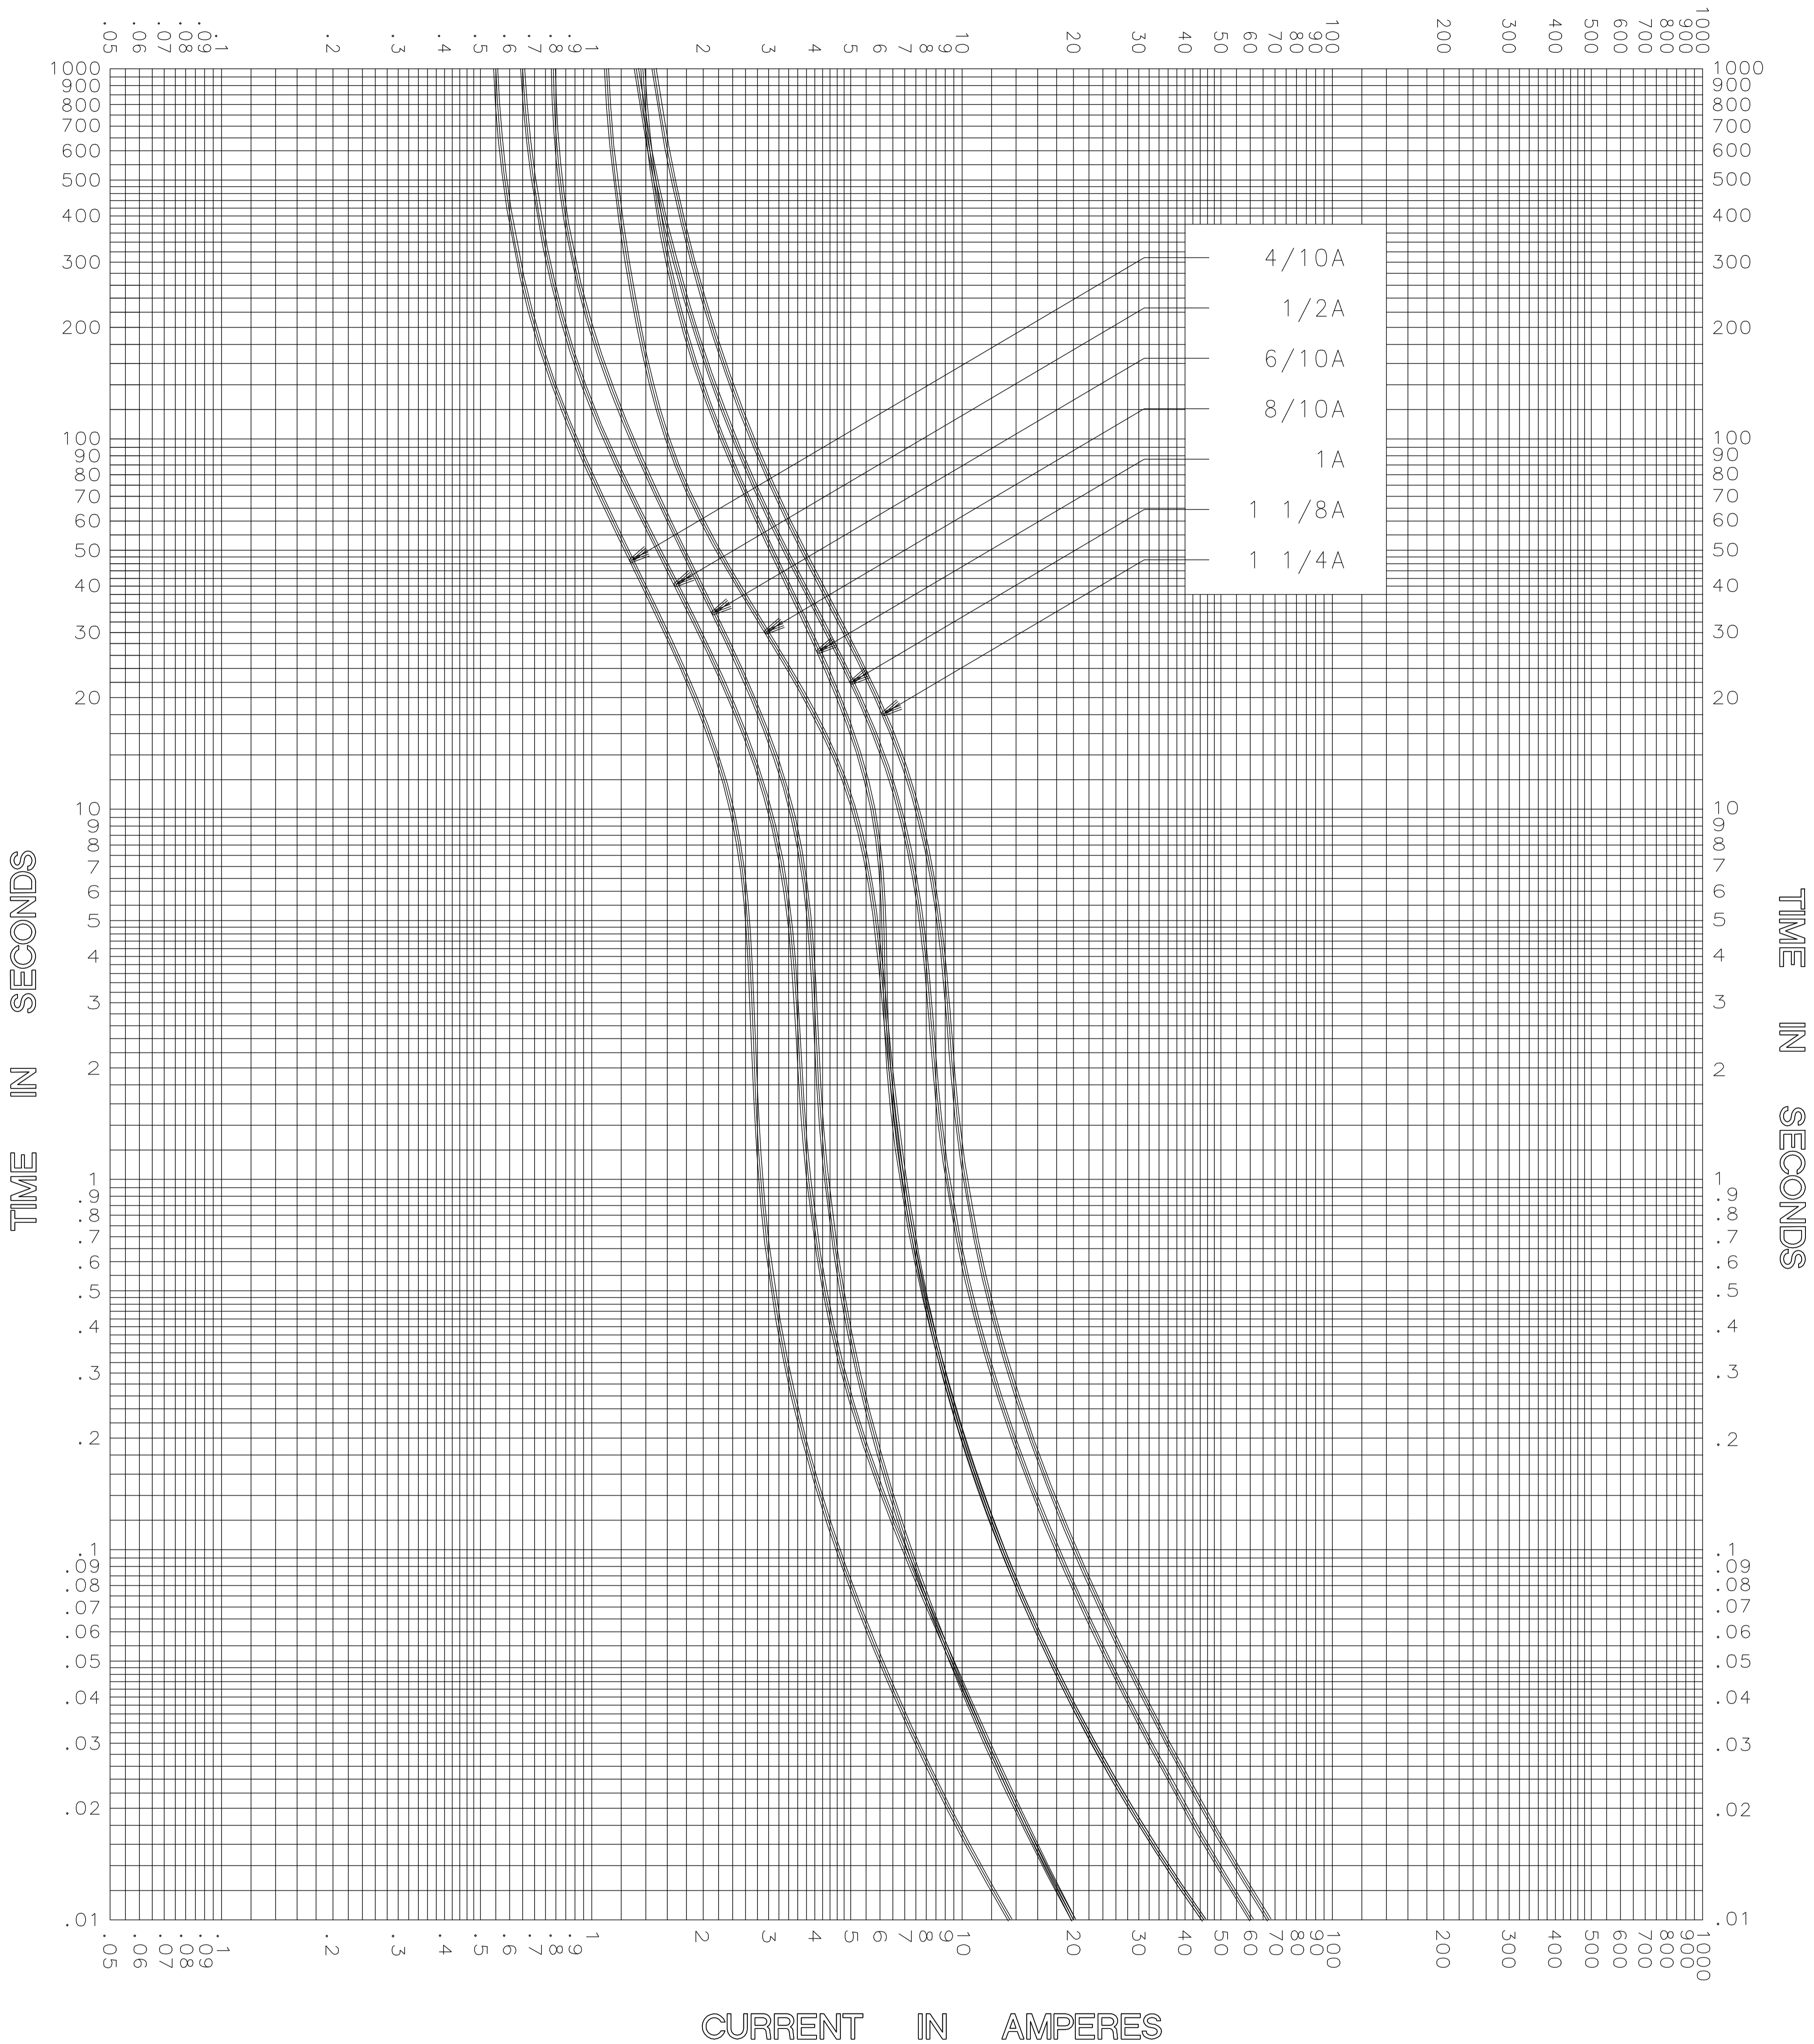

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		FLNR (4/10A - 1 1/4A)



LITTELFUSE, INC.  
DES PLAINES, ILL. USA


DRAWN BY	MRD
DATE	02/03/04
CHECKED BY	MP

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. B-FCC0141NR002
------------------------------------	----------------------------

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

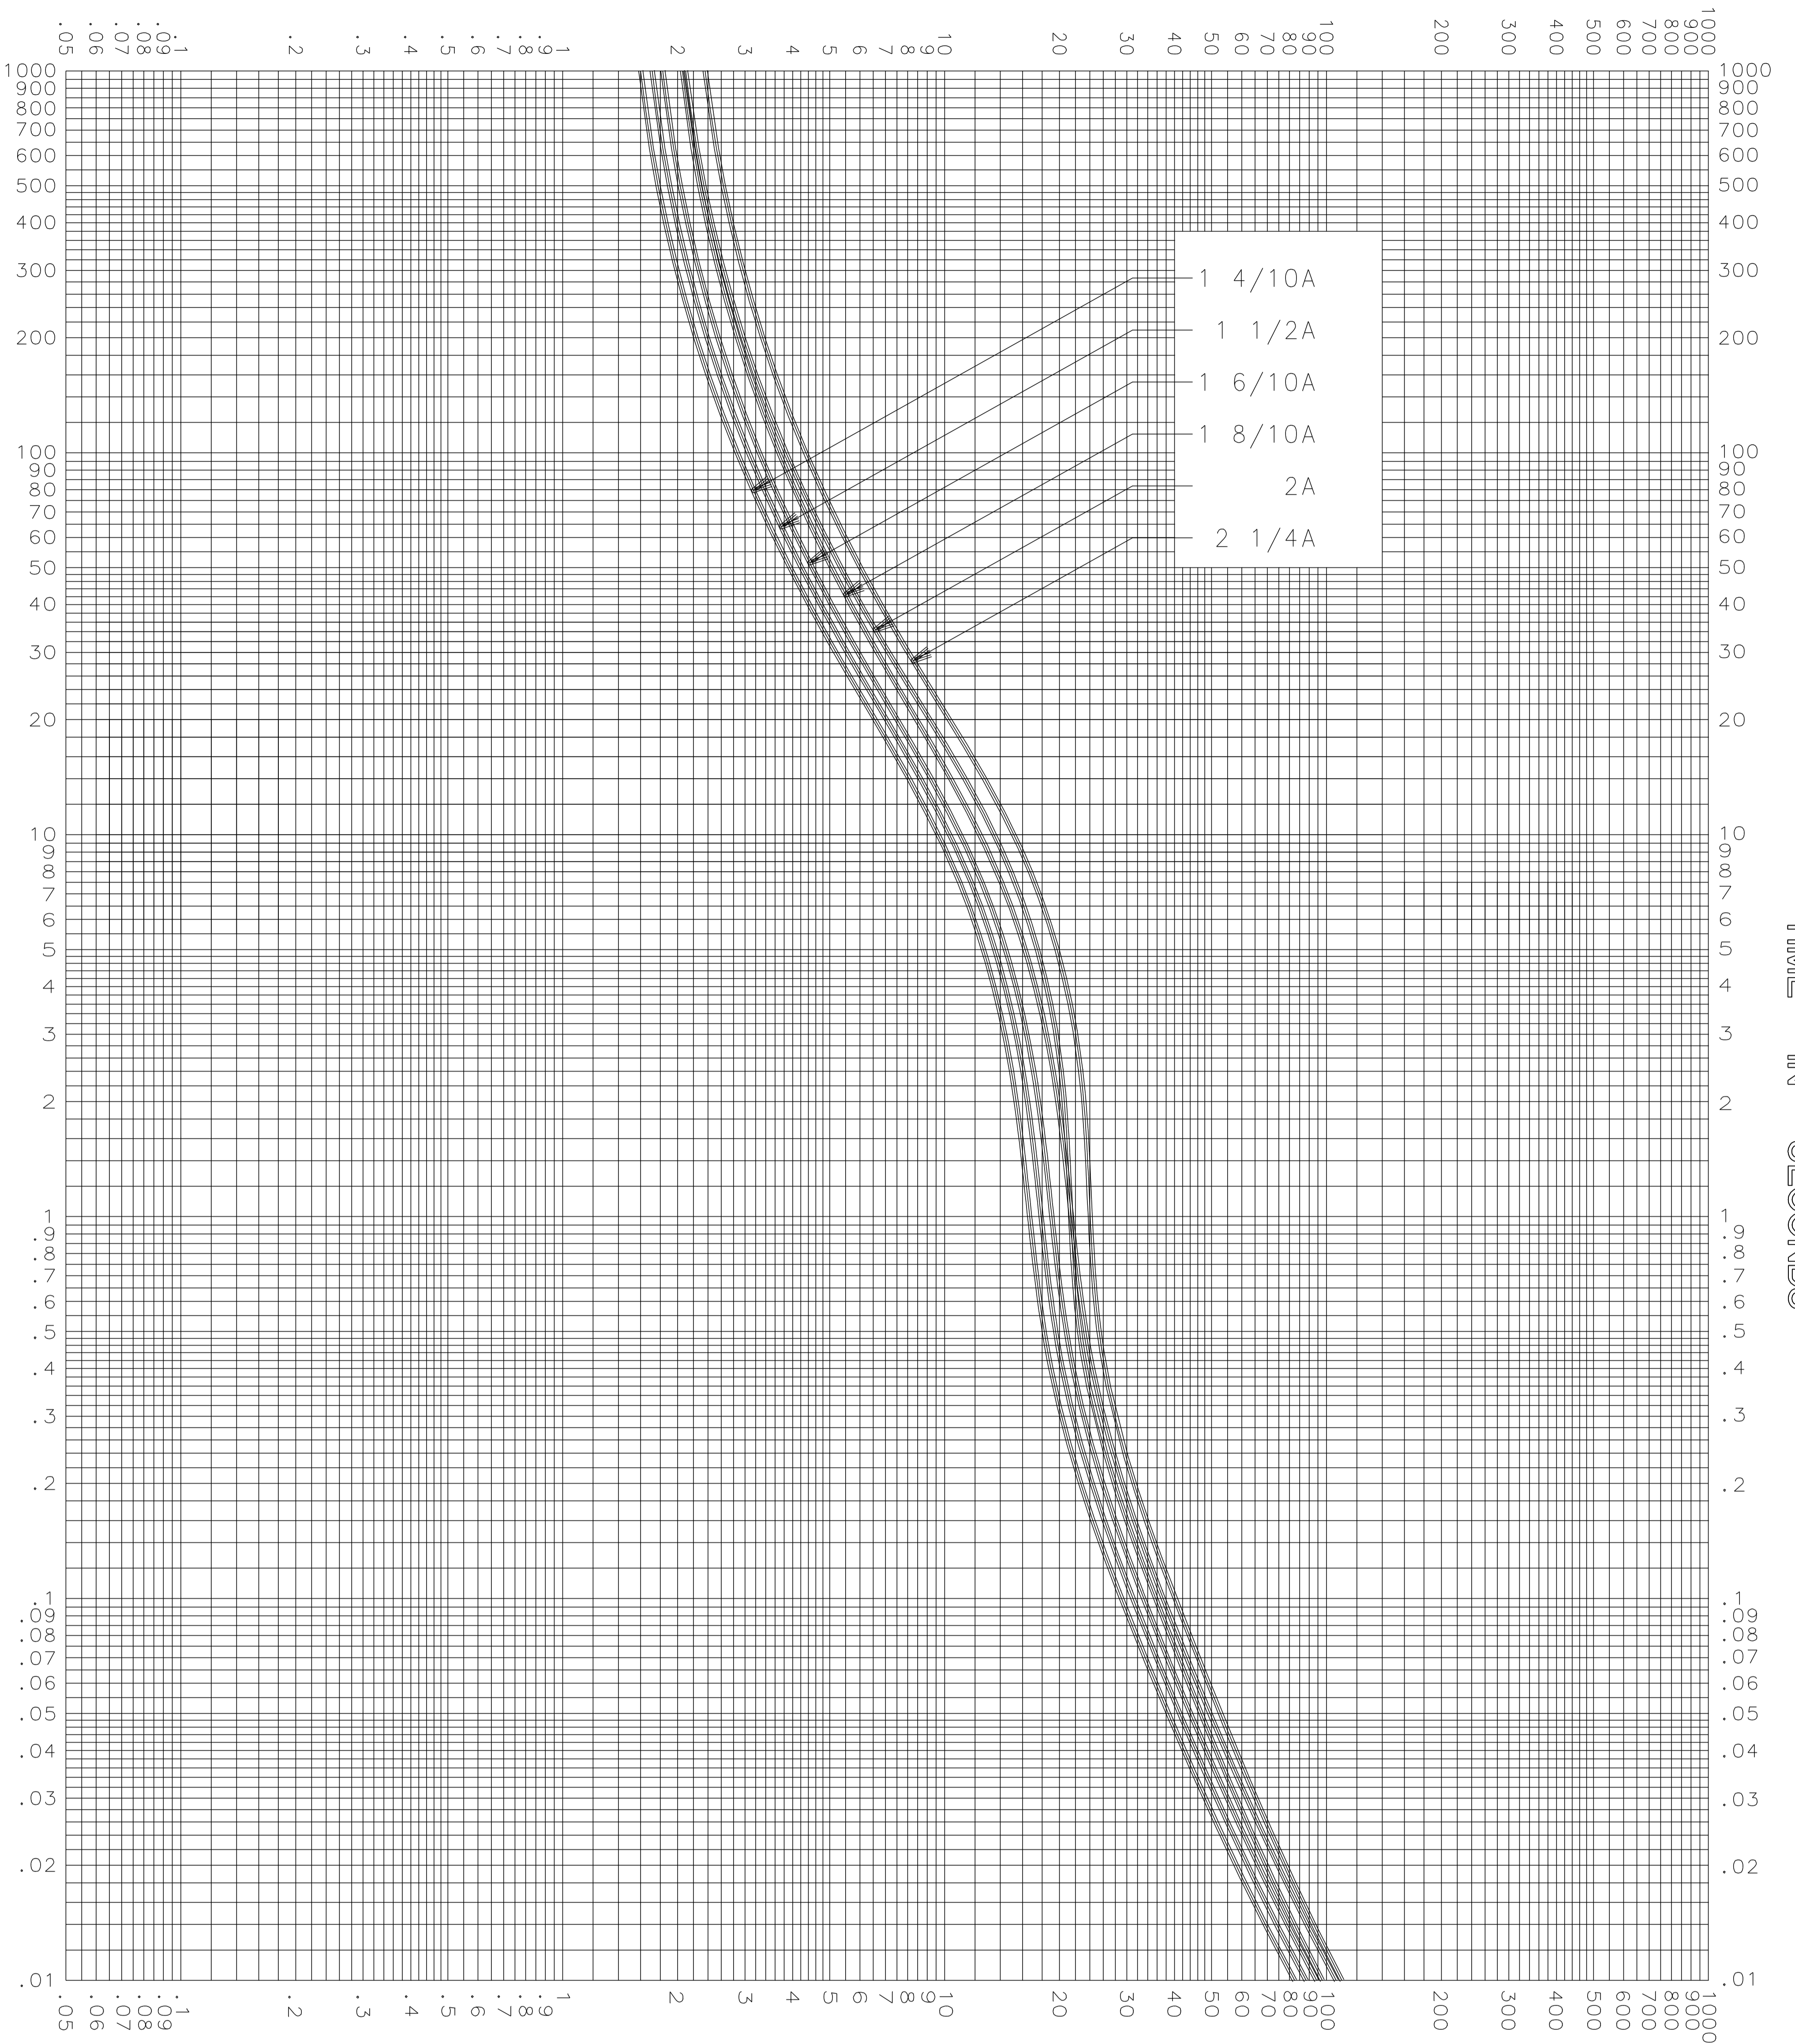

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		FLNR (1 4/10A - 2 1/4A)


**LITTELFUSE, INC.**  
 DES PLAINES, ILL. USA

DRAWN BY MRD  
 DATE 02/03/04  
 CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. B-FCC01 / VP 003

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

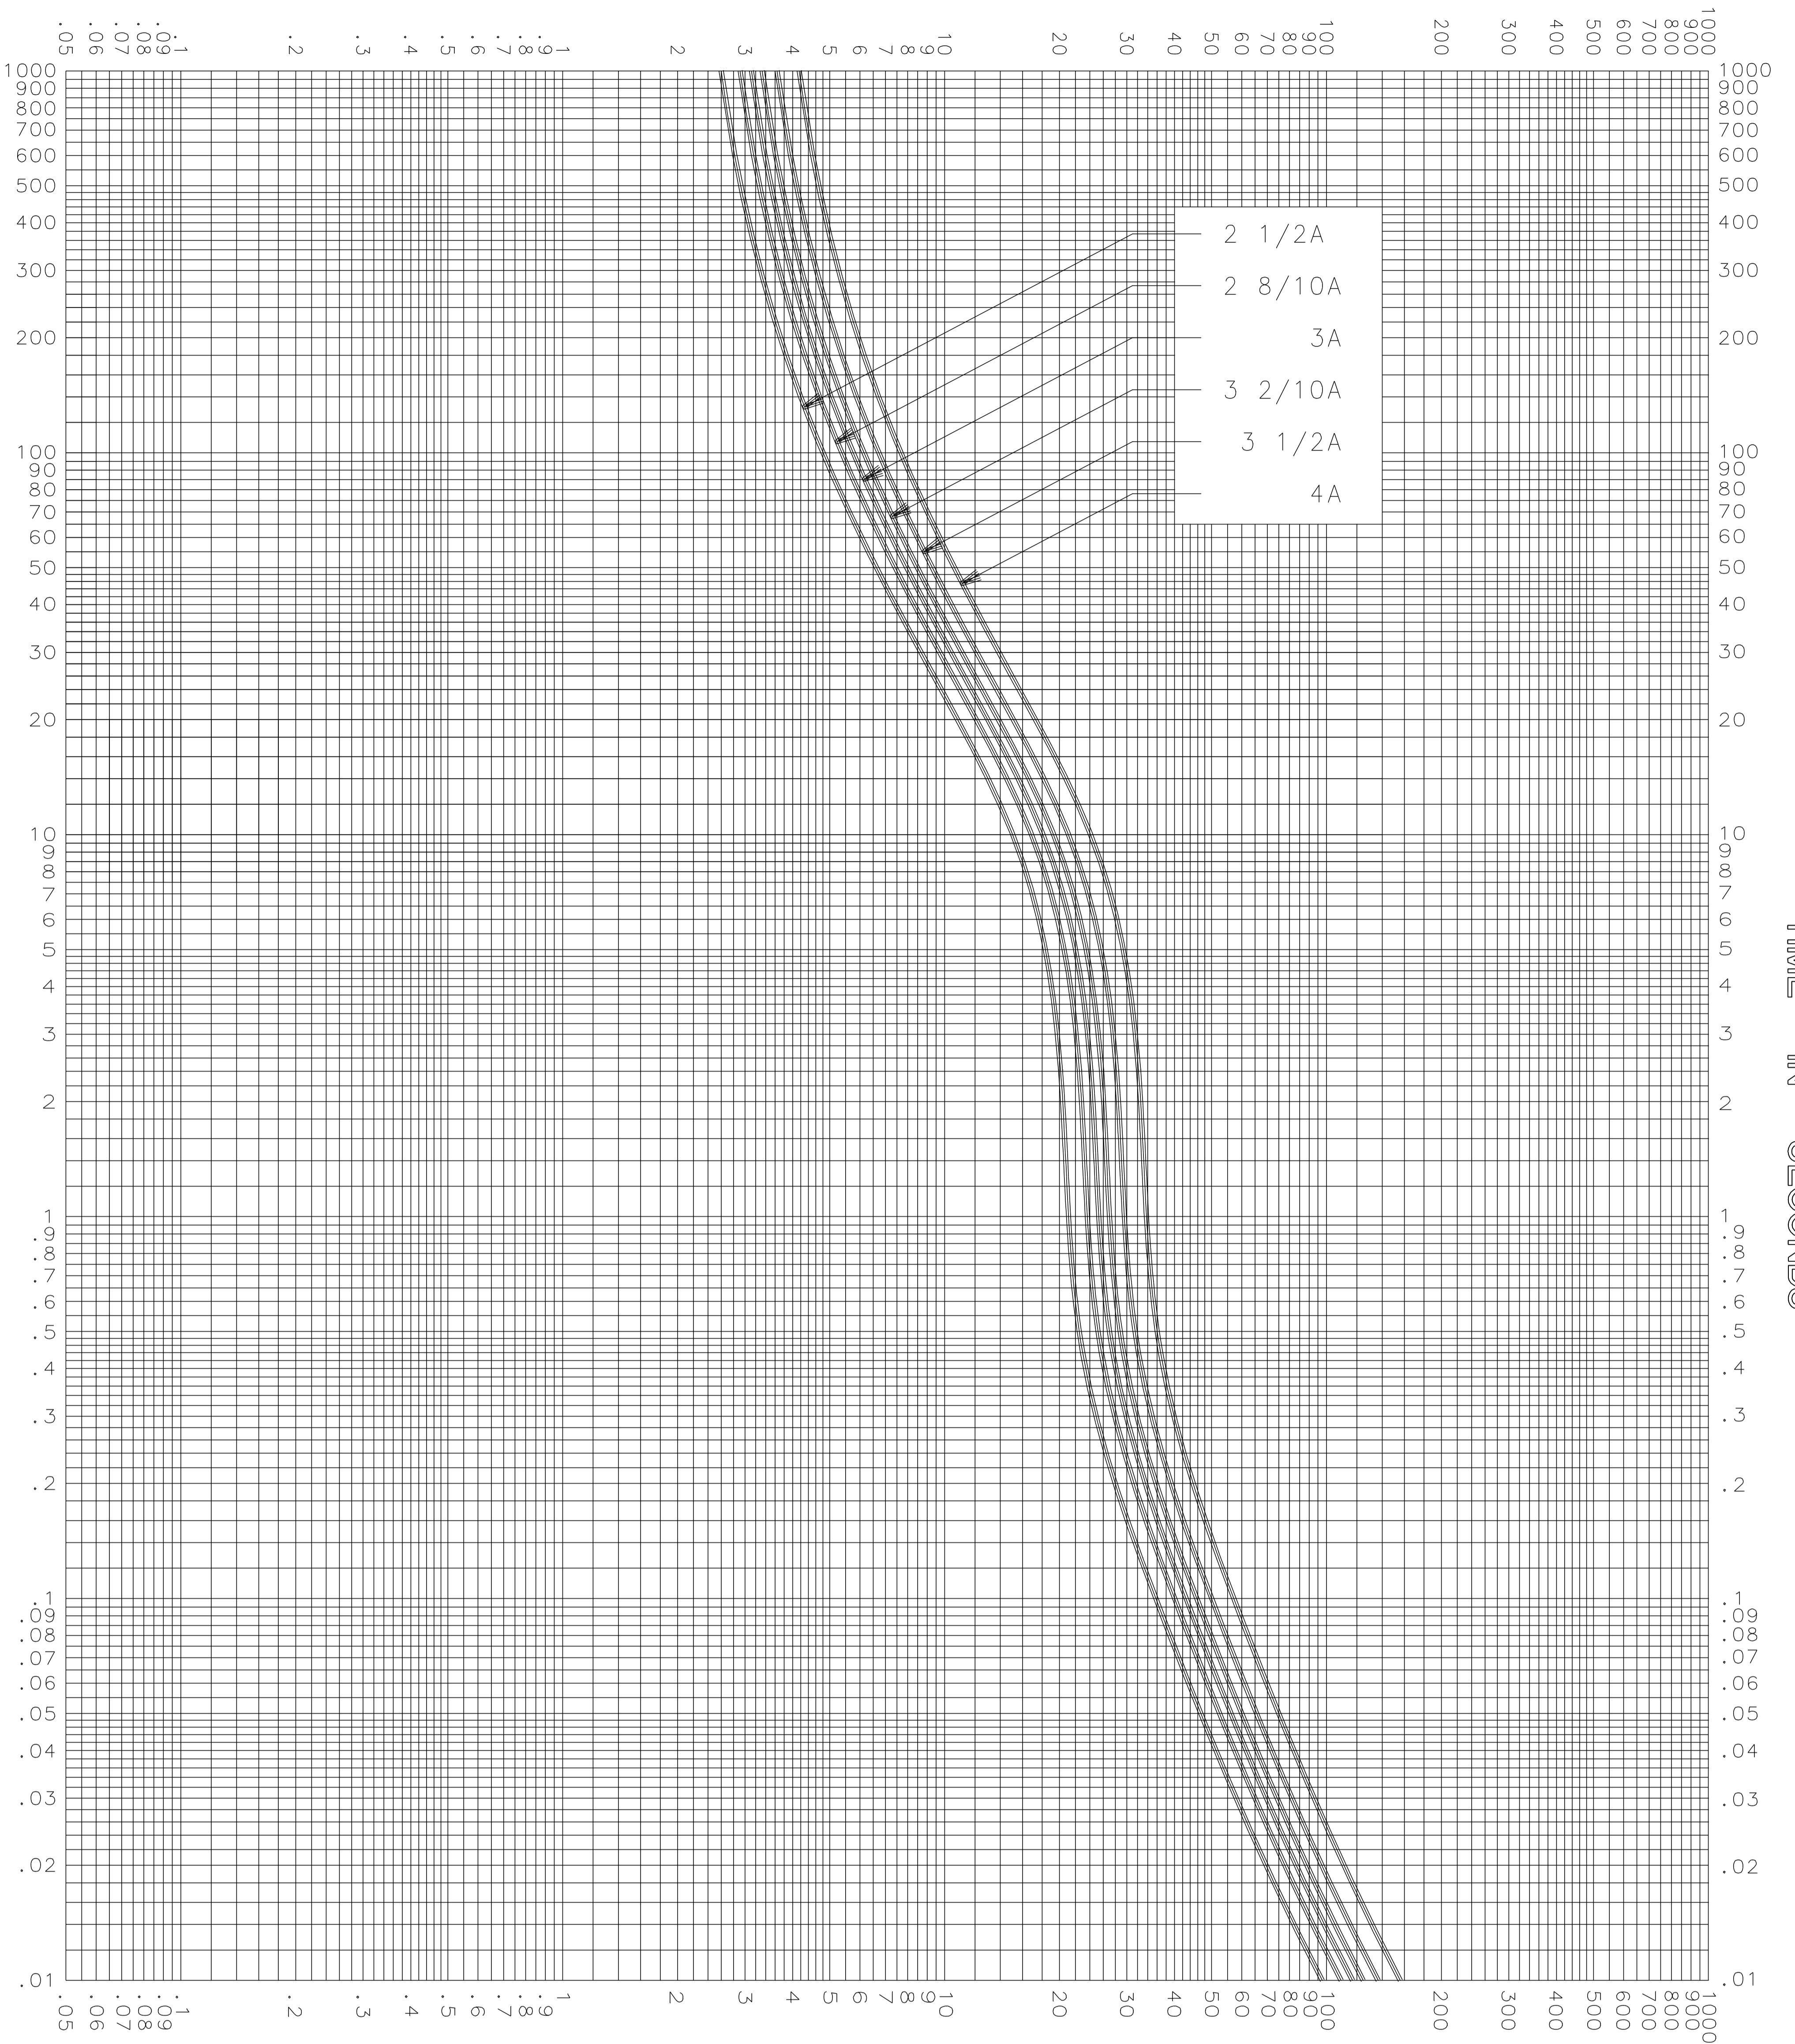

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (2 1/2A - 4A)
BASIS FOR DATA _____	


 <p>LITTELFUSE, INC. DES PLAINES, ILL. USA</p>	DRAWN BY MRD DATE 02/03/04 CHECKED BY MP
	DRAWING NO. B-FCC01 (REV) 004

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

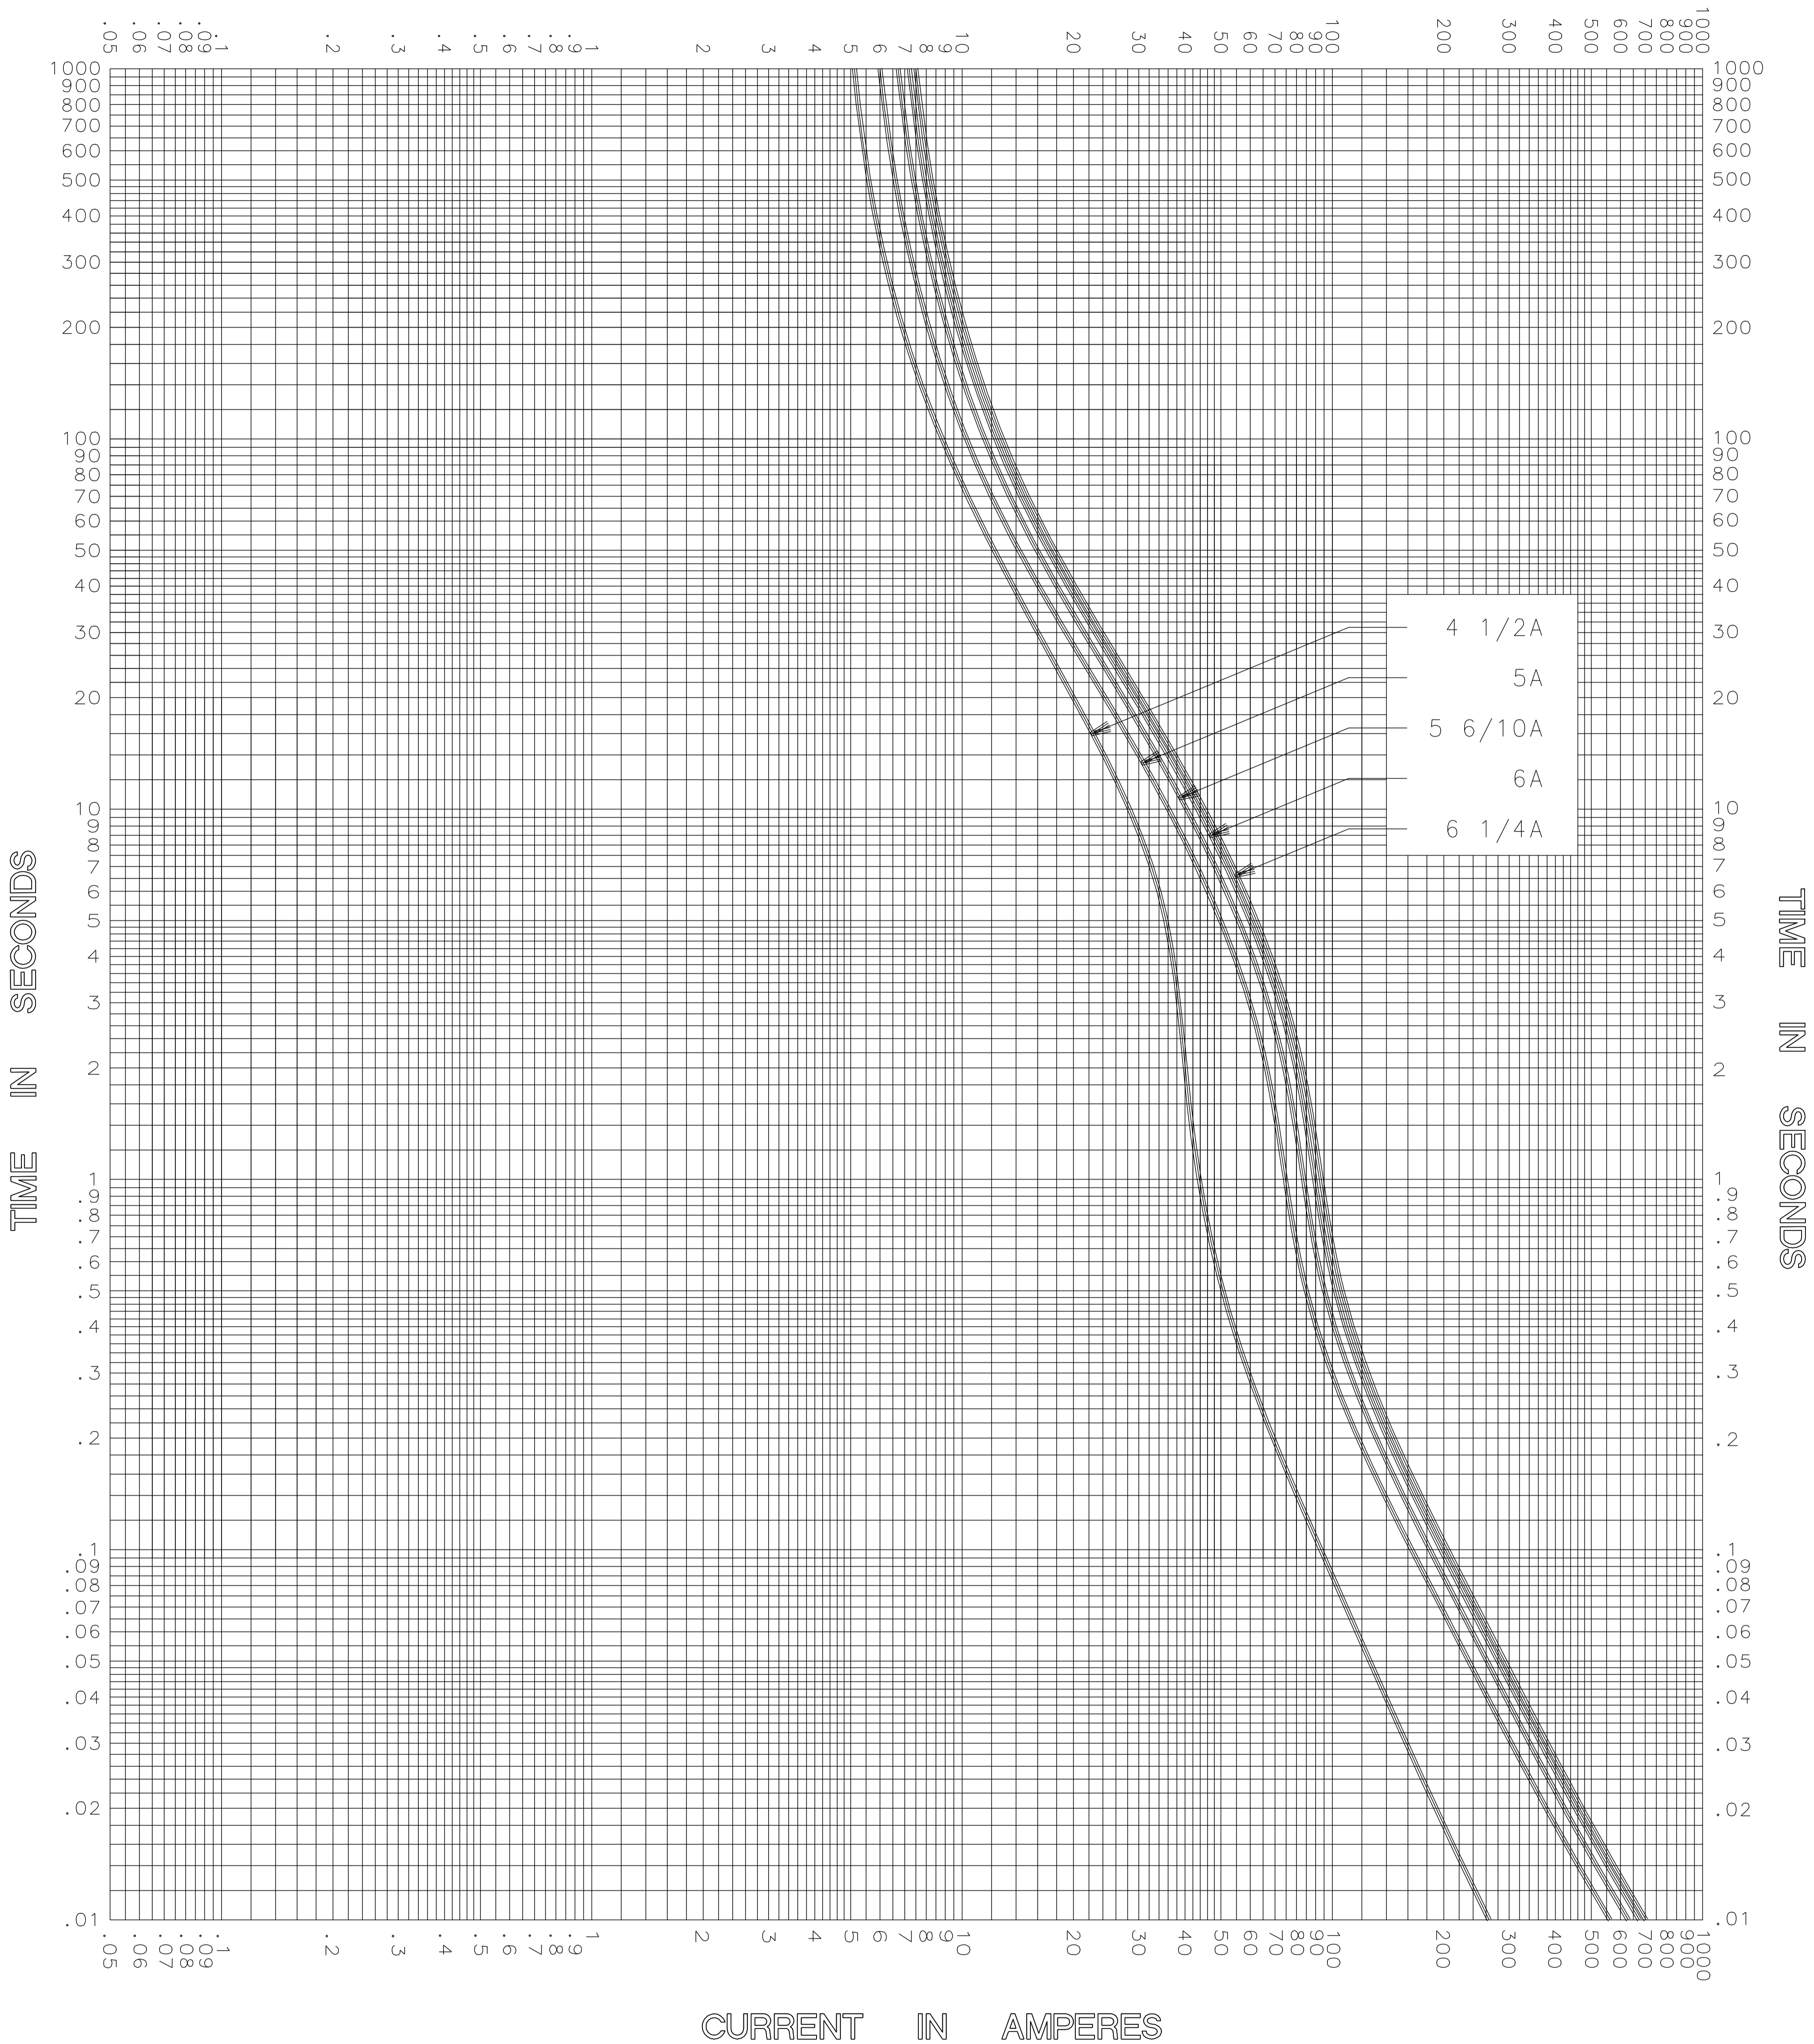

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (4 1/2A - 6 1/4A)
BASIS FOR DATA _____		



LITTELFUSE, INC.  
DES PLAINES, ILL. USA


DRAWN BY MRD
DATE 02/03/04
CHECKED BY MP
DRAWING NO. B-FCC015-LNR005

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

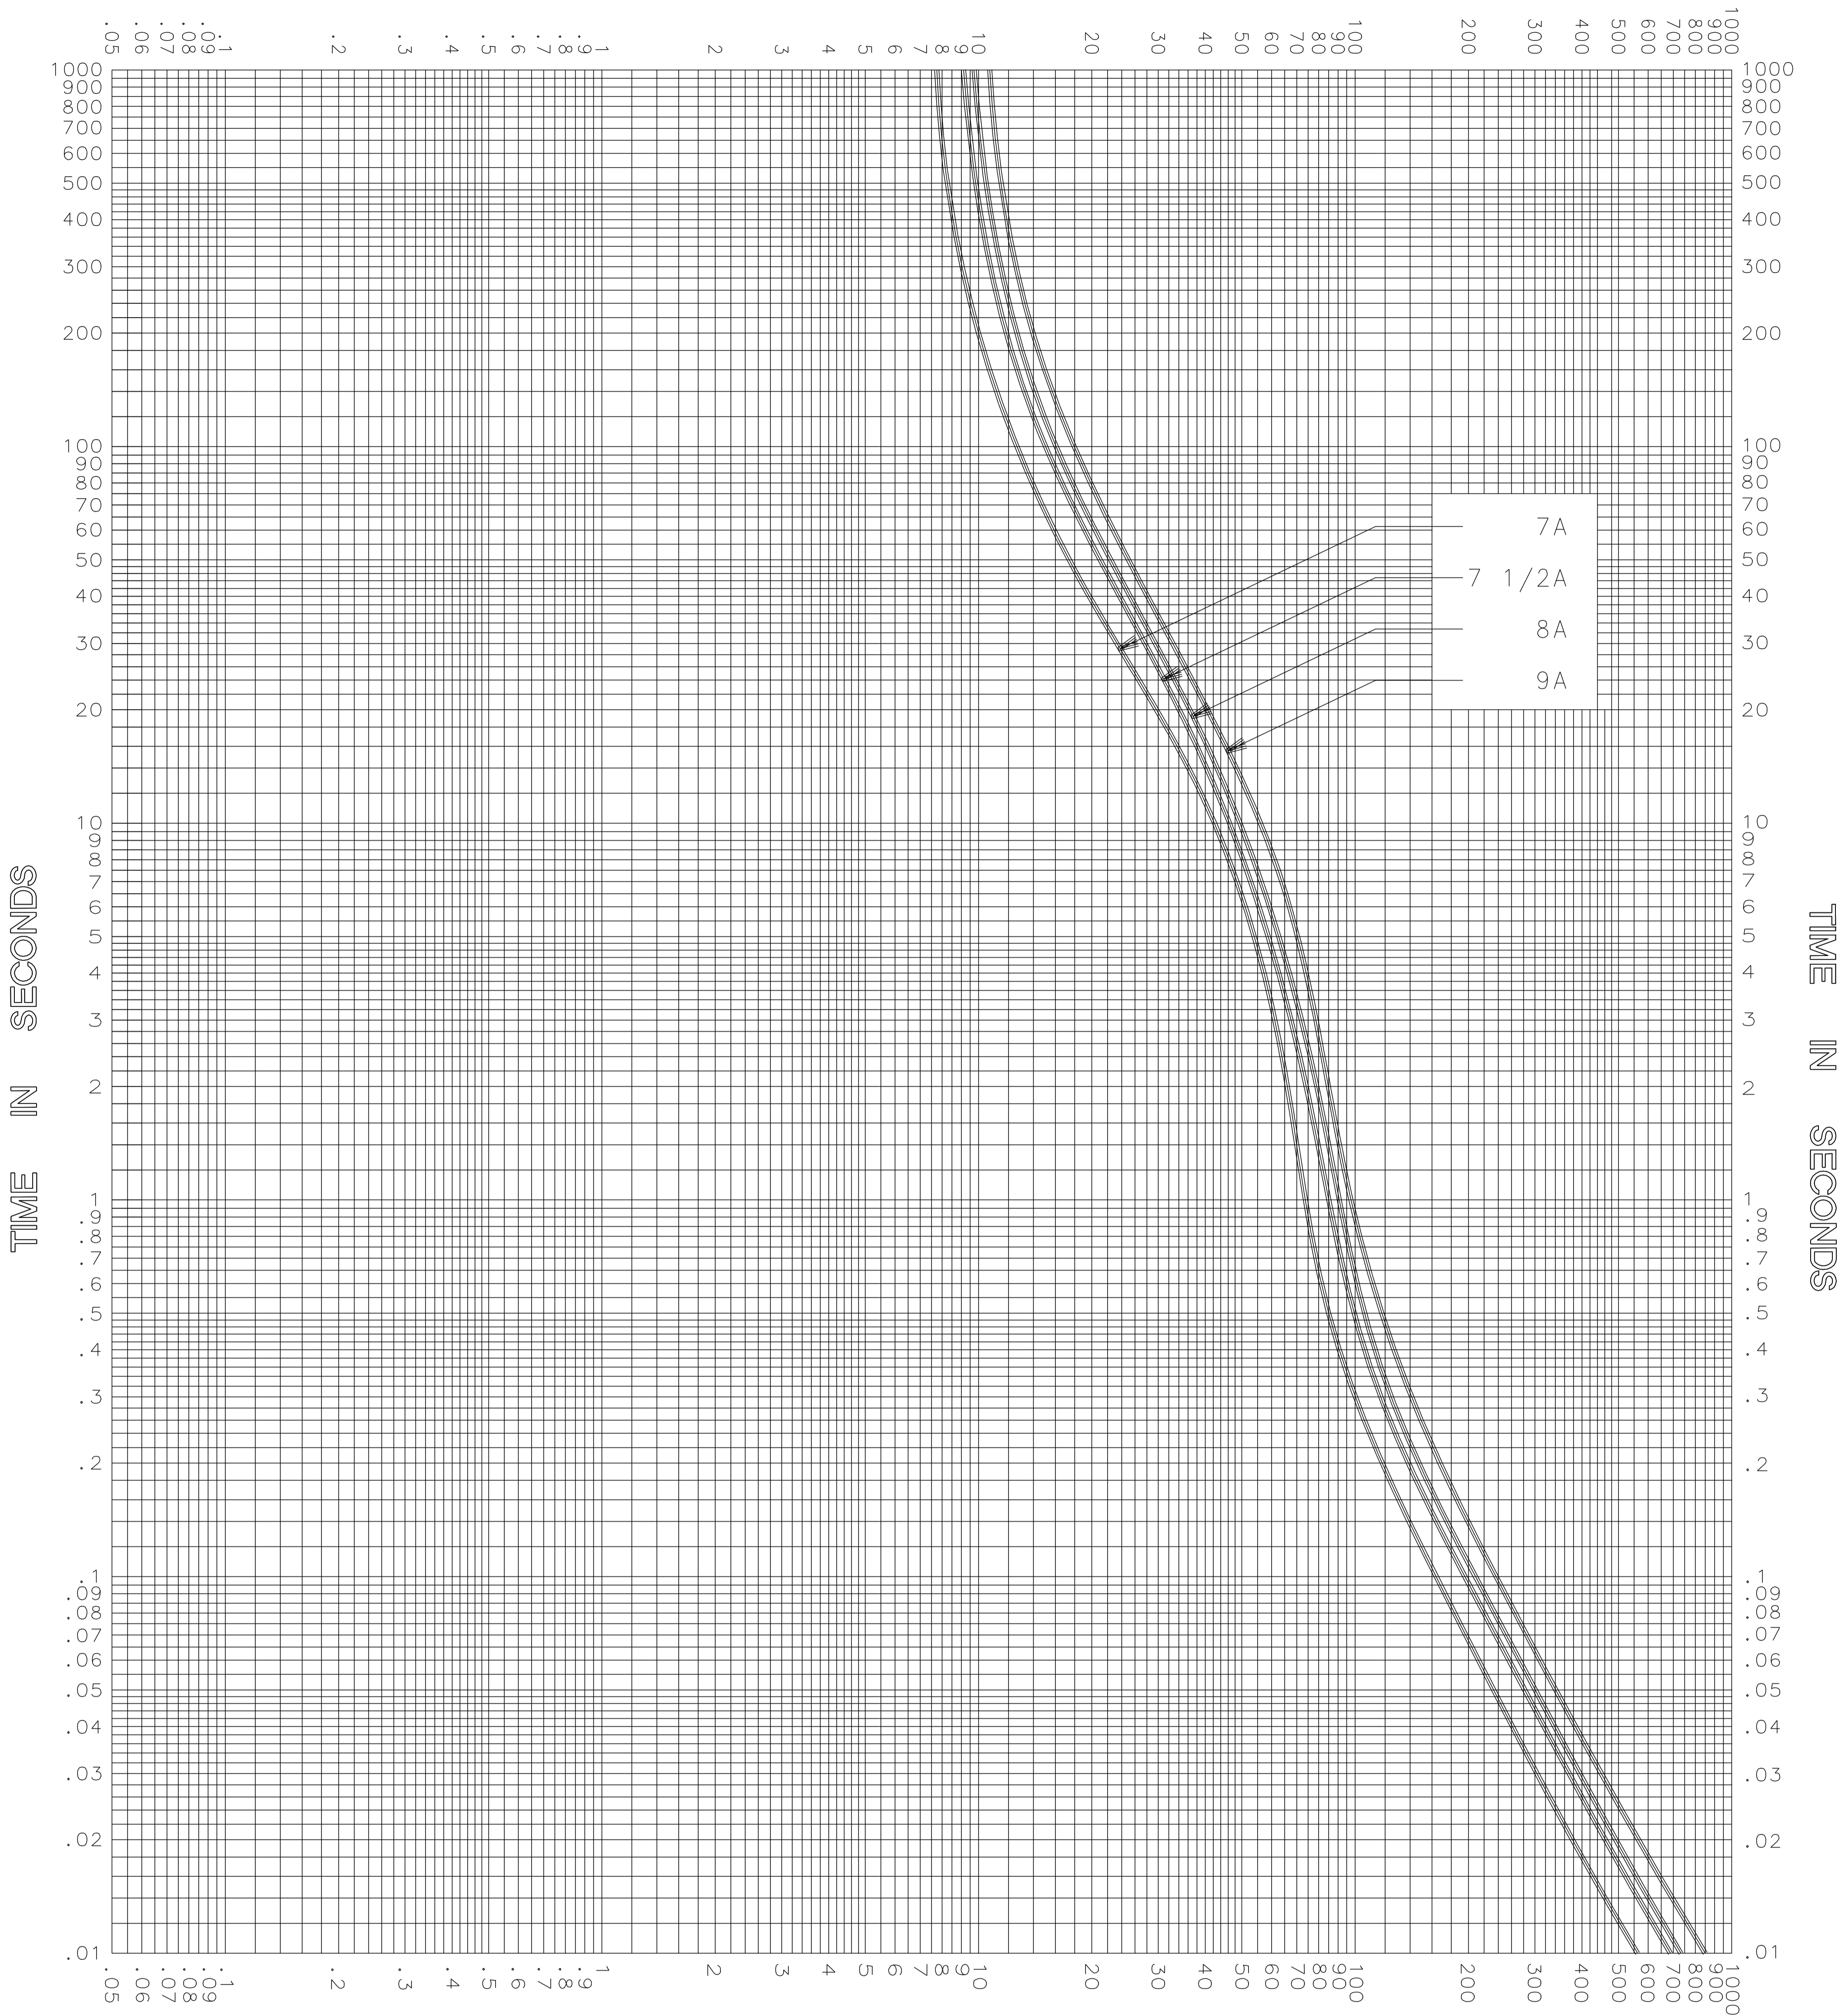

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (7A - 9A)
BASIS FOR DATA _____		


 <p>LITTELFUSE, INC. DES PLAINES, ILL. USA</p>	DRAWN BY MRD DATE 02/03/04 CHECKED BY MP
	DRAWING NO. B-FCC01-VR-006

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

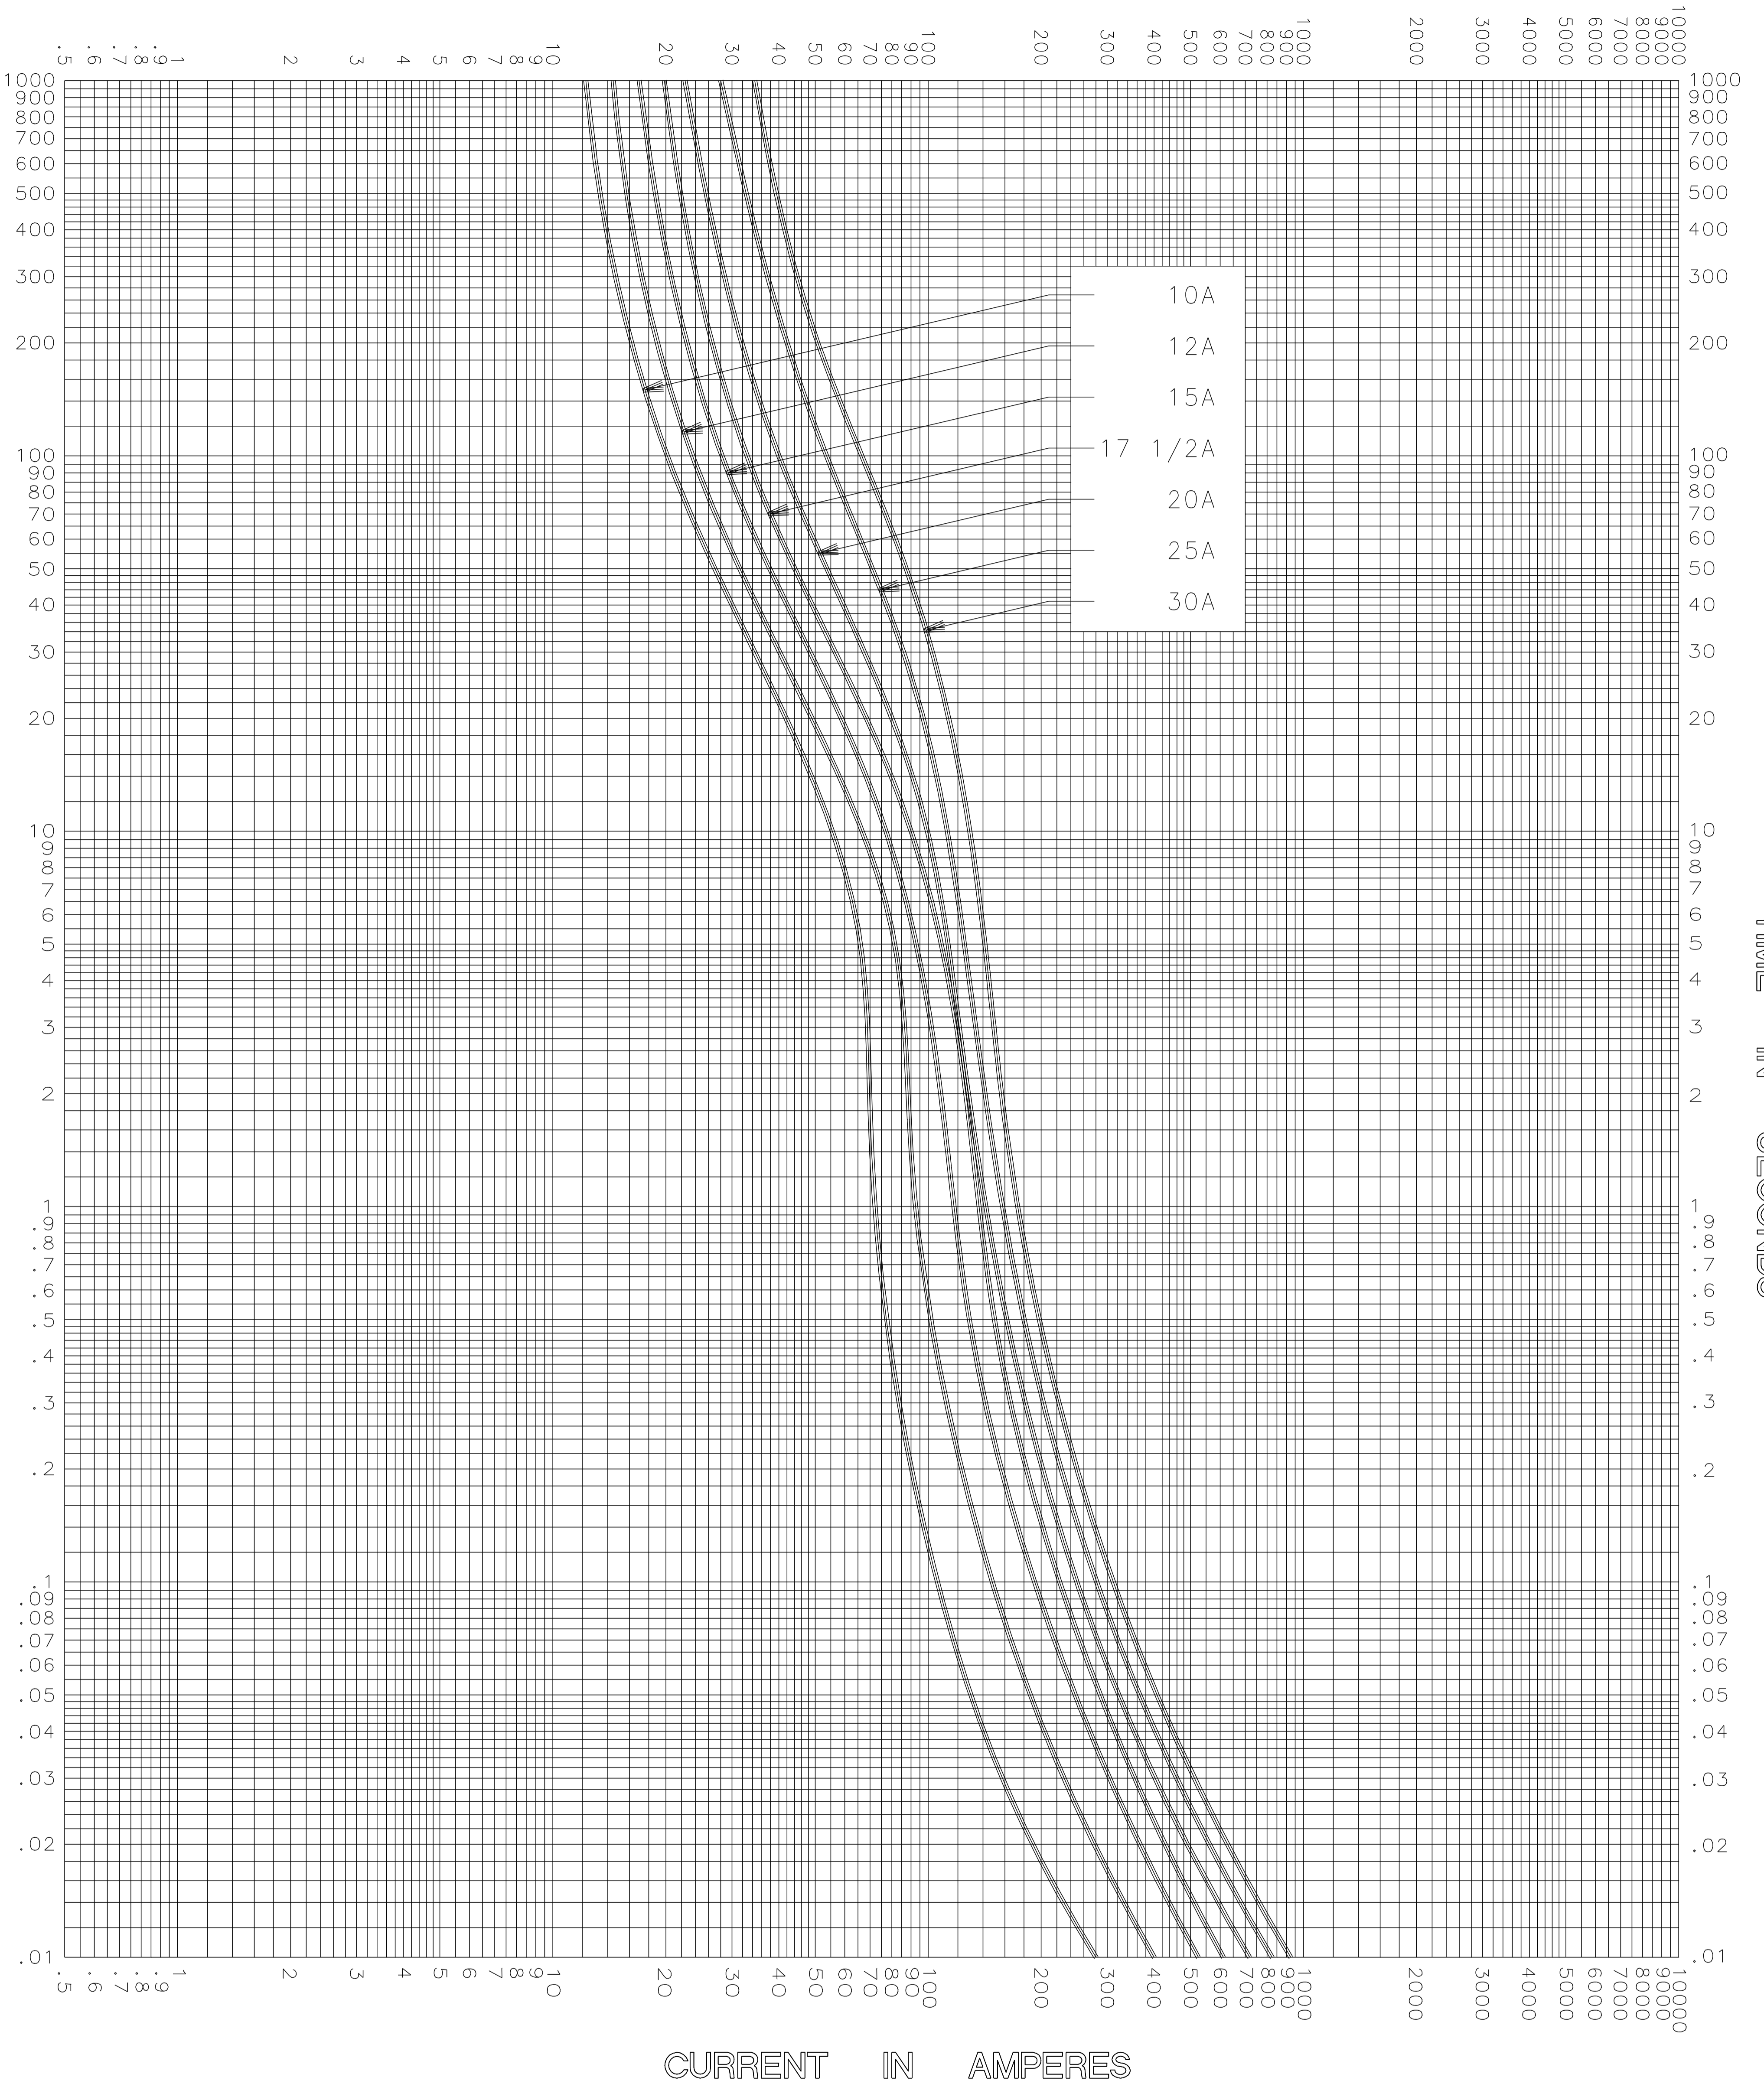

CURRENT IN AMPERES


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER FLNR (10A - 30A)
---	---

<b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY MRD DATE 02/03/04 CHECKED BY MP
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. B-FCC01 (REV 007)

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

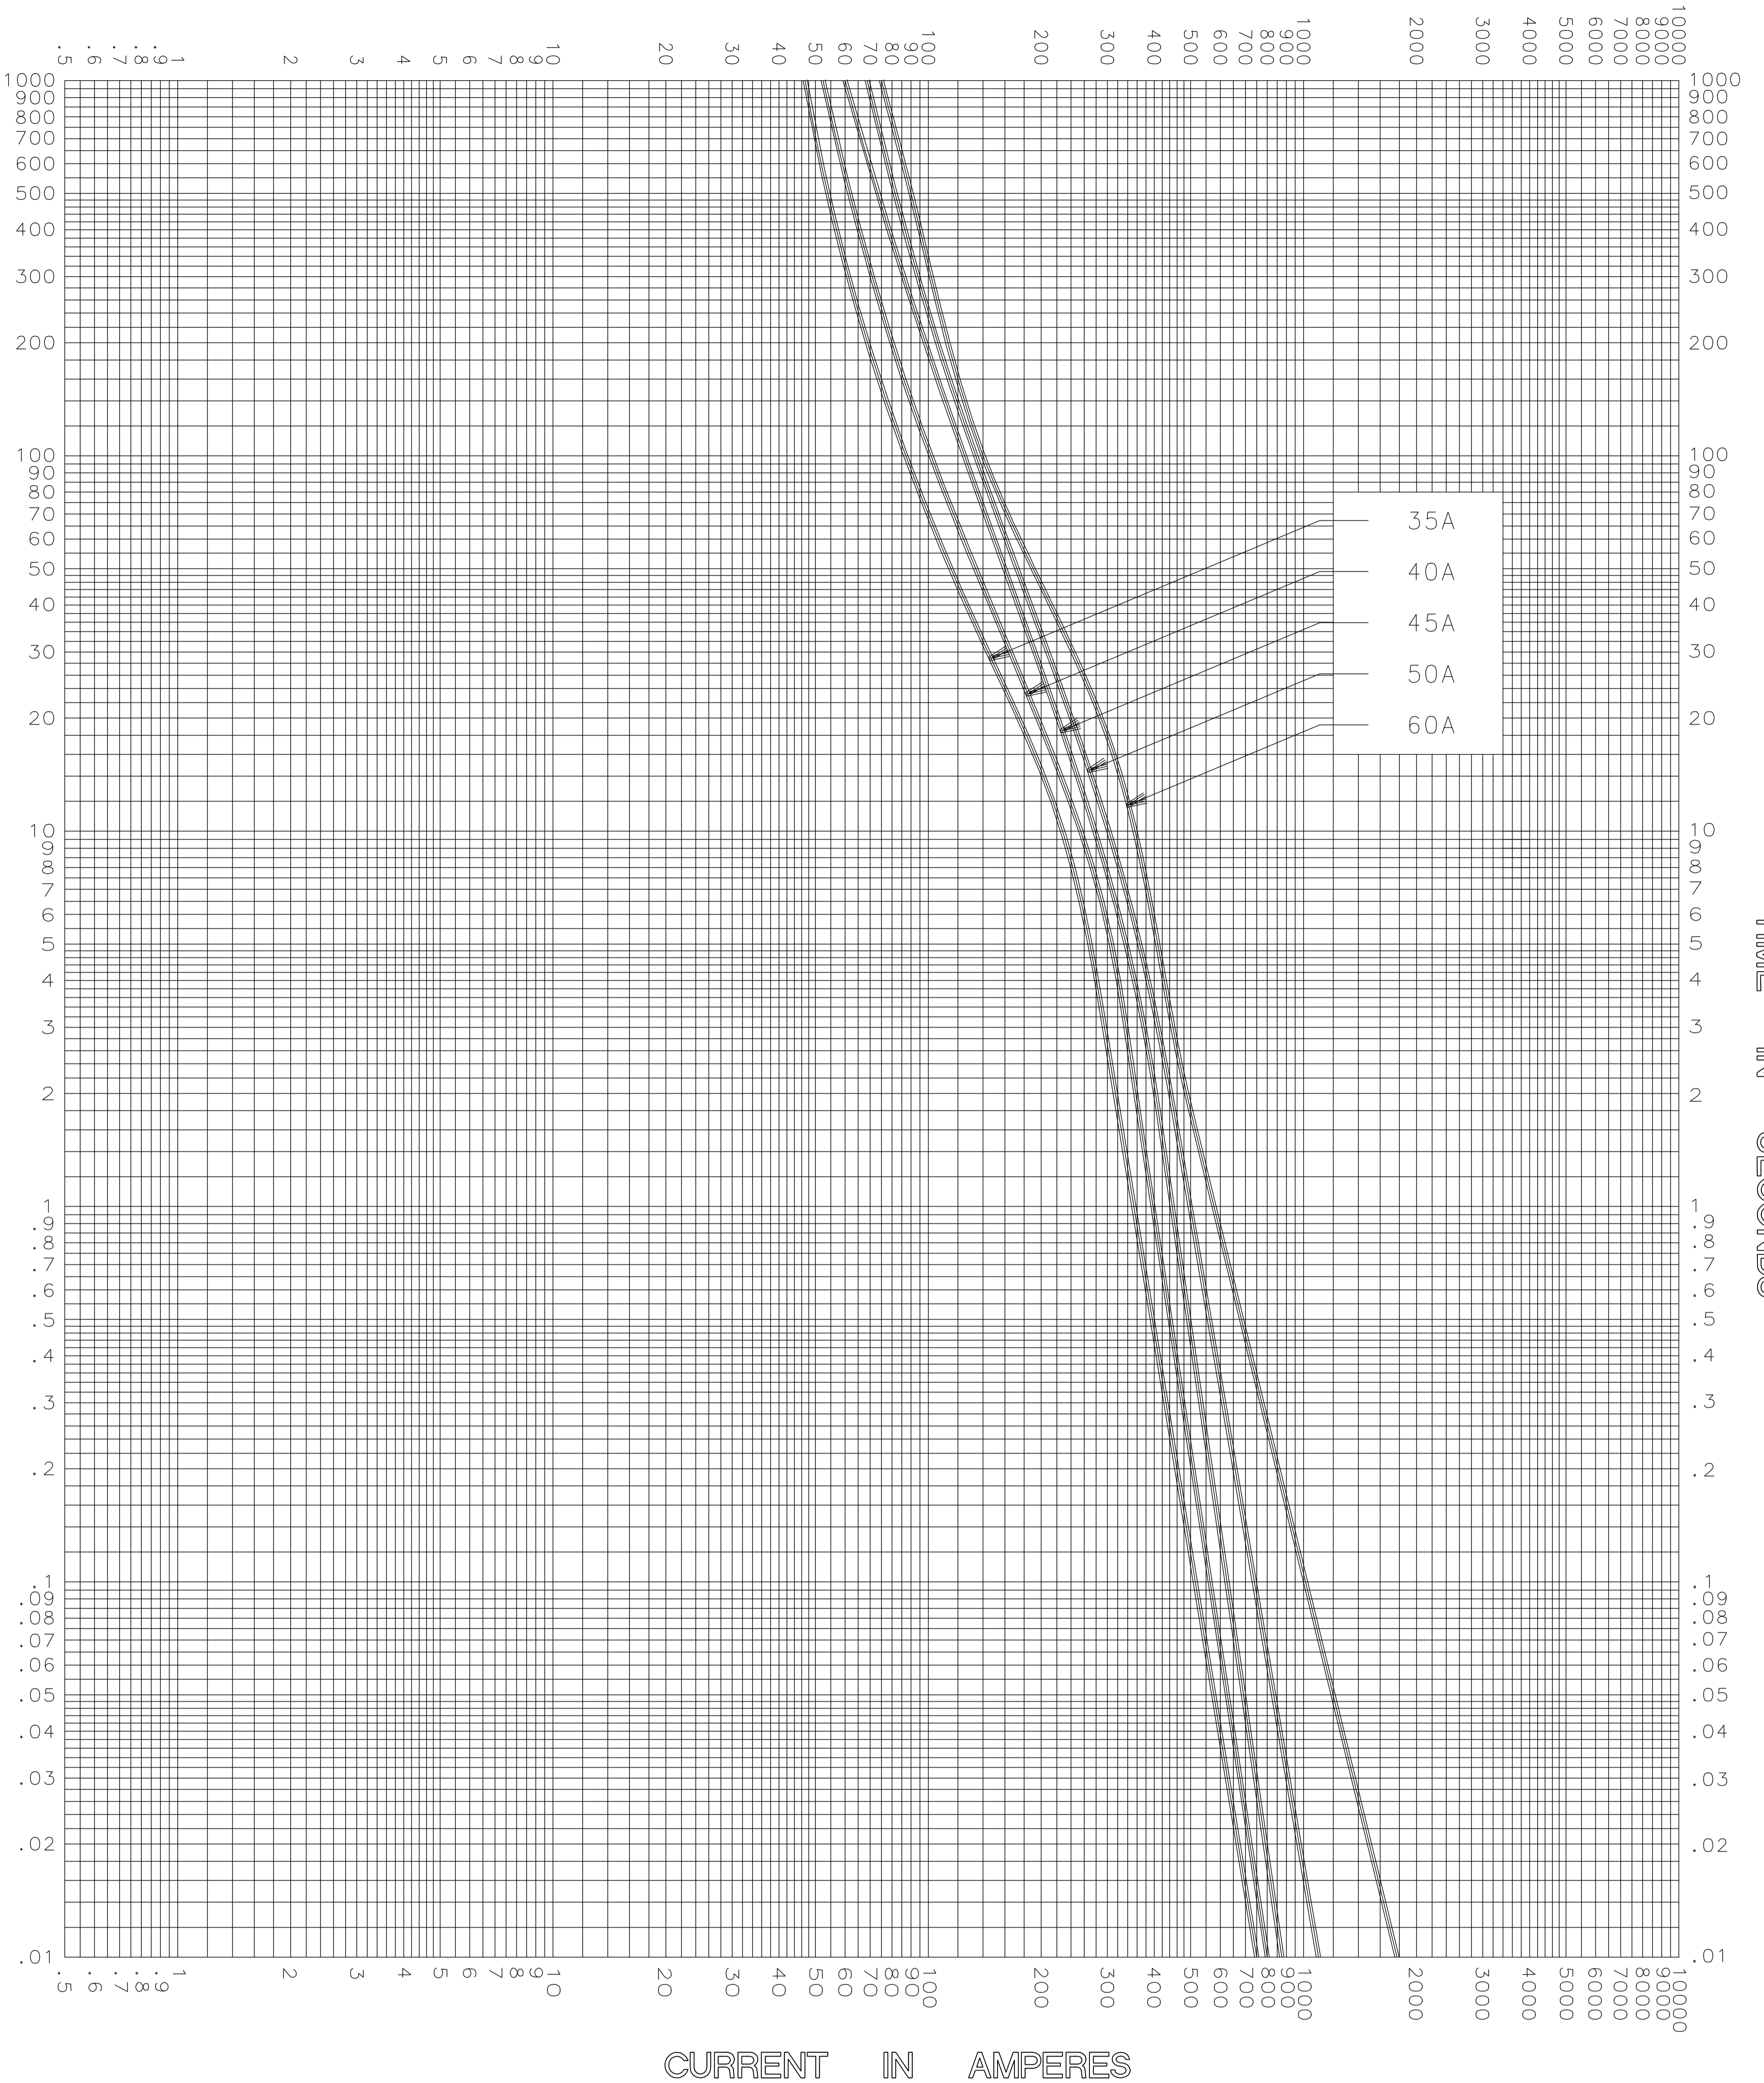

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (35A - 60A)
BASIS FOR DATA _____		



LITTELFUSE, INC.  
DES PLAINES, ILL. USA

DRAWN BY	LLL
DATE	05/02/05
CHECKED BY	MP
DRAWING NO.	A-FCC01 FLNR 008


TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT




CURRENT IN AMPERES

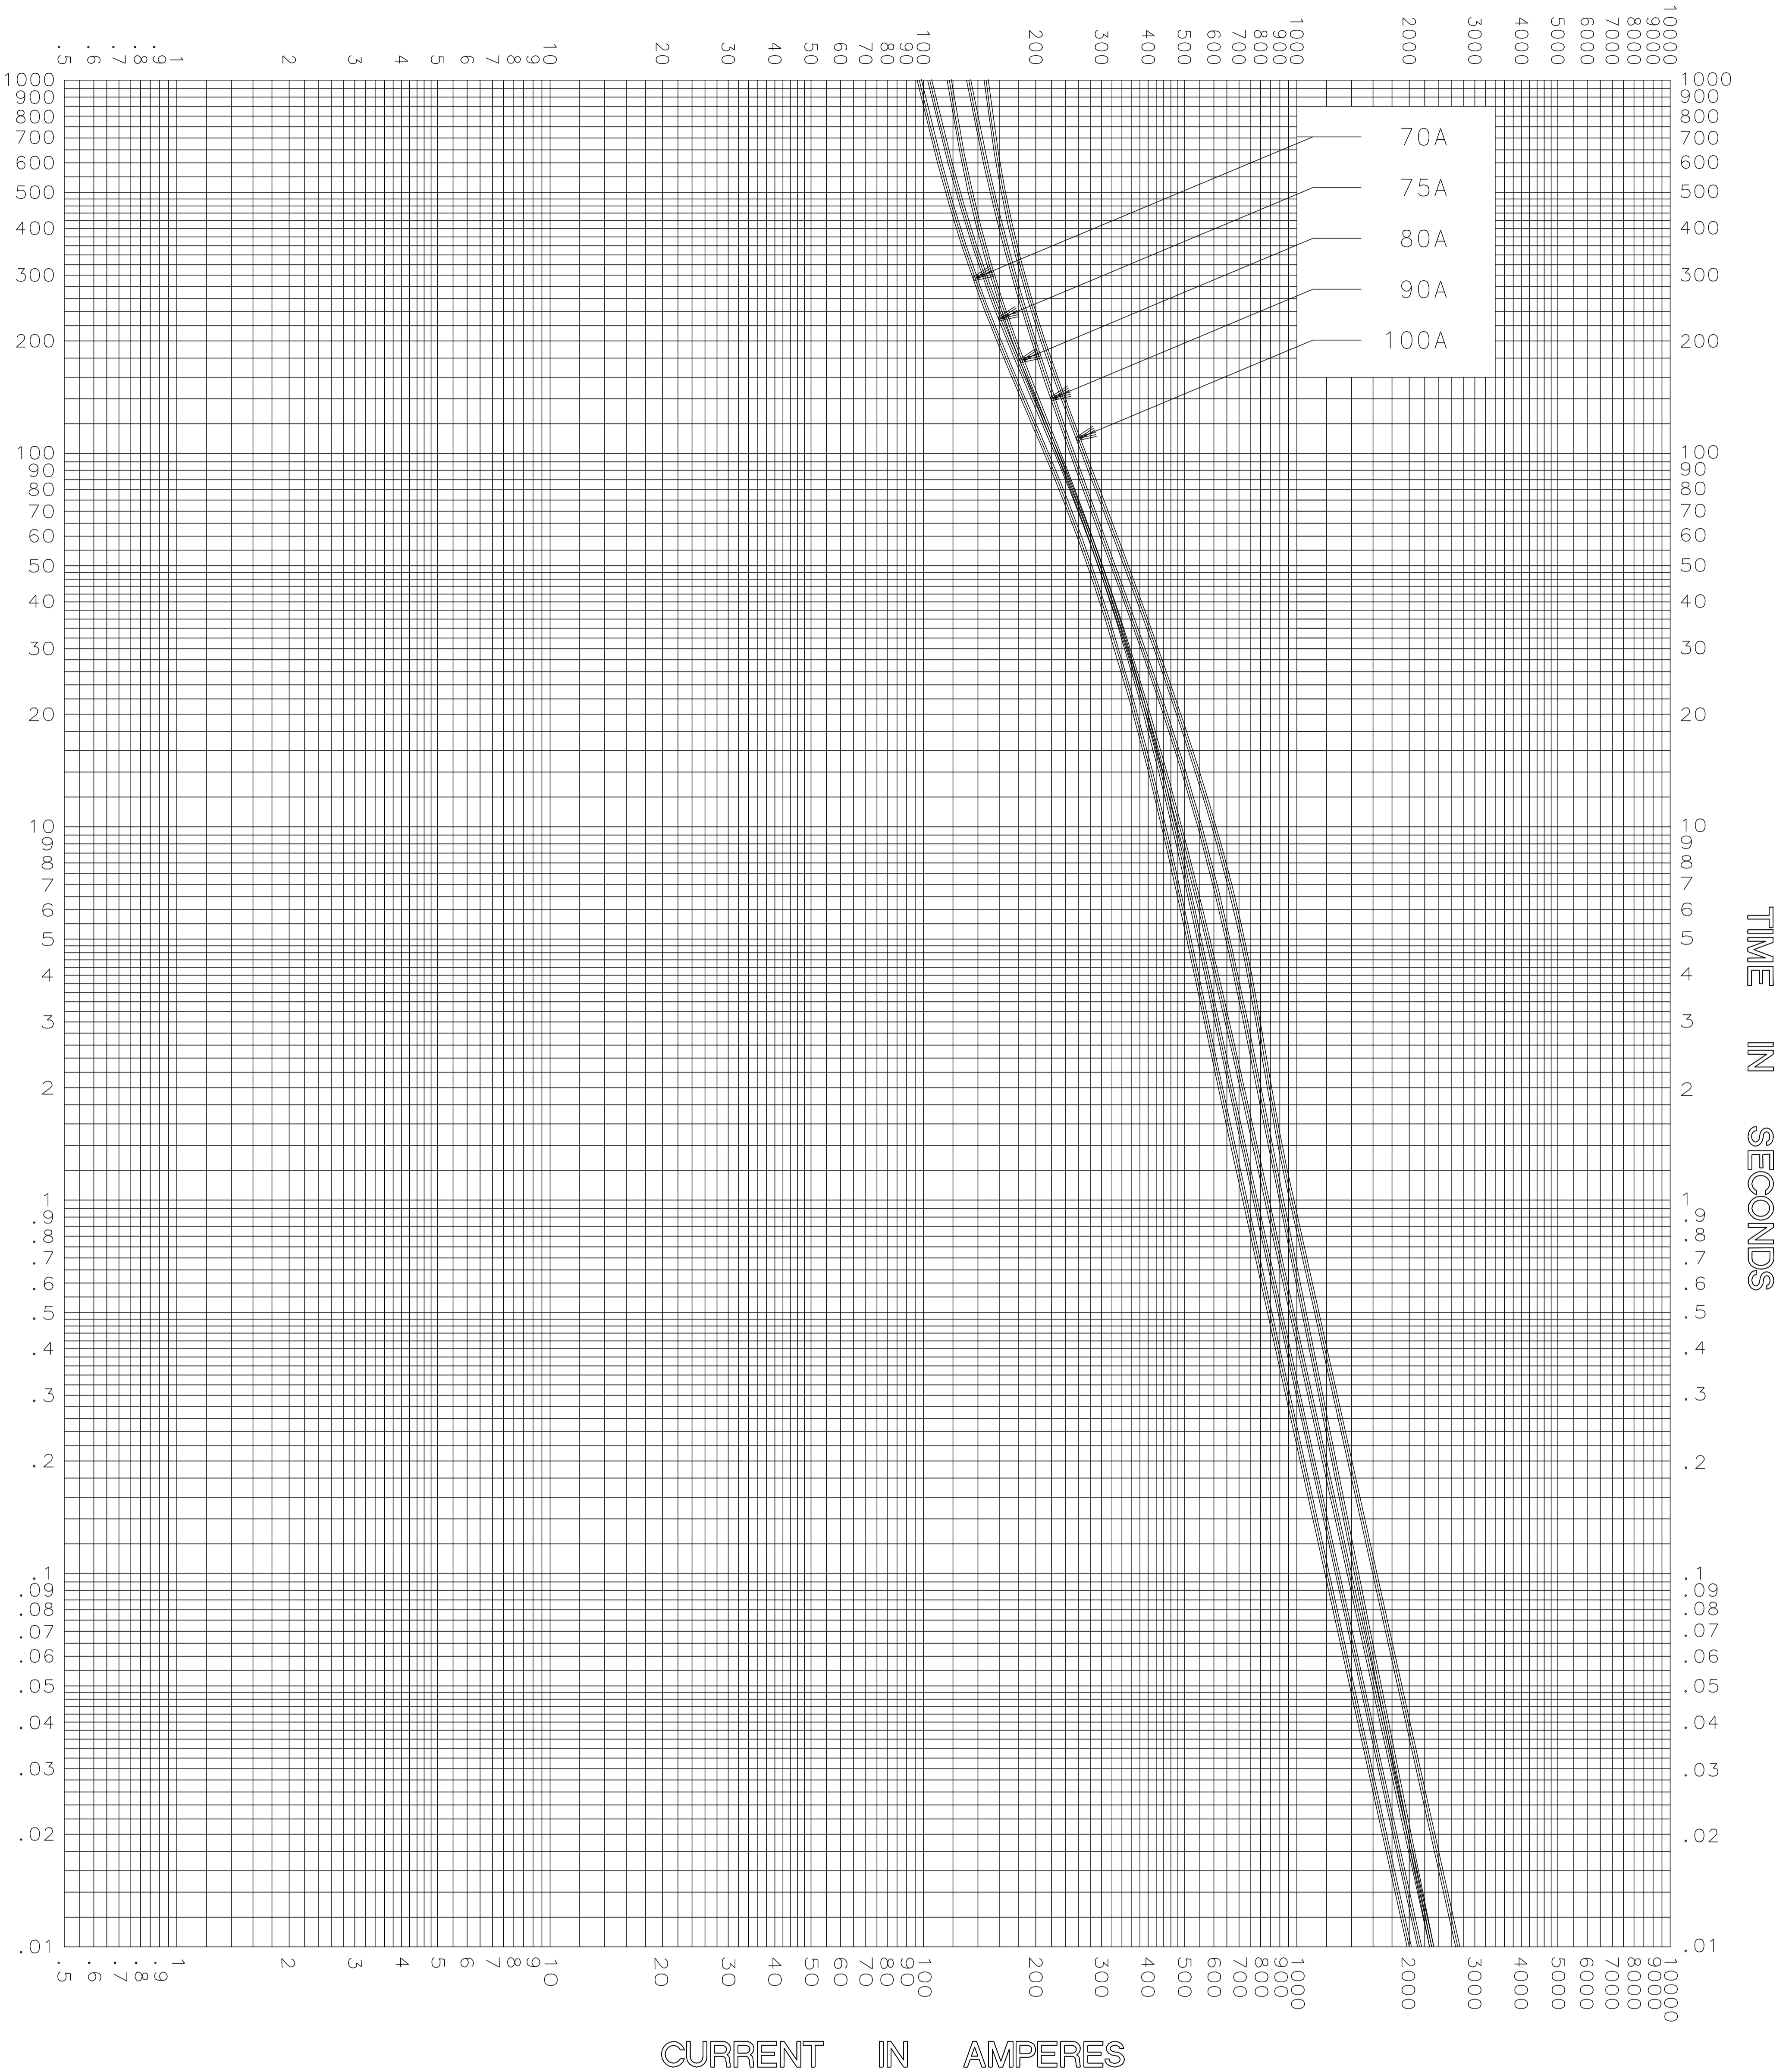

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (70A - 100A)
BASIS FOR DATA _____	


 <p>LITTELFUSE, INC. DES PLAINES, ILL. USA</p>	DRAWN BY <u>LLL</u> DATE <u>05/02/05</u> CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC01 FLNR 1009</u>

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

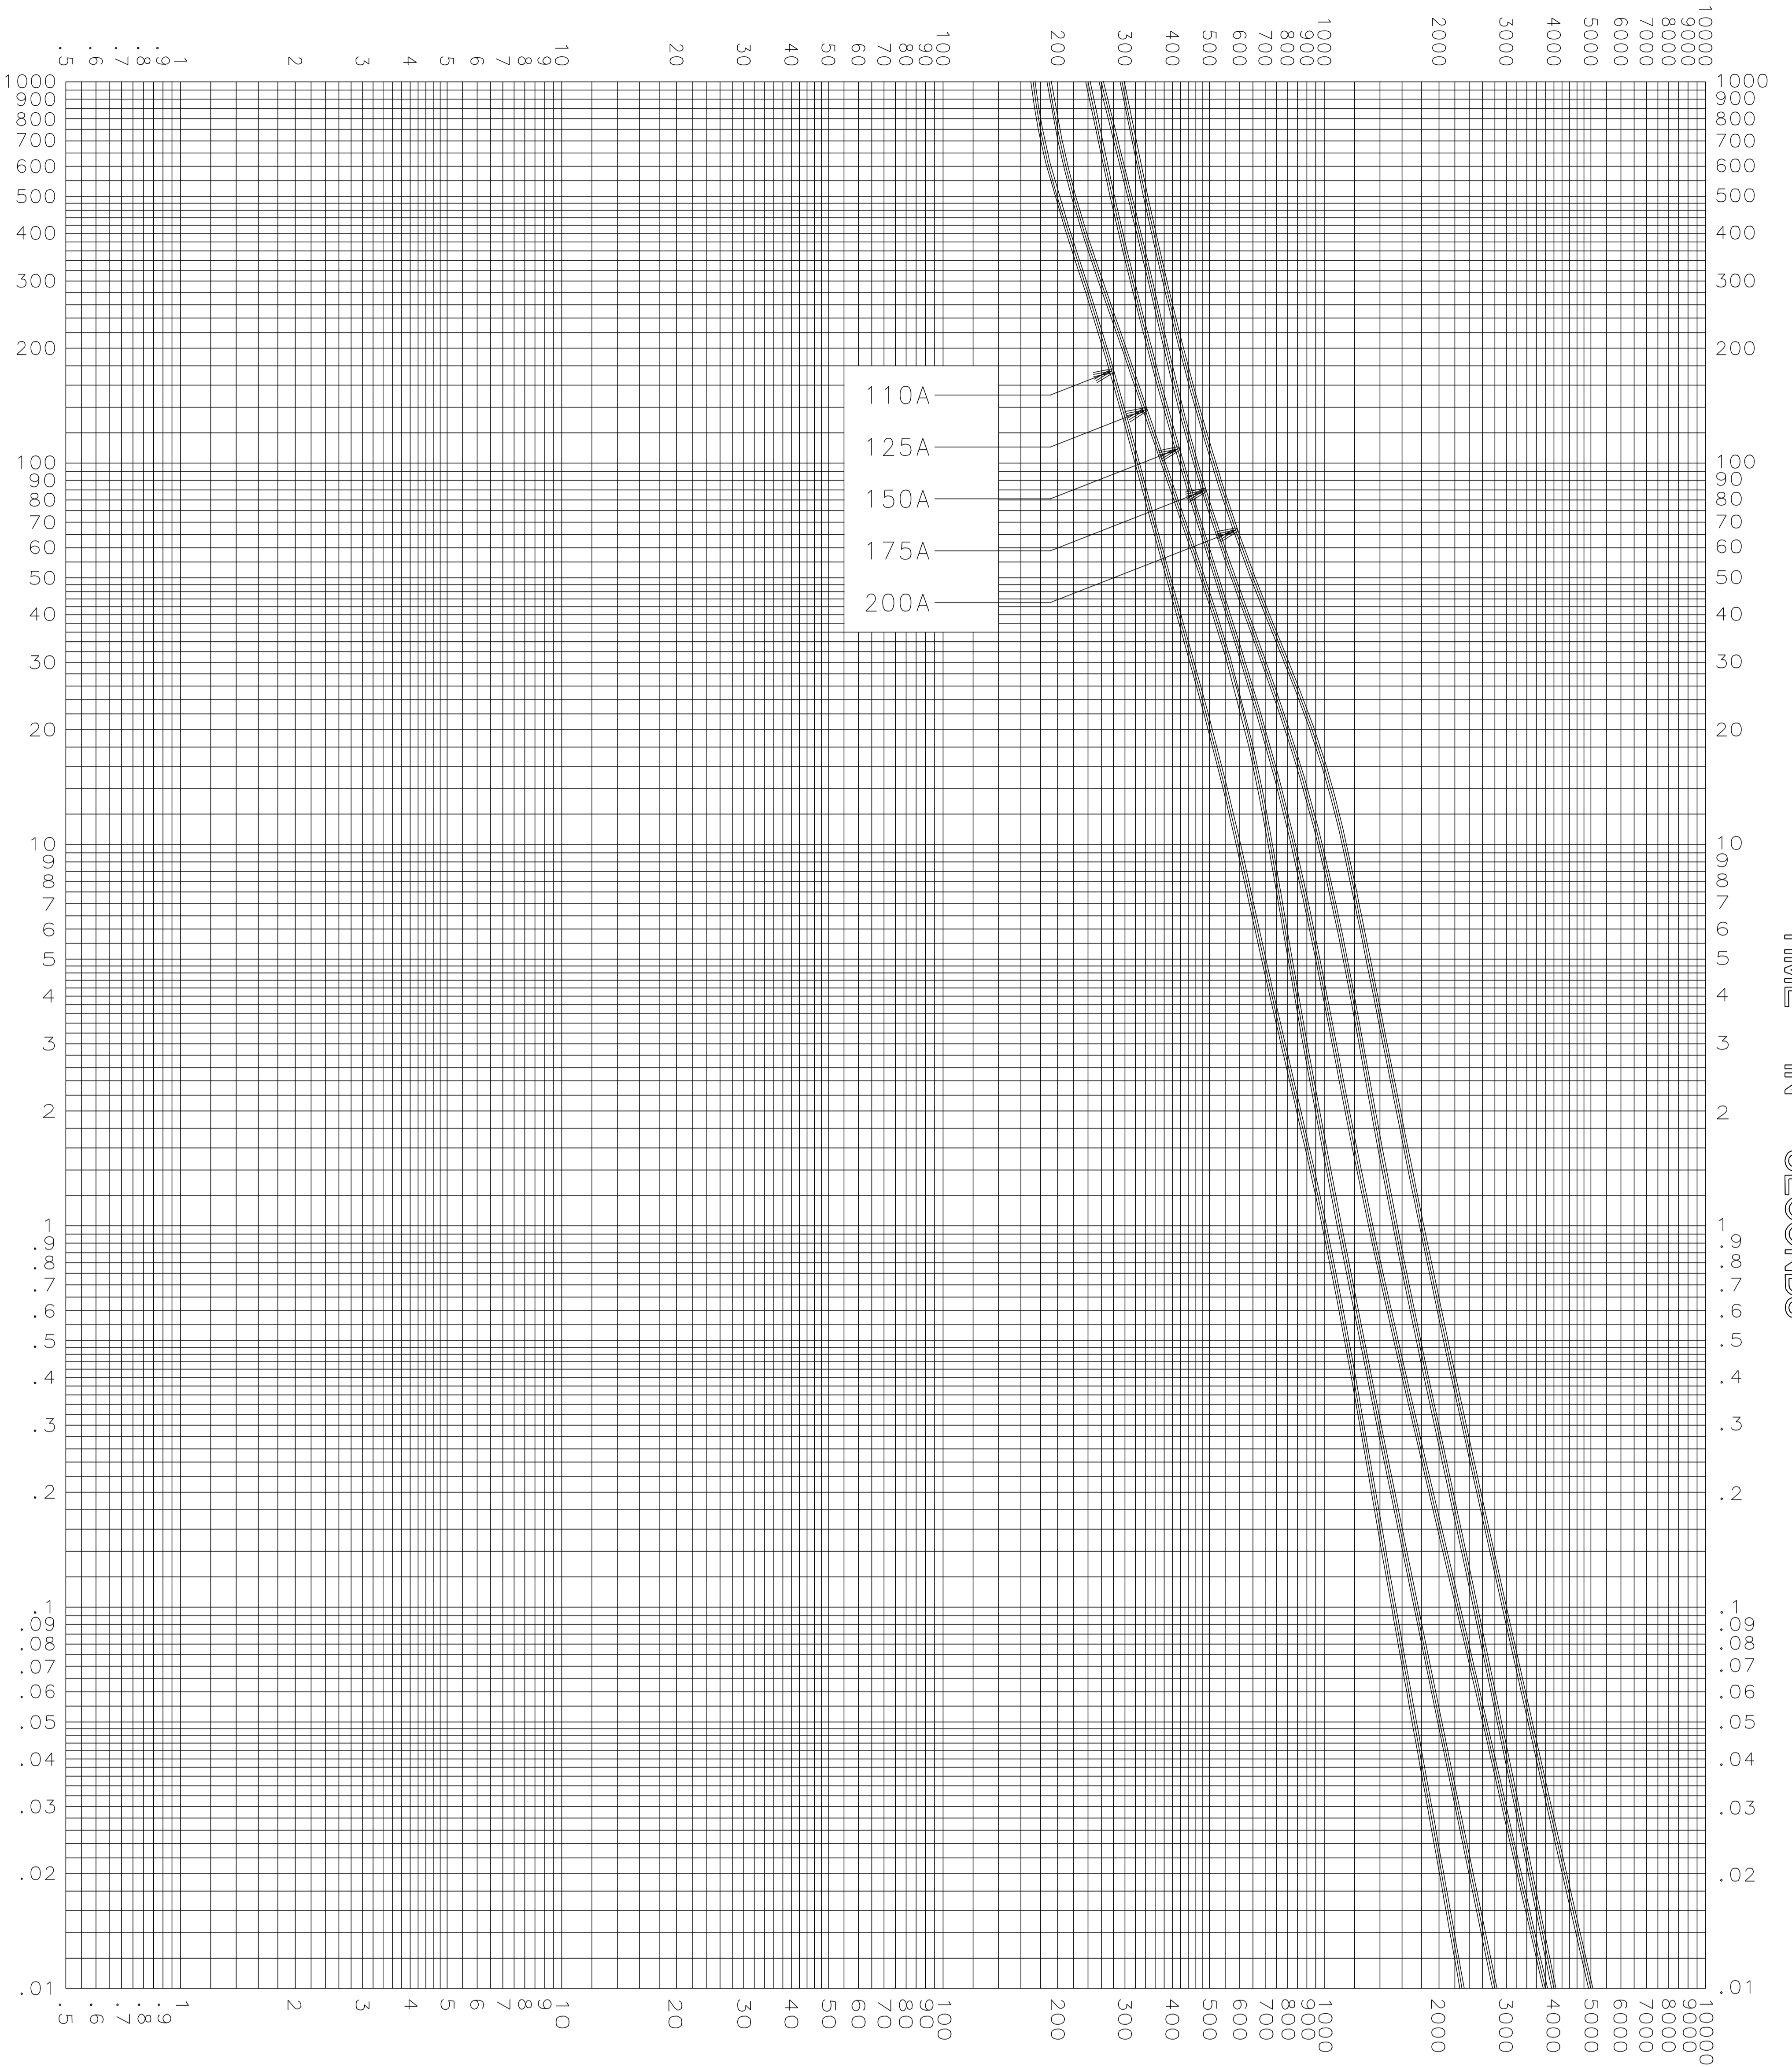

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (110A - 200A)
BASIS FOR DATA _____	


 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>05/02/05</u> CHECKED BY <u>MP</u>
	DRAWING NO. A-FCC01-11NR010

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

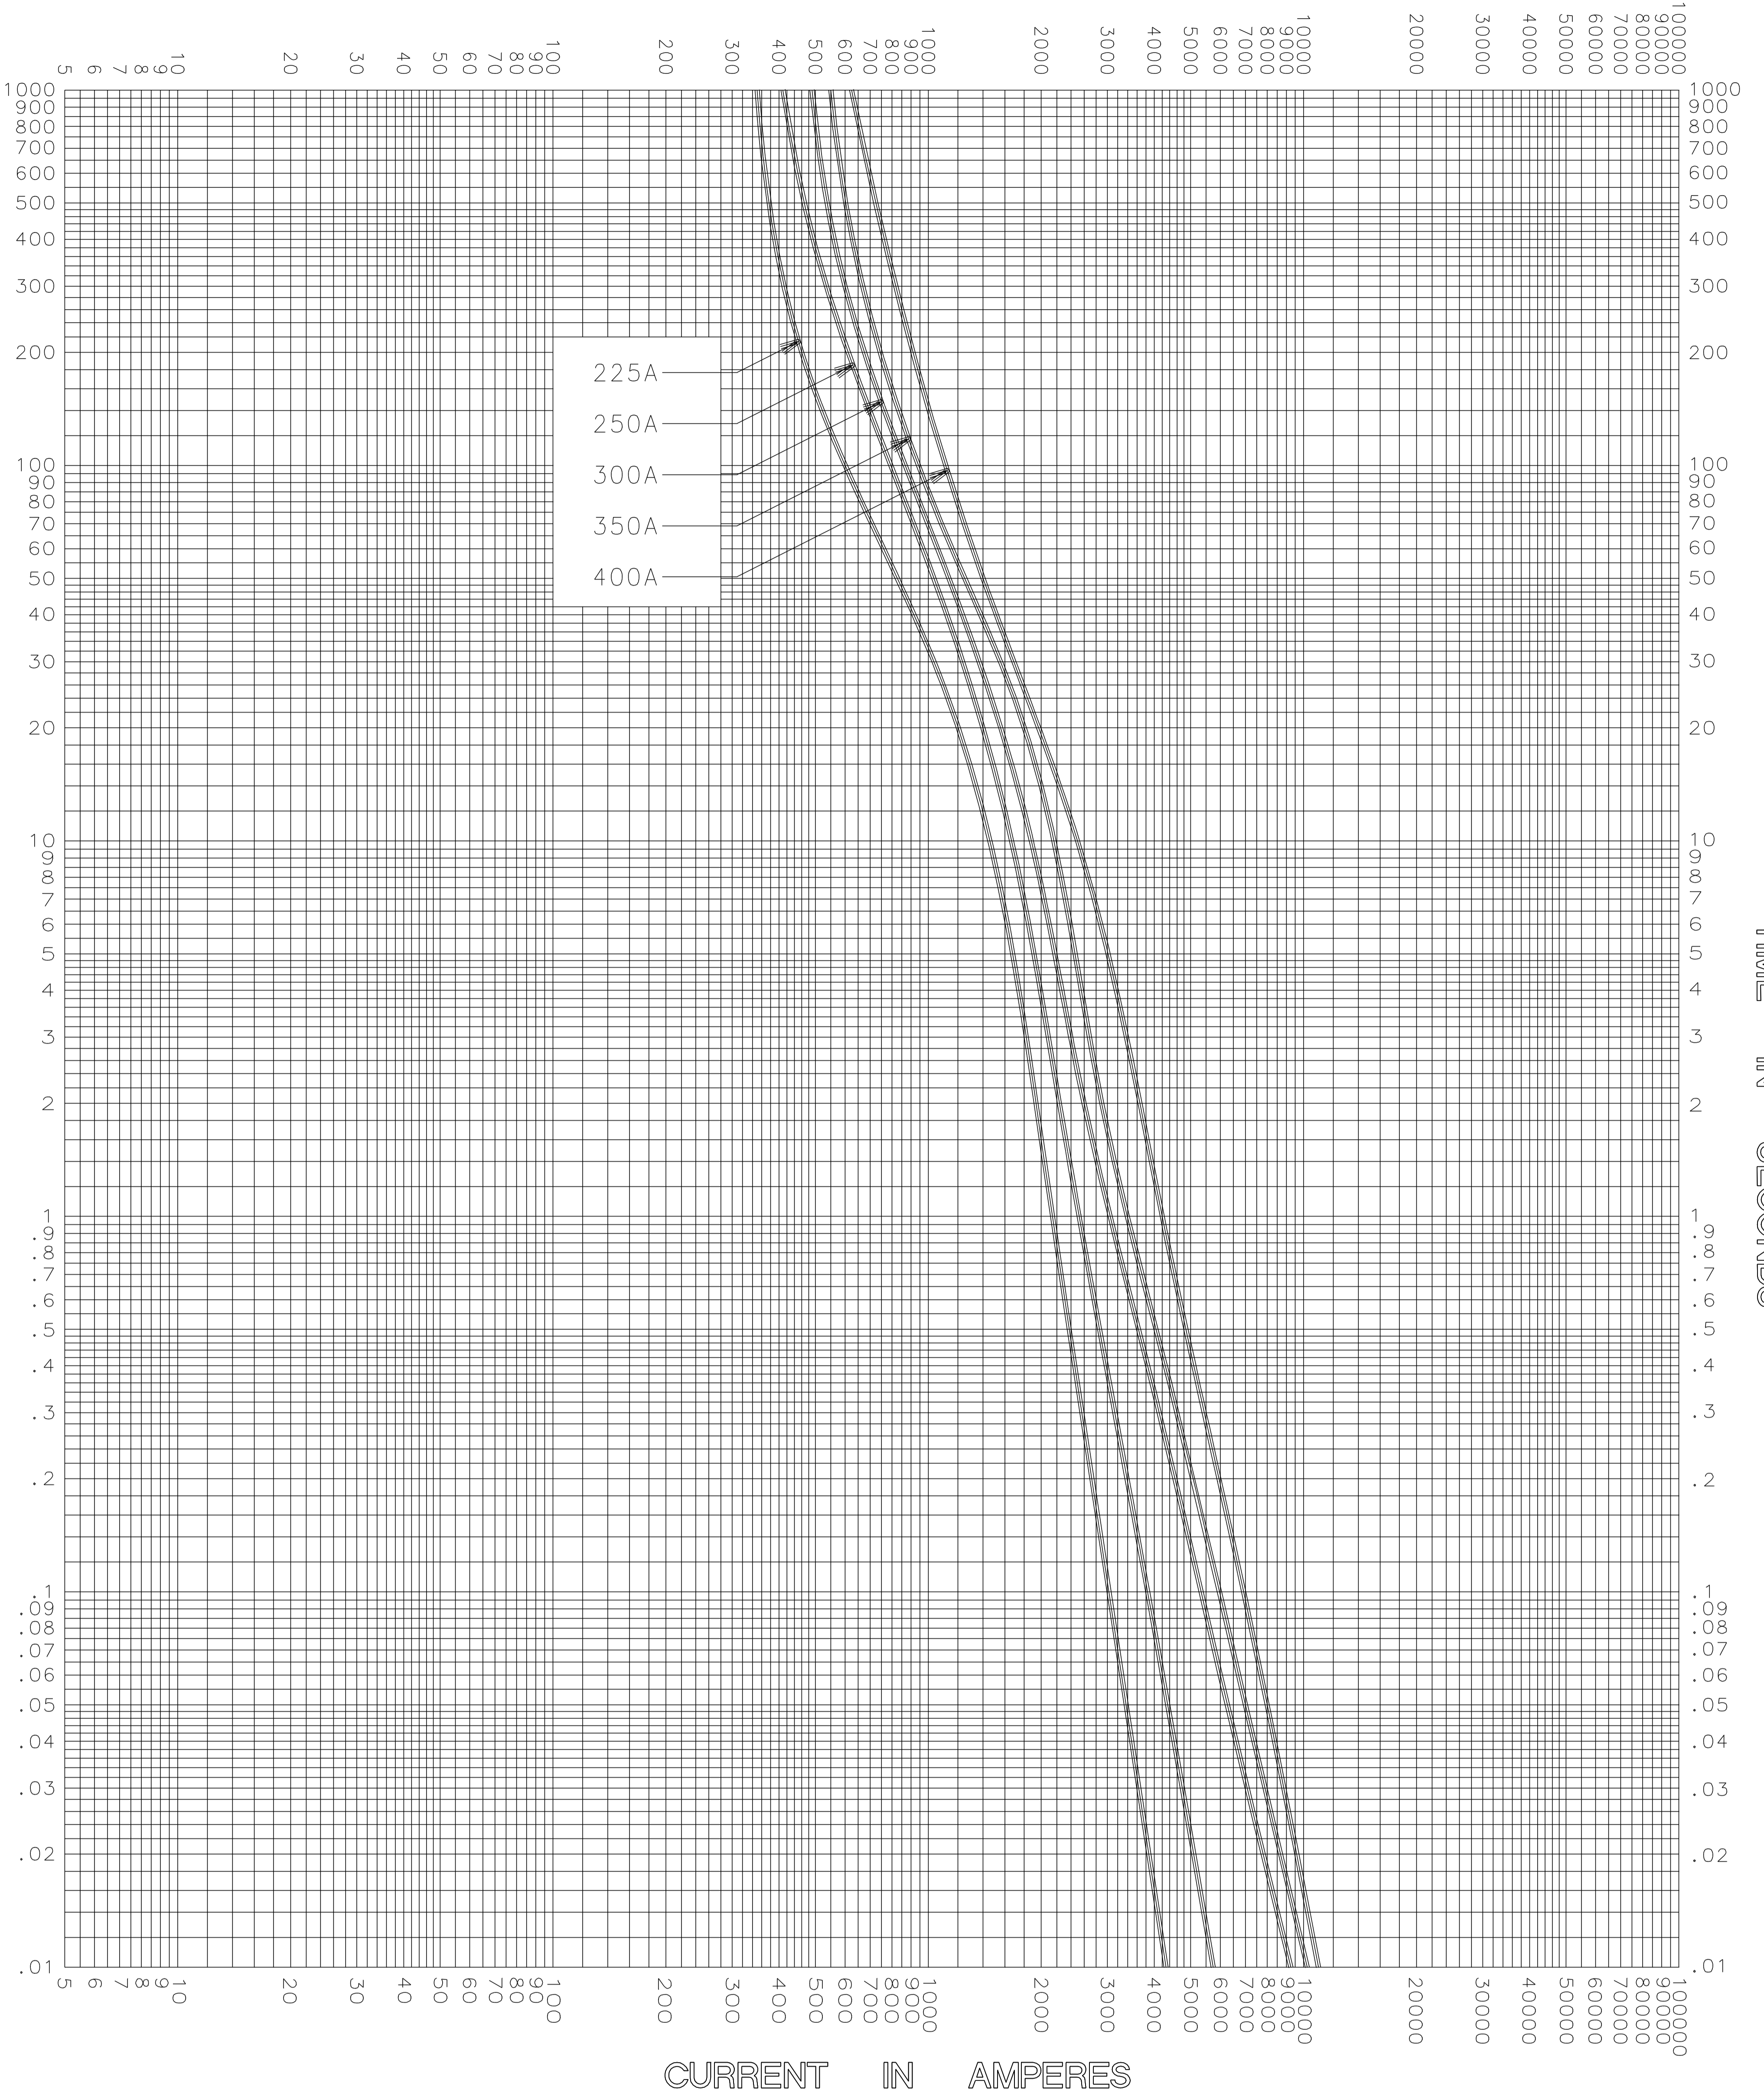

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (225A - 400A)
BASIS FOR DATA _____		



LITTELFUSE, INC.  
DES PLAINES, ILL. USA


DRAWN BY	LLL
DATE	05/02/05
CHECKED BY	MP

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01-FLNR-011
------------------------------------	---------------------------------

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

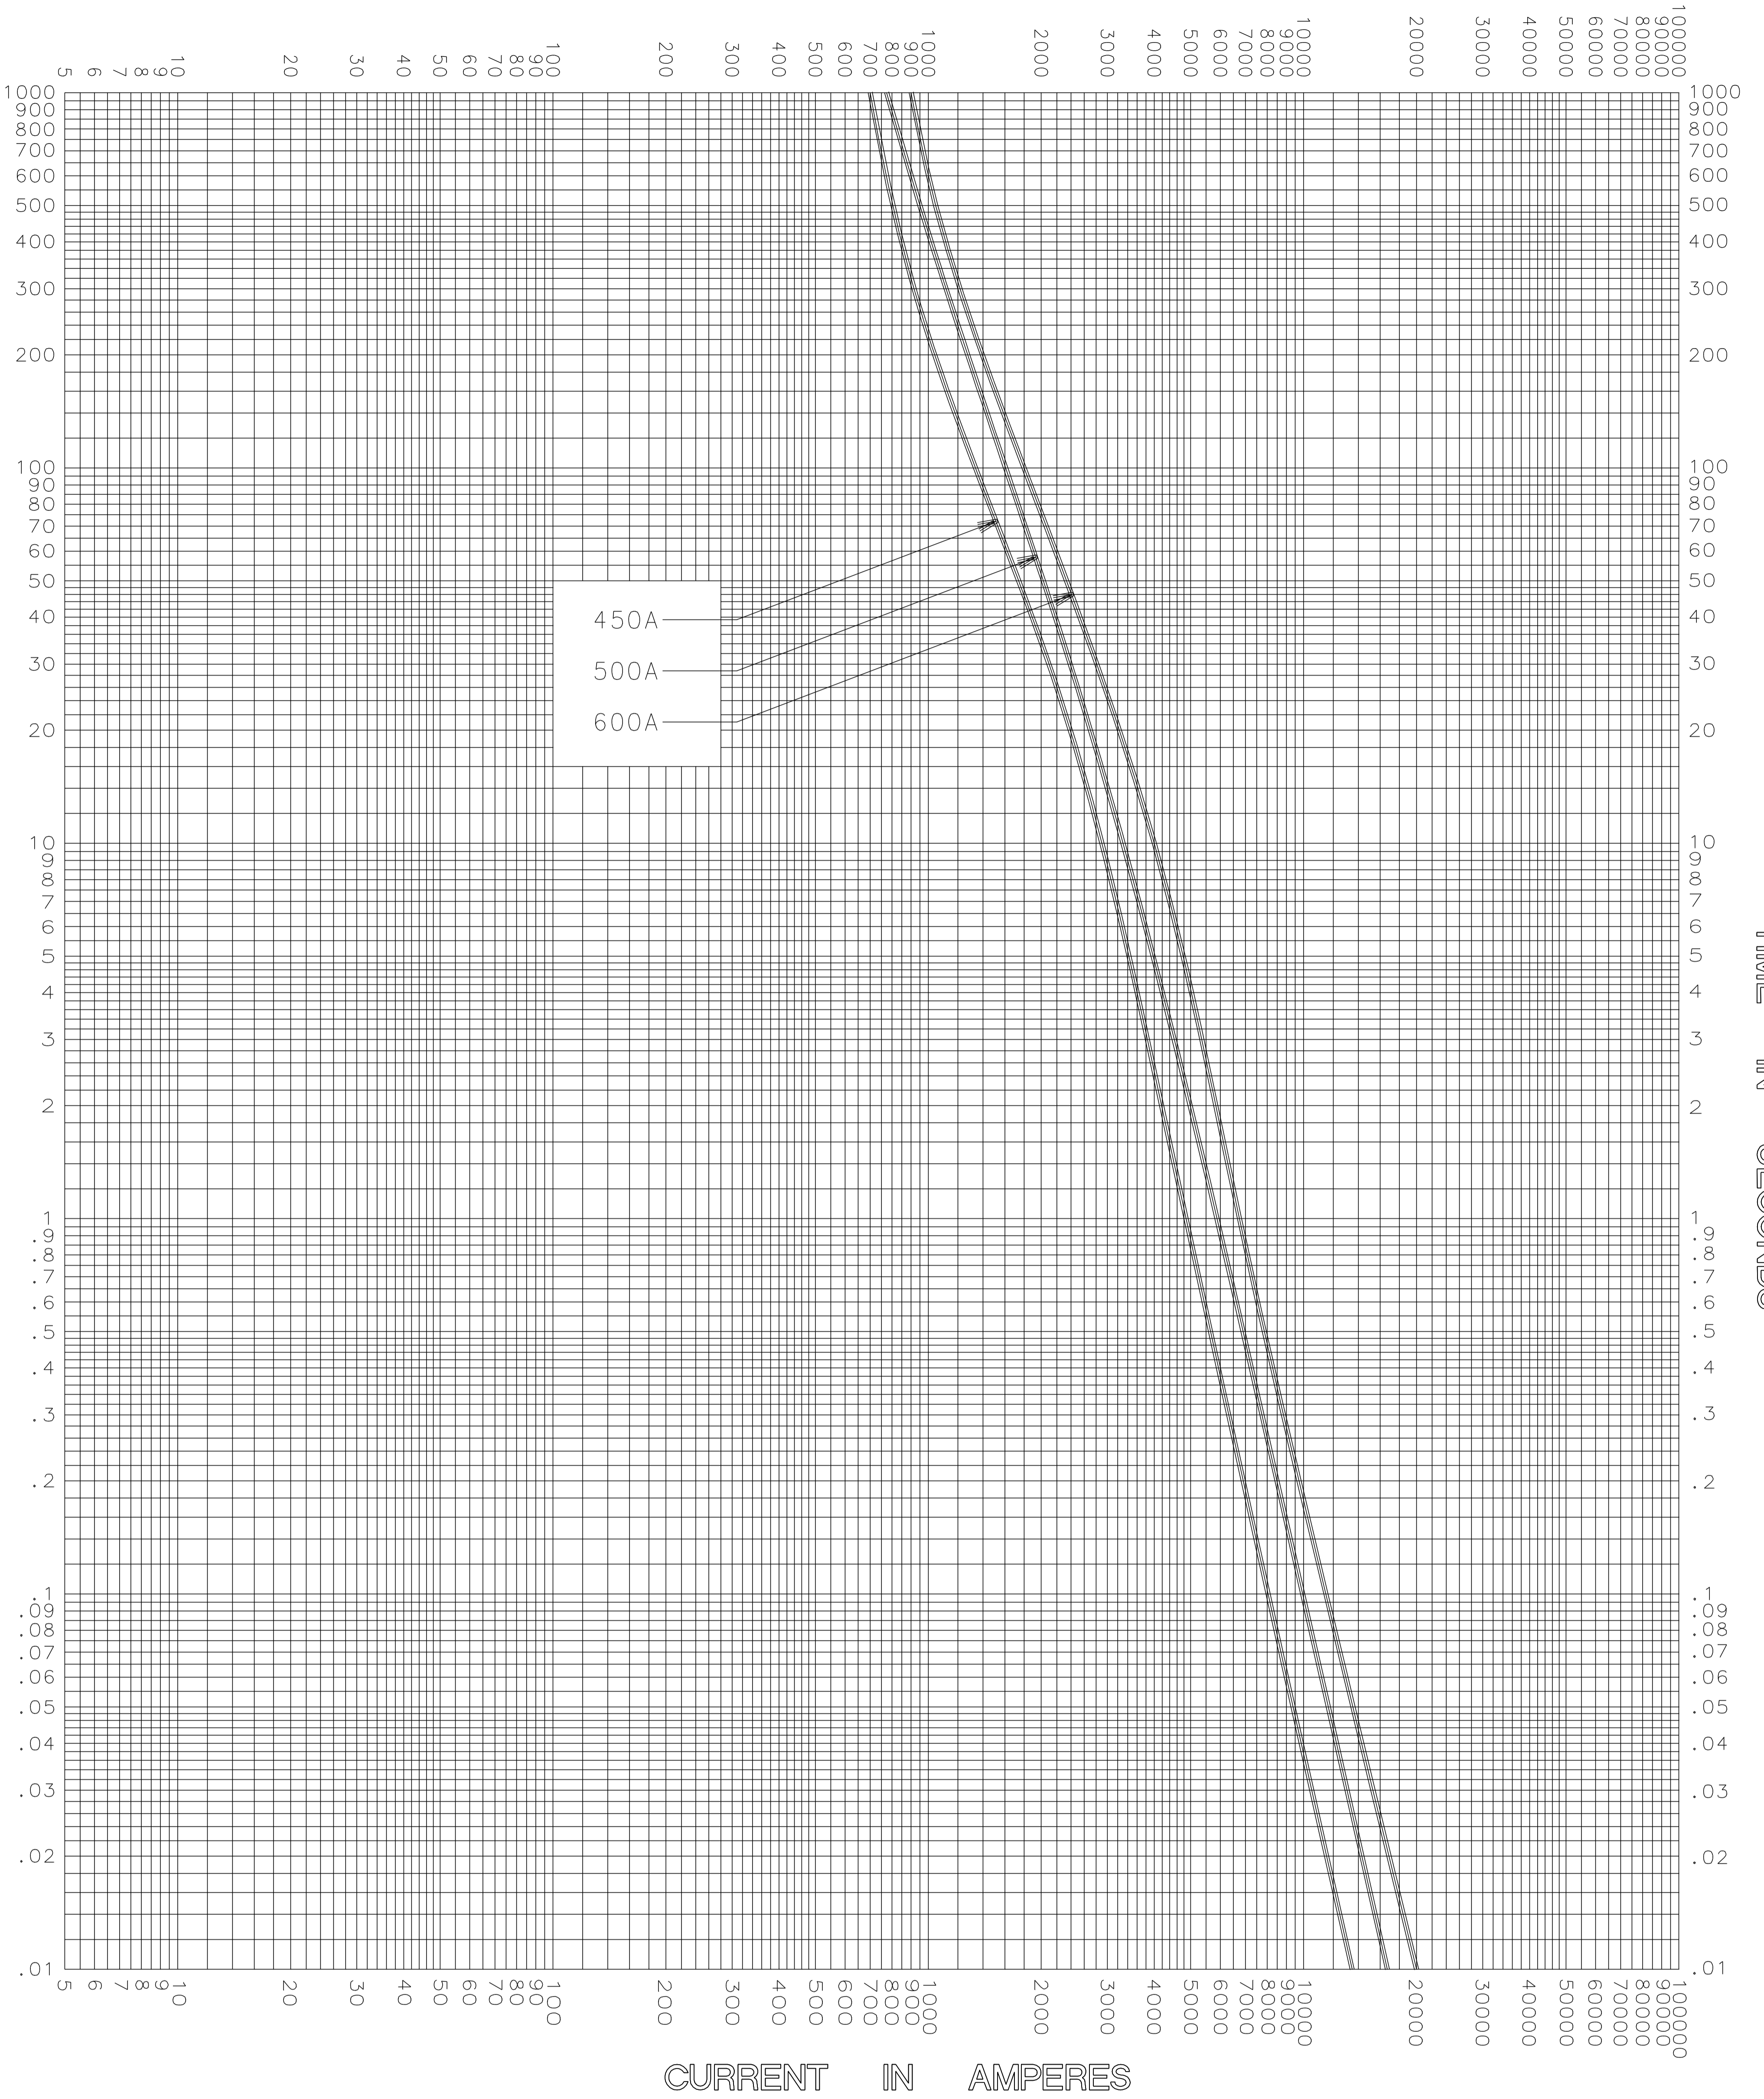

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (450A - 600A)
BASIS FOR DATA _____		



LITTELFUSE, INC.  
DES PLAINES, ILL. USA


DRAWN BY	LLL
DATE	05/02/05
CHECKED BY	MP

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01-FLNR-012
------------------------------------	---------------------------------

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

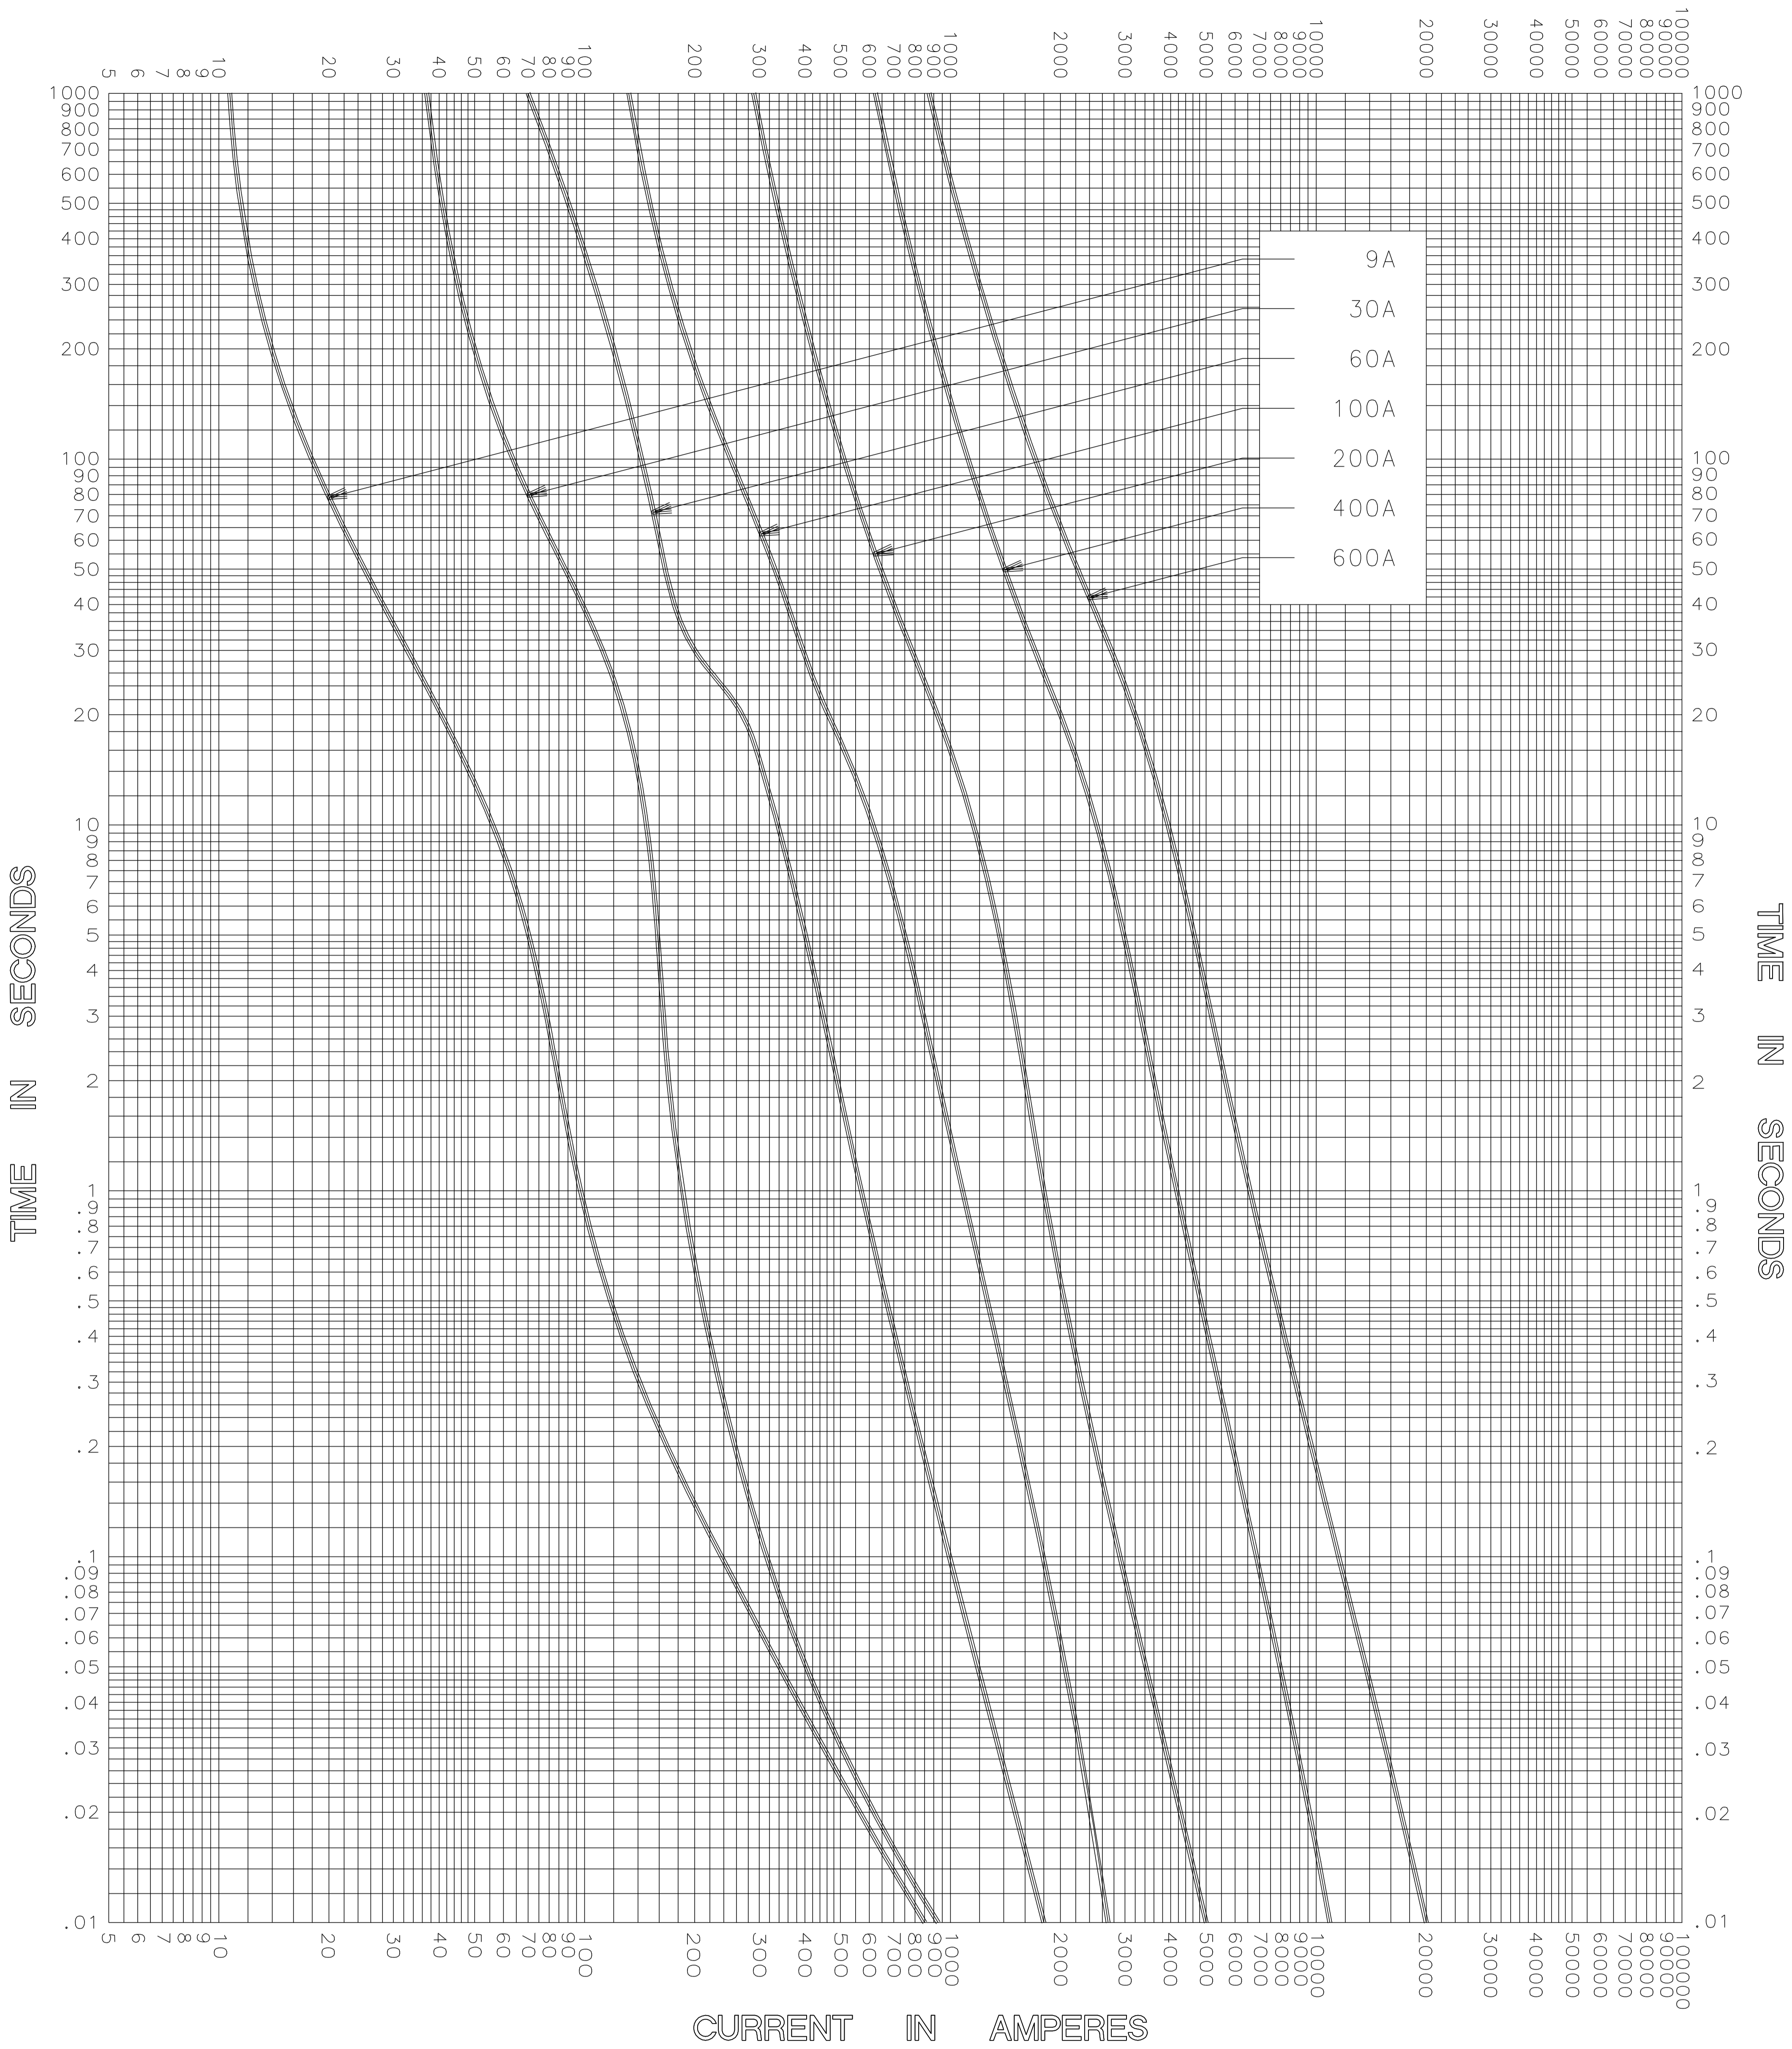

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (9A - 600A)
BASIS FOR DATA _____		



LITTELFUSE, INC.  
DES PLAINES, ILL. USA

DRAWN BY LLL  
DATE 05/02/05  
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC013

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT