


**AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES**

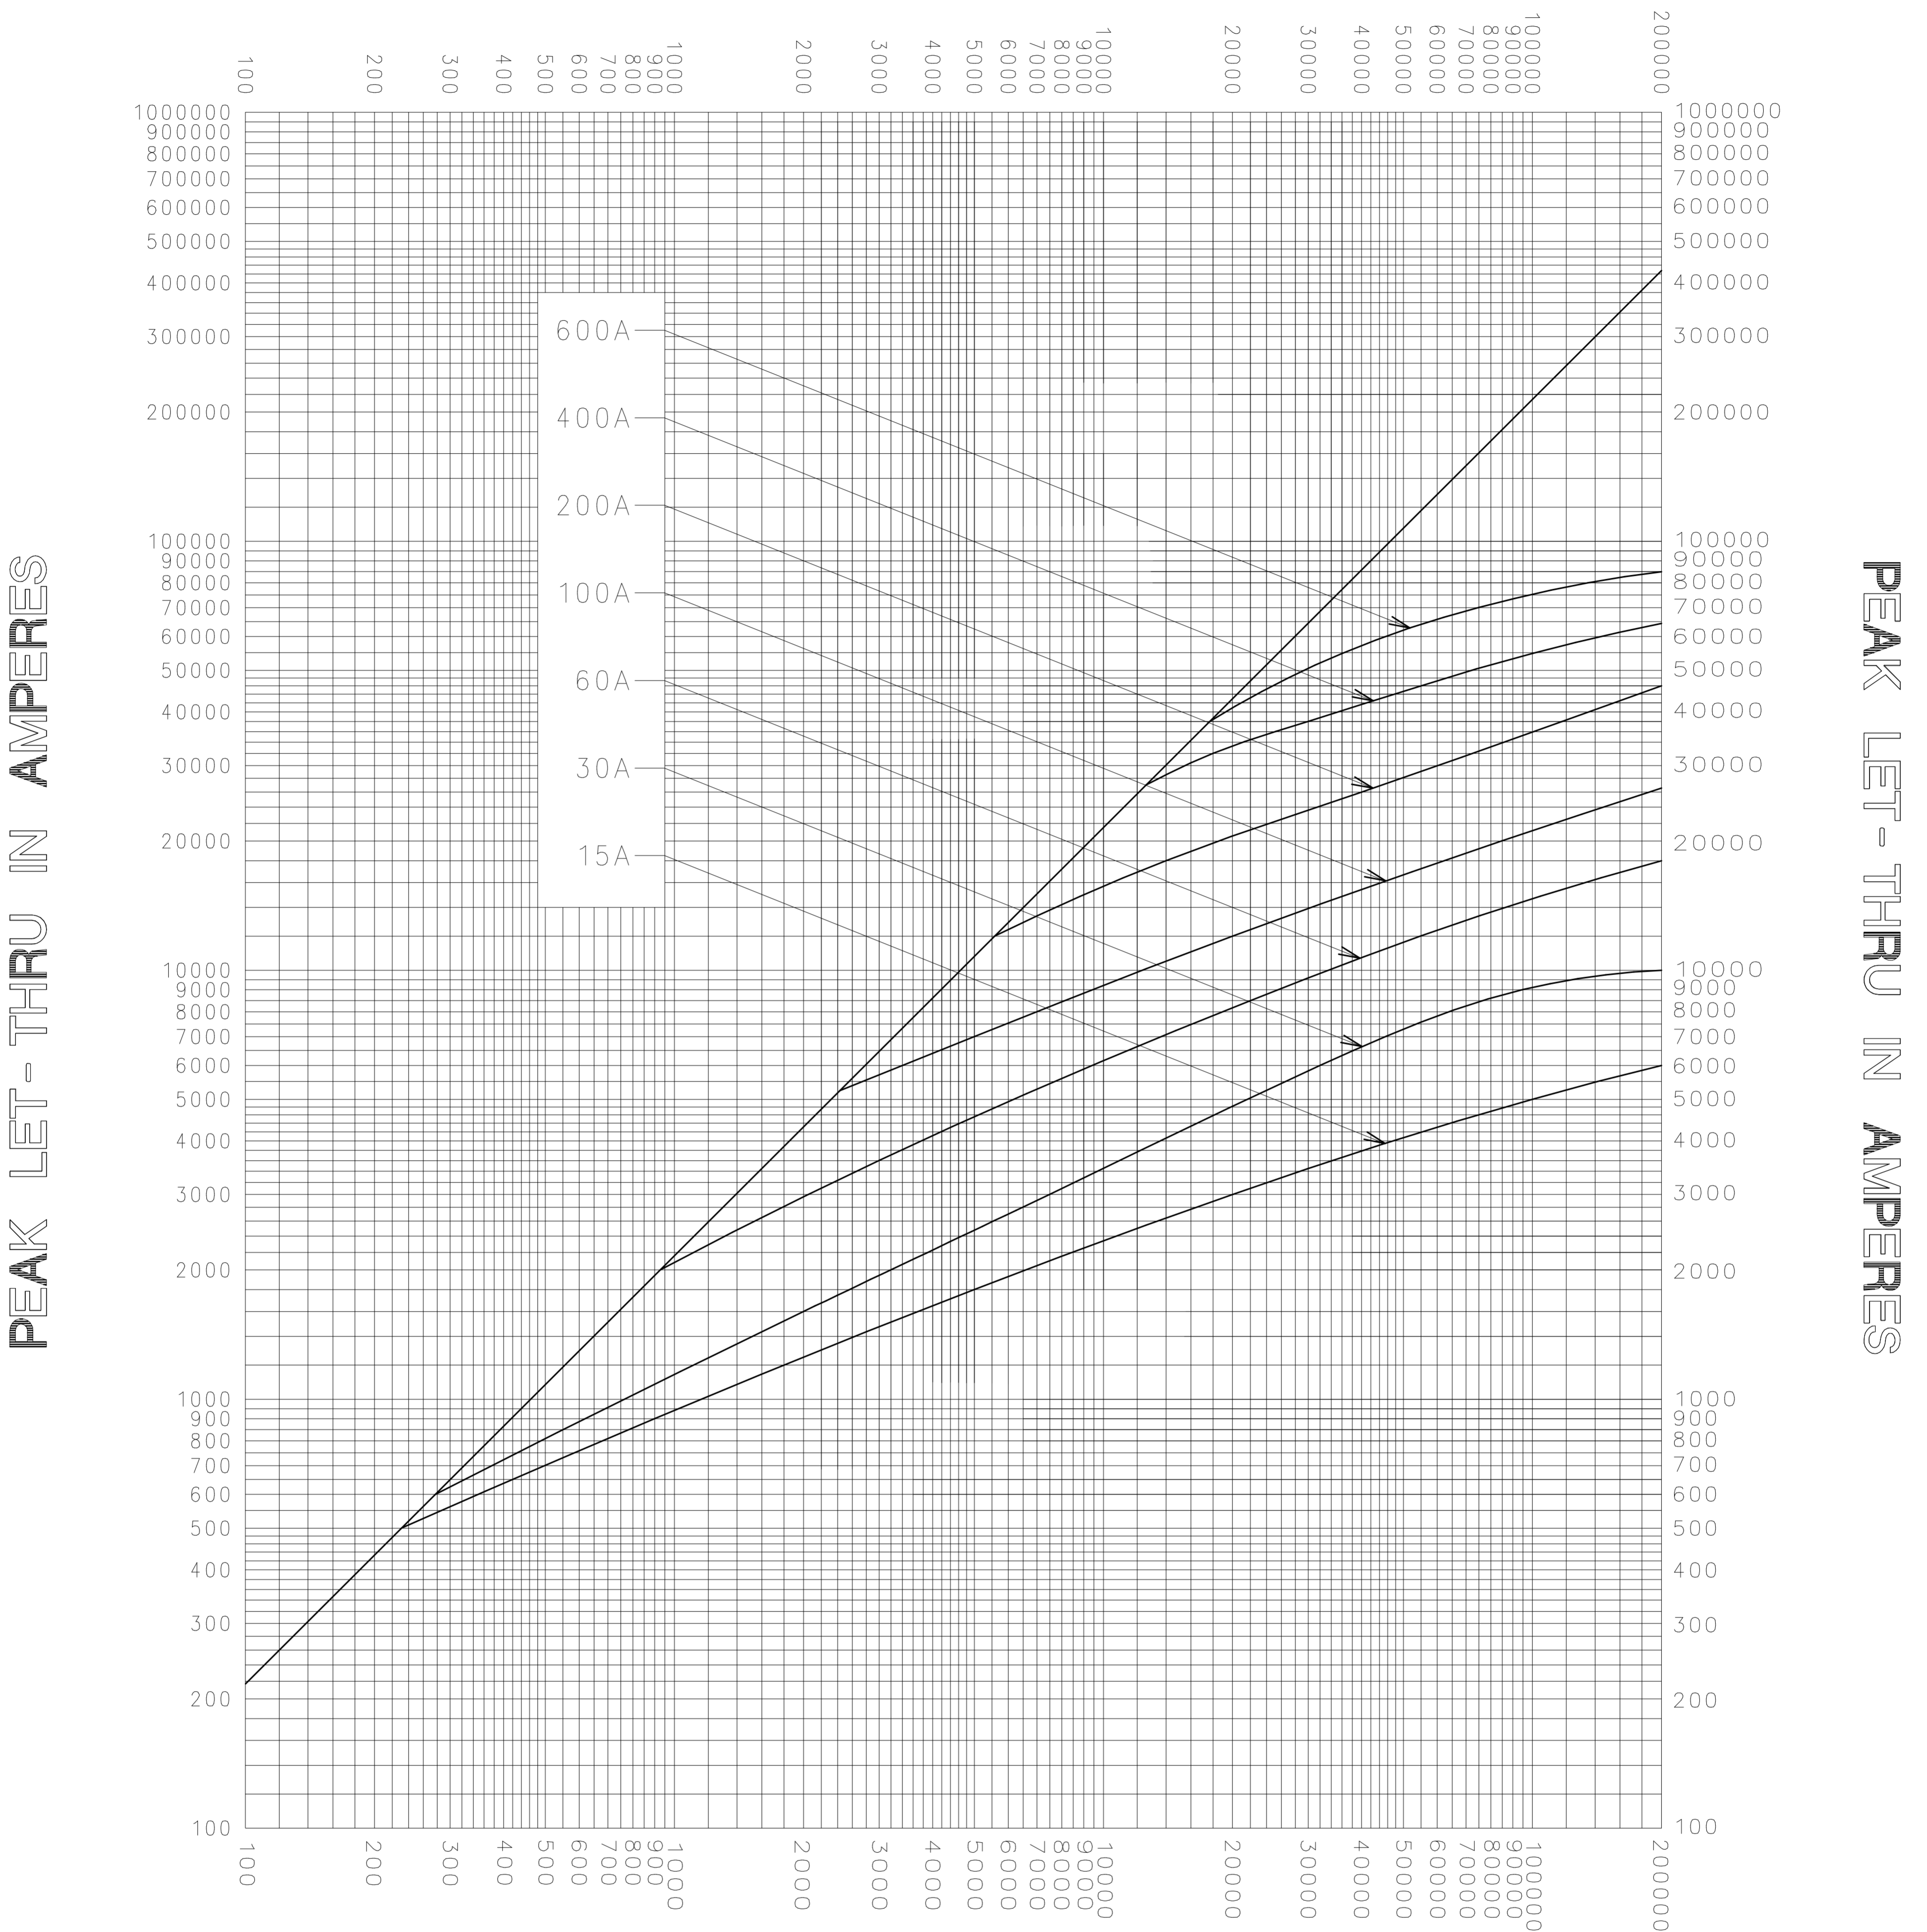

**AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER IDSR (15A - 600A)
BASIS FOR DATA _____	

<b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>09/06/06</u> CHECKED BY <u>MP</u>
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>	DRAWING NO. A-FCC05-05S-001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT