


CURRENT IN AMPERES

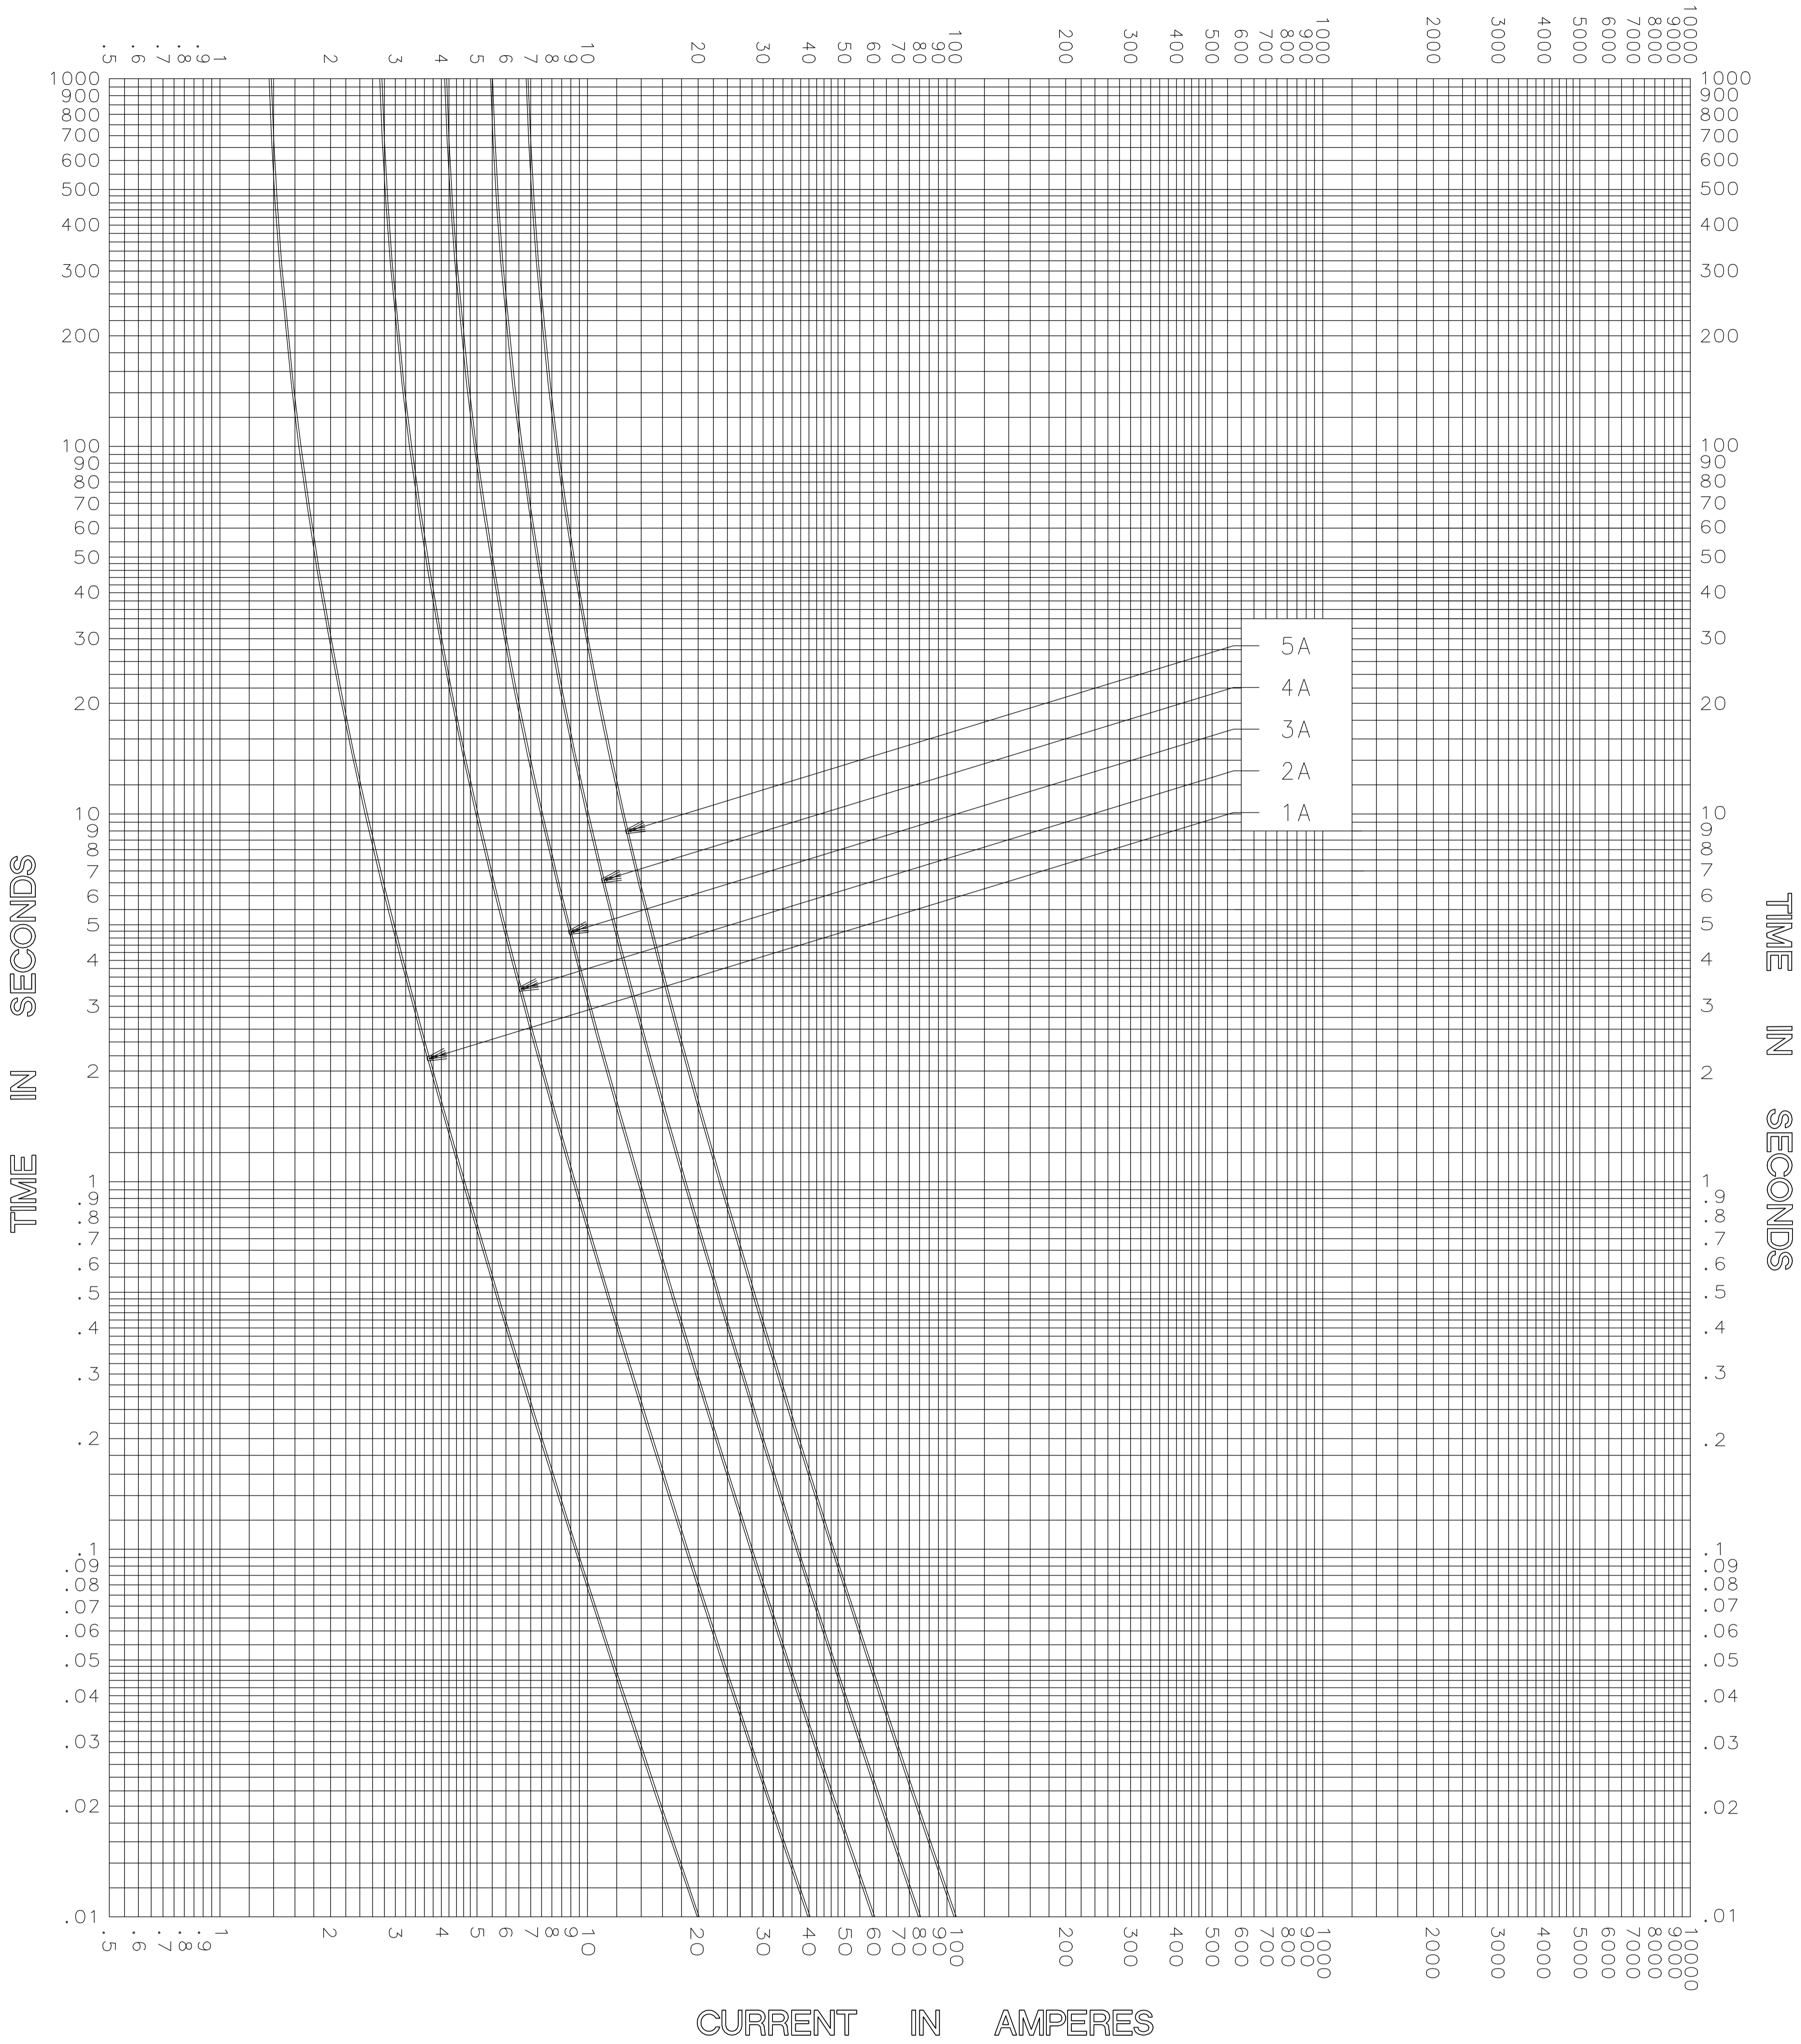

CURRENT IN AMPERES


|                                                       |                     |
|-------------------------------------------------------|---------------------|
| TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER |
| BASIS FOR DATA _____                                  | NLN (1A - 5A)       |

|                                                                                                                     |                                                                     |
|---------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------|
| <br>DES PLAINES, ILLINOIS 60016 | DRAWN BY <u>LLL</u><br>DATE <u>08/18/04</u><br>CHECKED BY <u>MP</u> |
| TIME CURRENT CHARACTERISTIC CURVES                                                                                  | DRAWING NO. <u>A - FCC01111001</u>                                  |

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

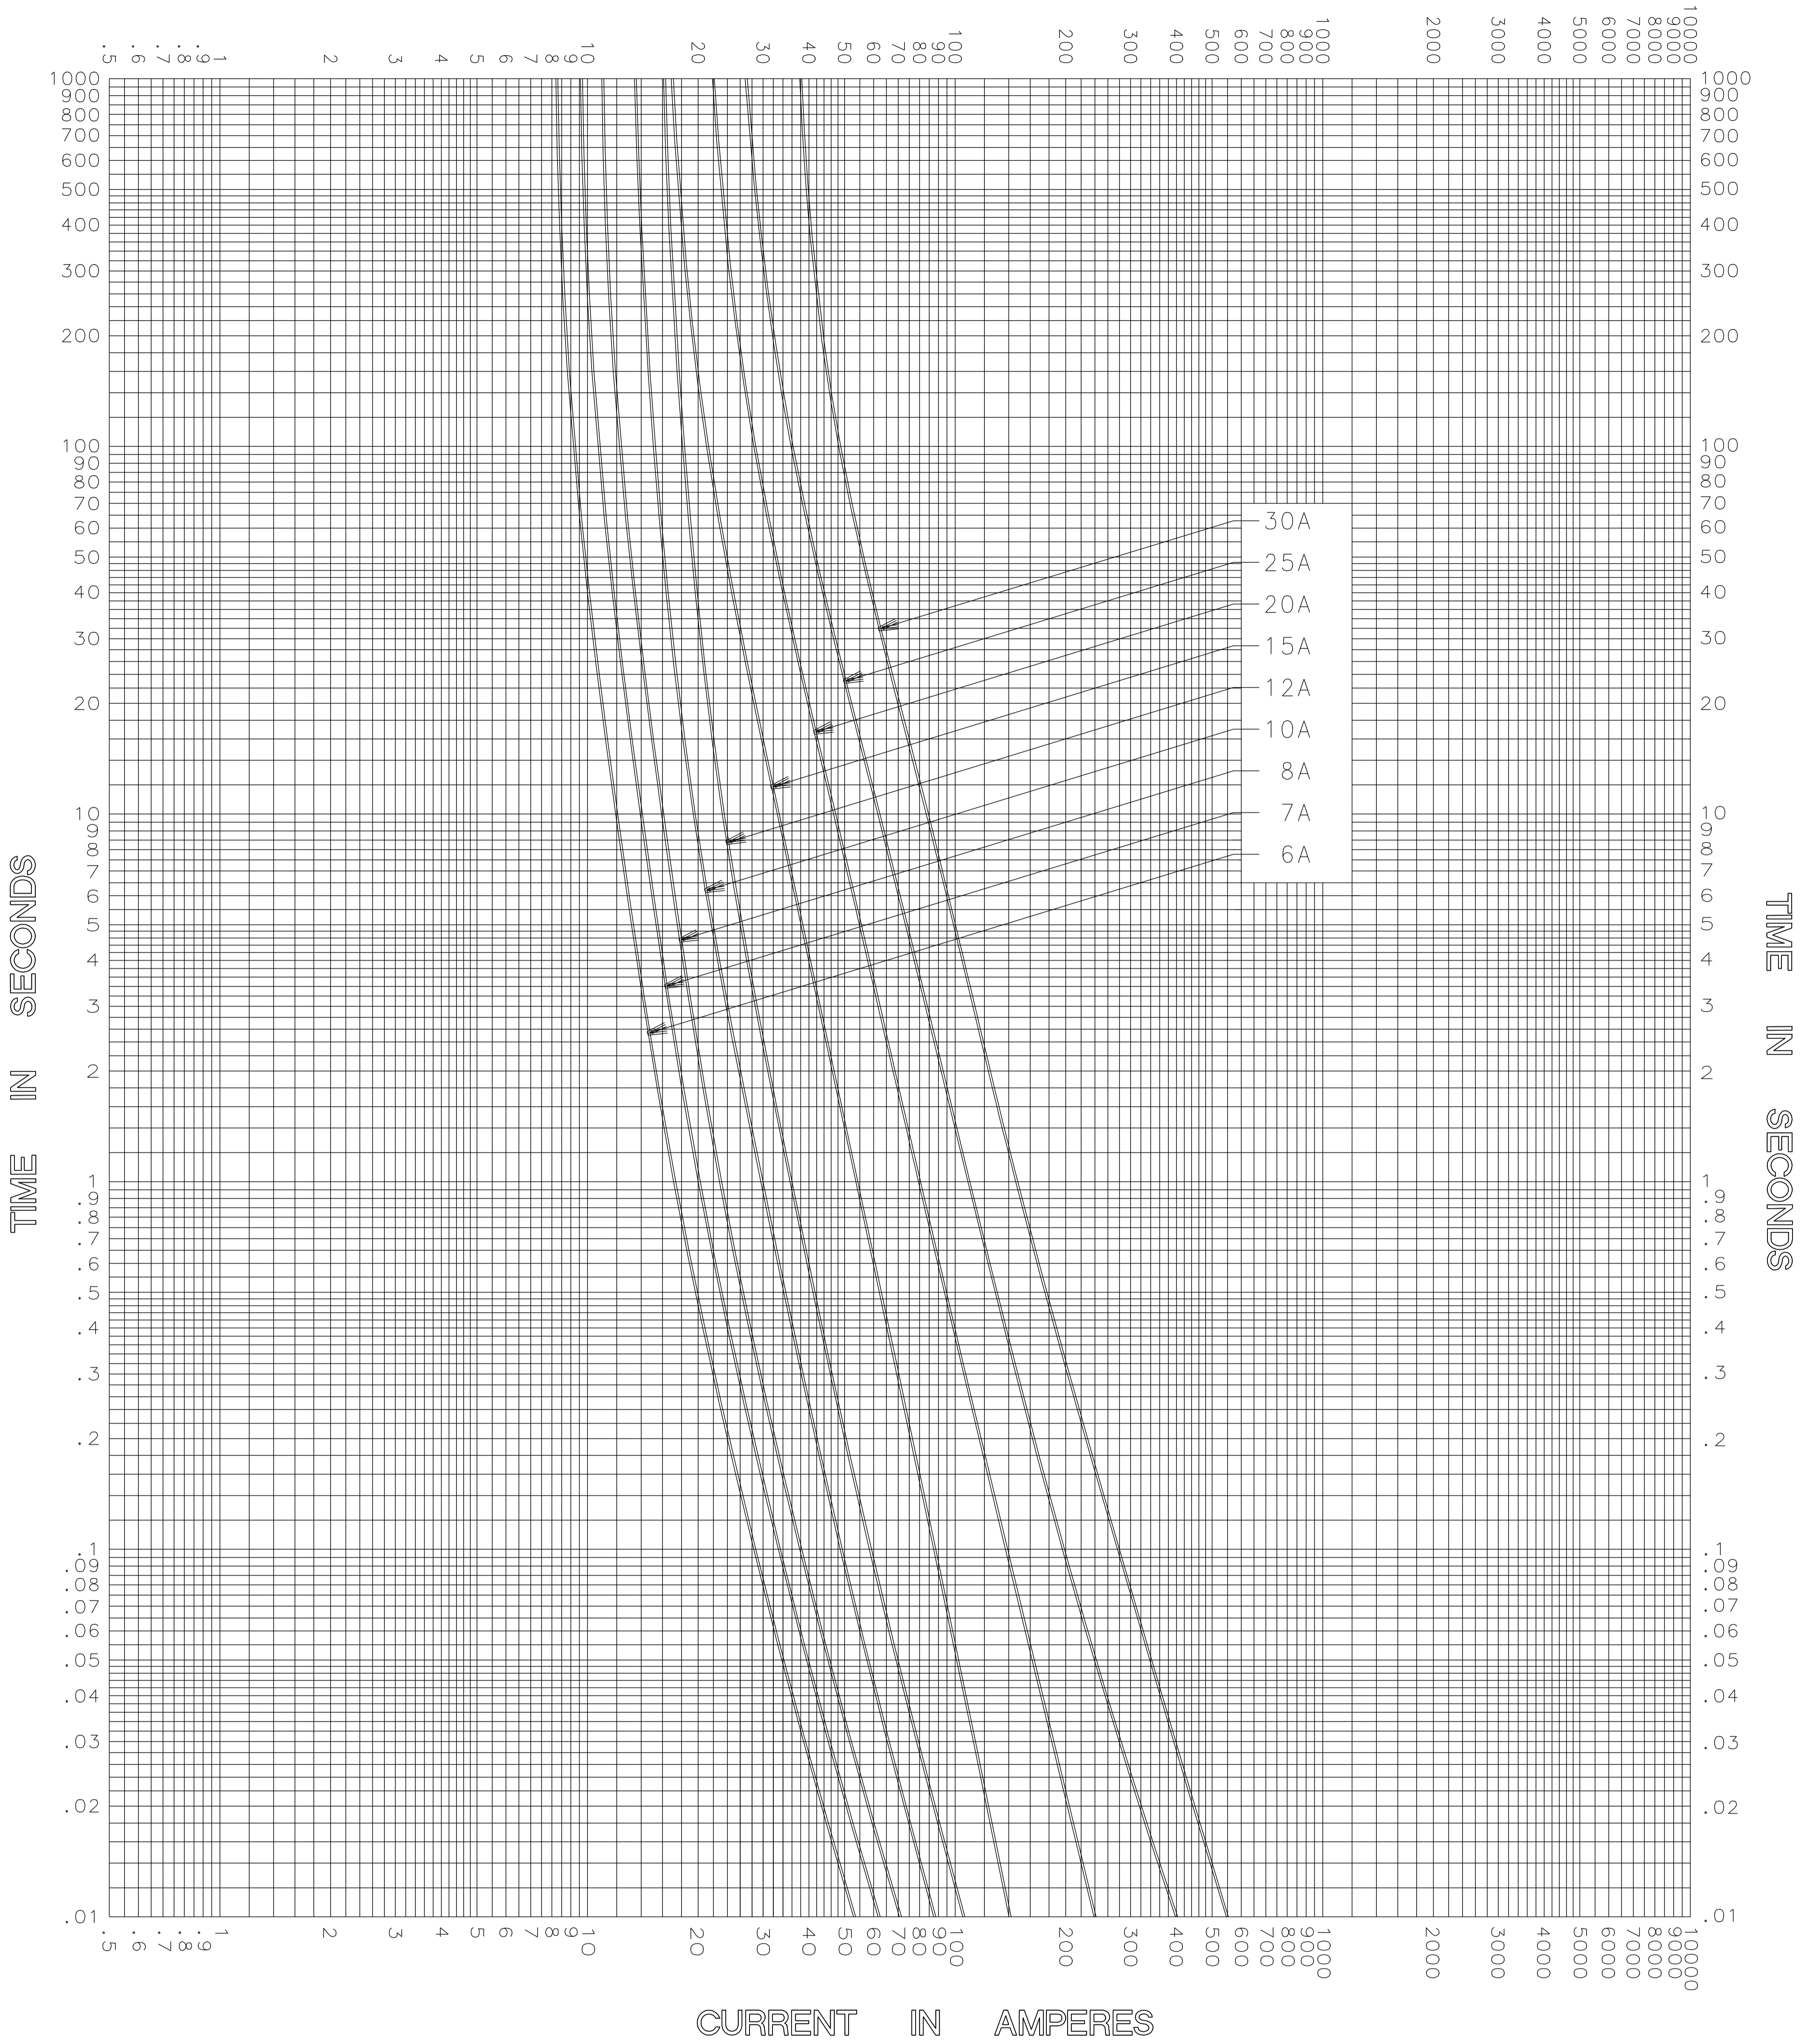

CURRENT IN AMPERES

|                      |                                    |                                       |
|----------------------|------------------------------------|---------------------------------------|
| TEST VOLTAGE _____   | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER<br>NLN (6A - 30A) |
| BASIS FOR DATA _____ |                                    |                                       |




|             |               |
|-------------|---------------|
| DRAWN BY    | LLL           |
| DATE        | 08/18/04      |
| CHECKED BY  | MP            |
| DRAWING NO. | A - FCC014102 |

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

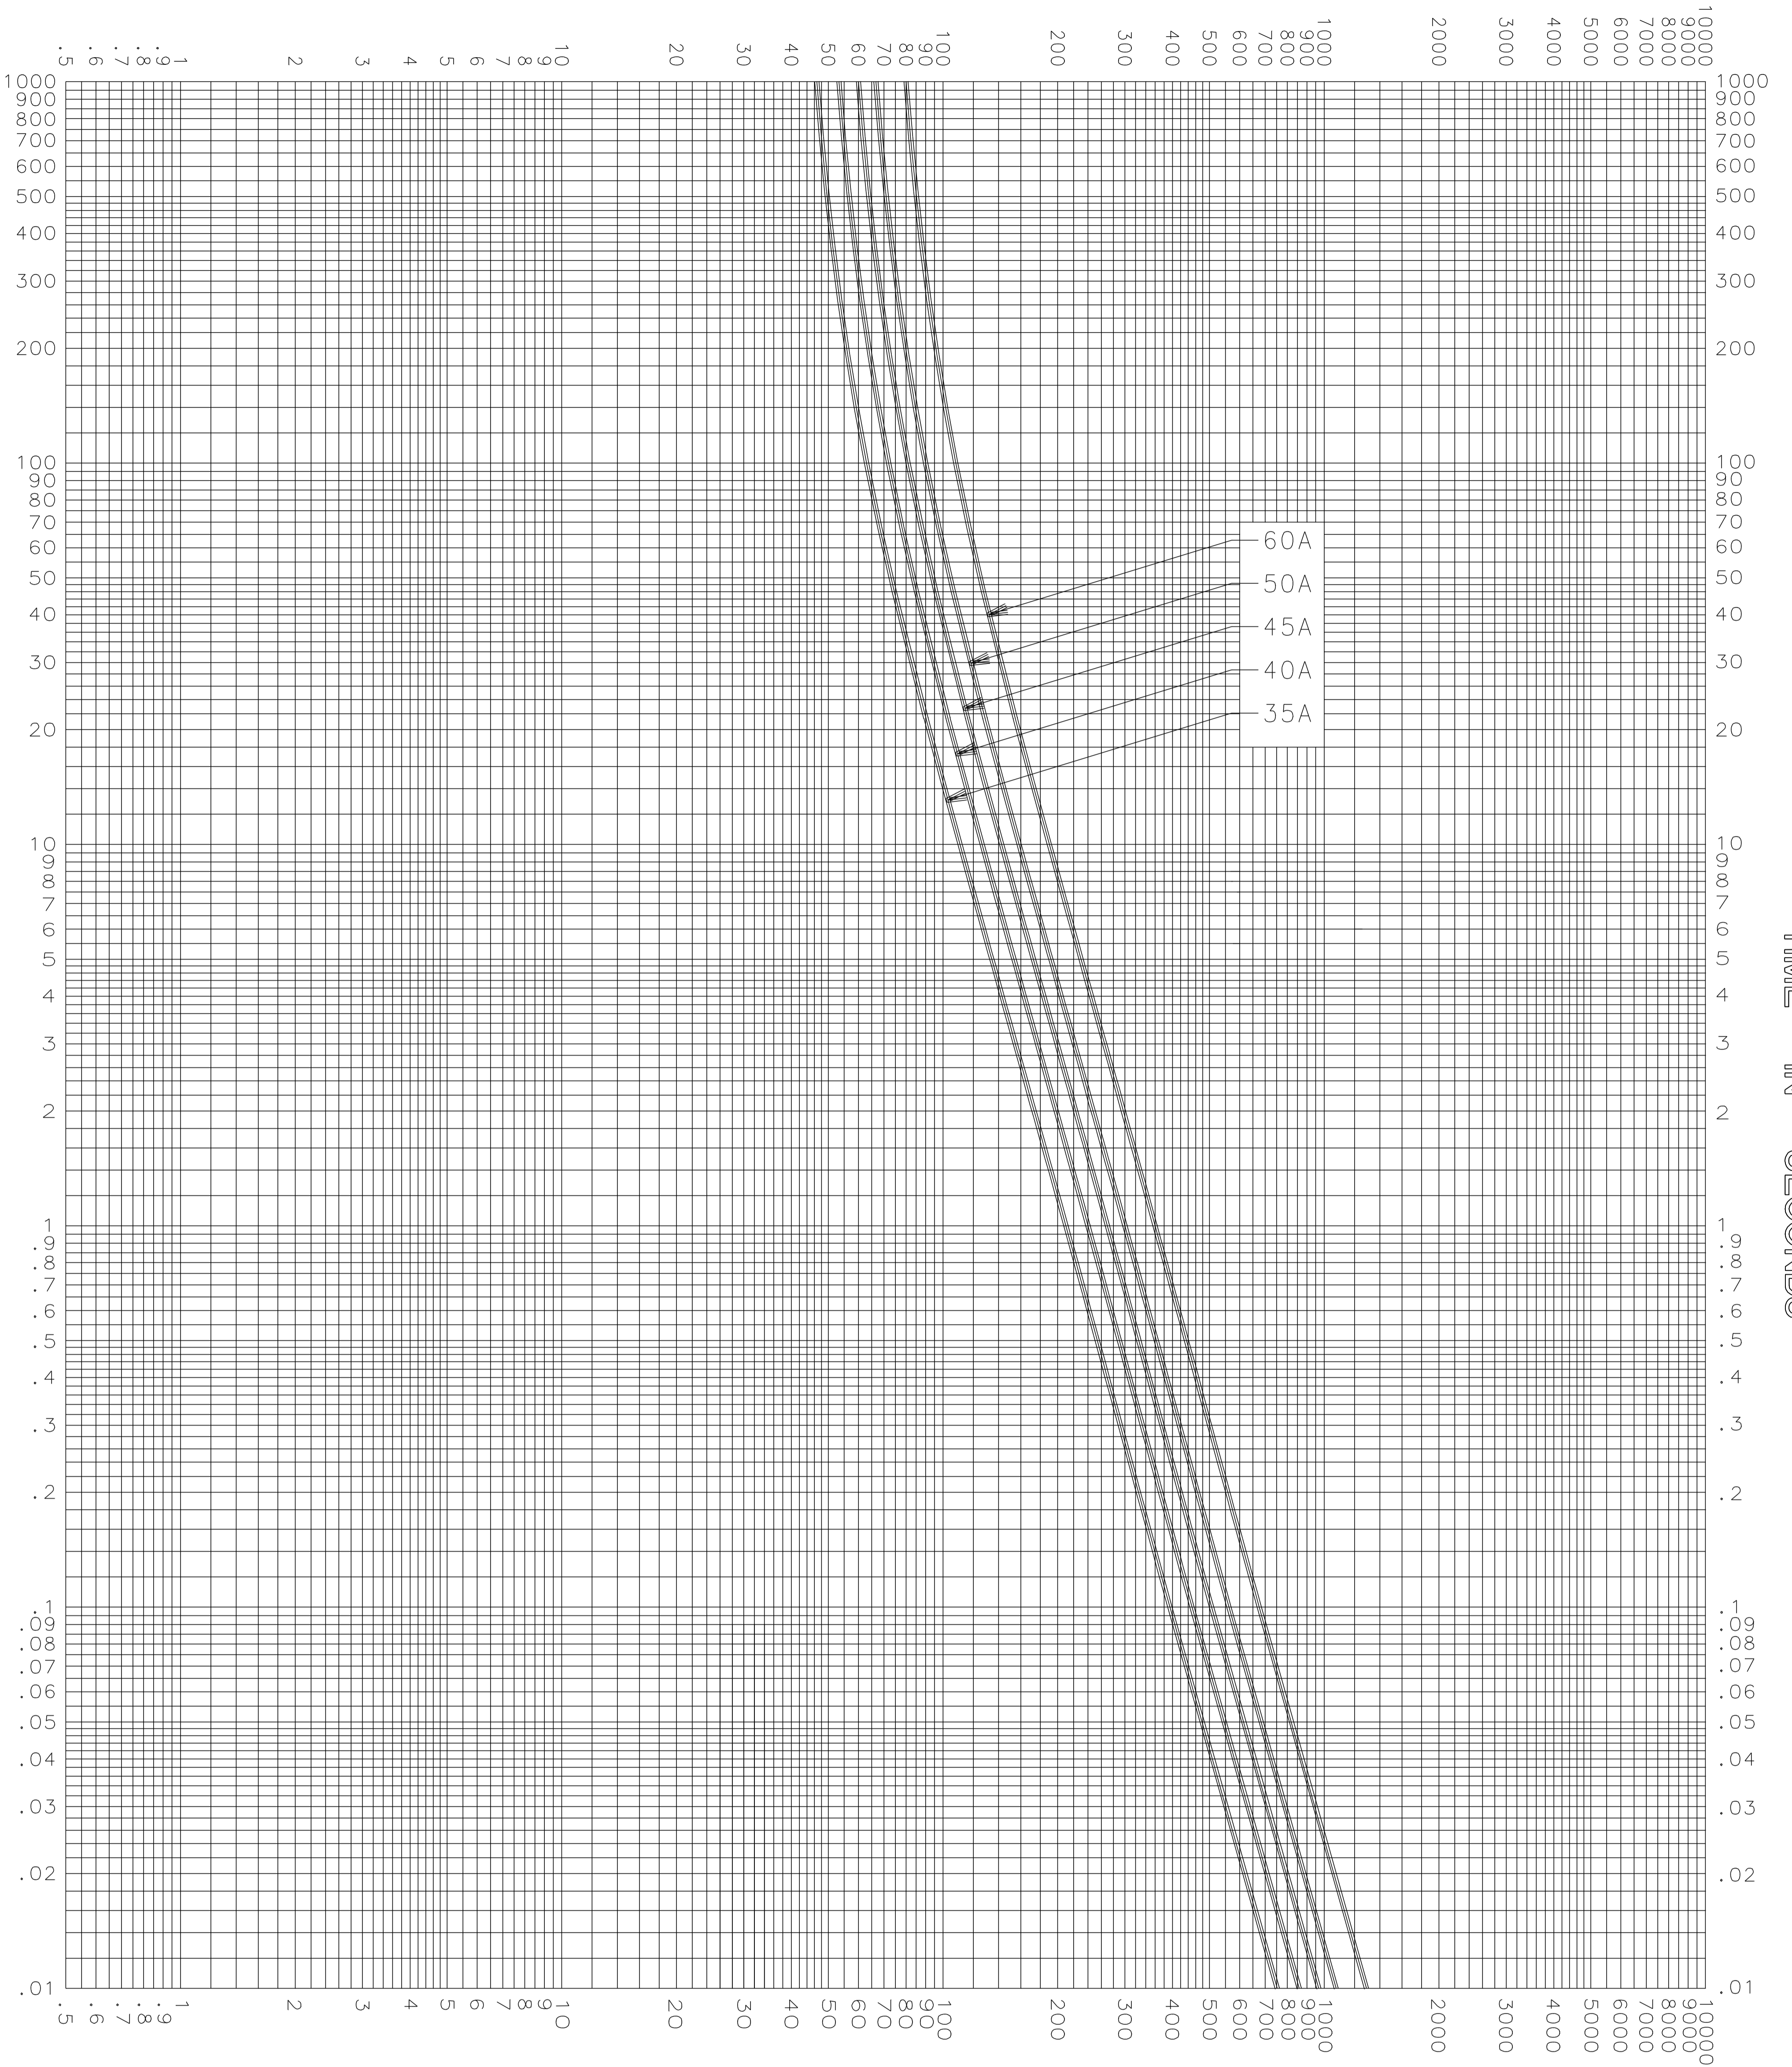

CURRENT IN AMPERES

|                      |                                    |                                        |
|----------------------|------------------------------------|----------------------------------------|
| TEST VOLTAGE _____   | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER<br>NLN (35A - 60A) |
| BASIS FOR DATA _____ |                                    |                                        |




|               |
|---------------|
| DRAWN BY LLL  |
| DATE 08/18/04 |
| CHECKED BY MP |

|                                    |                               |
|------------------------------------|-------------------------------|
| TIME CURRENT CHARACTERISTIC CURVES | DRAWING NO.<br>A - FCC0111103 |
|------------------------------------|-------------------------------|

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

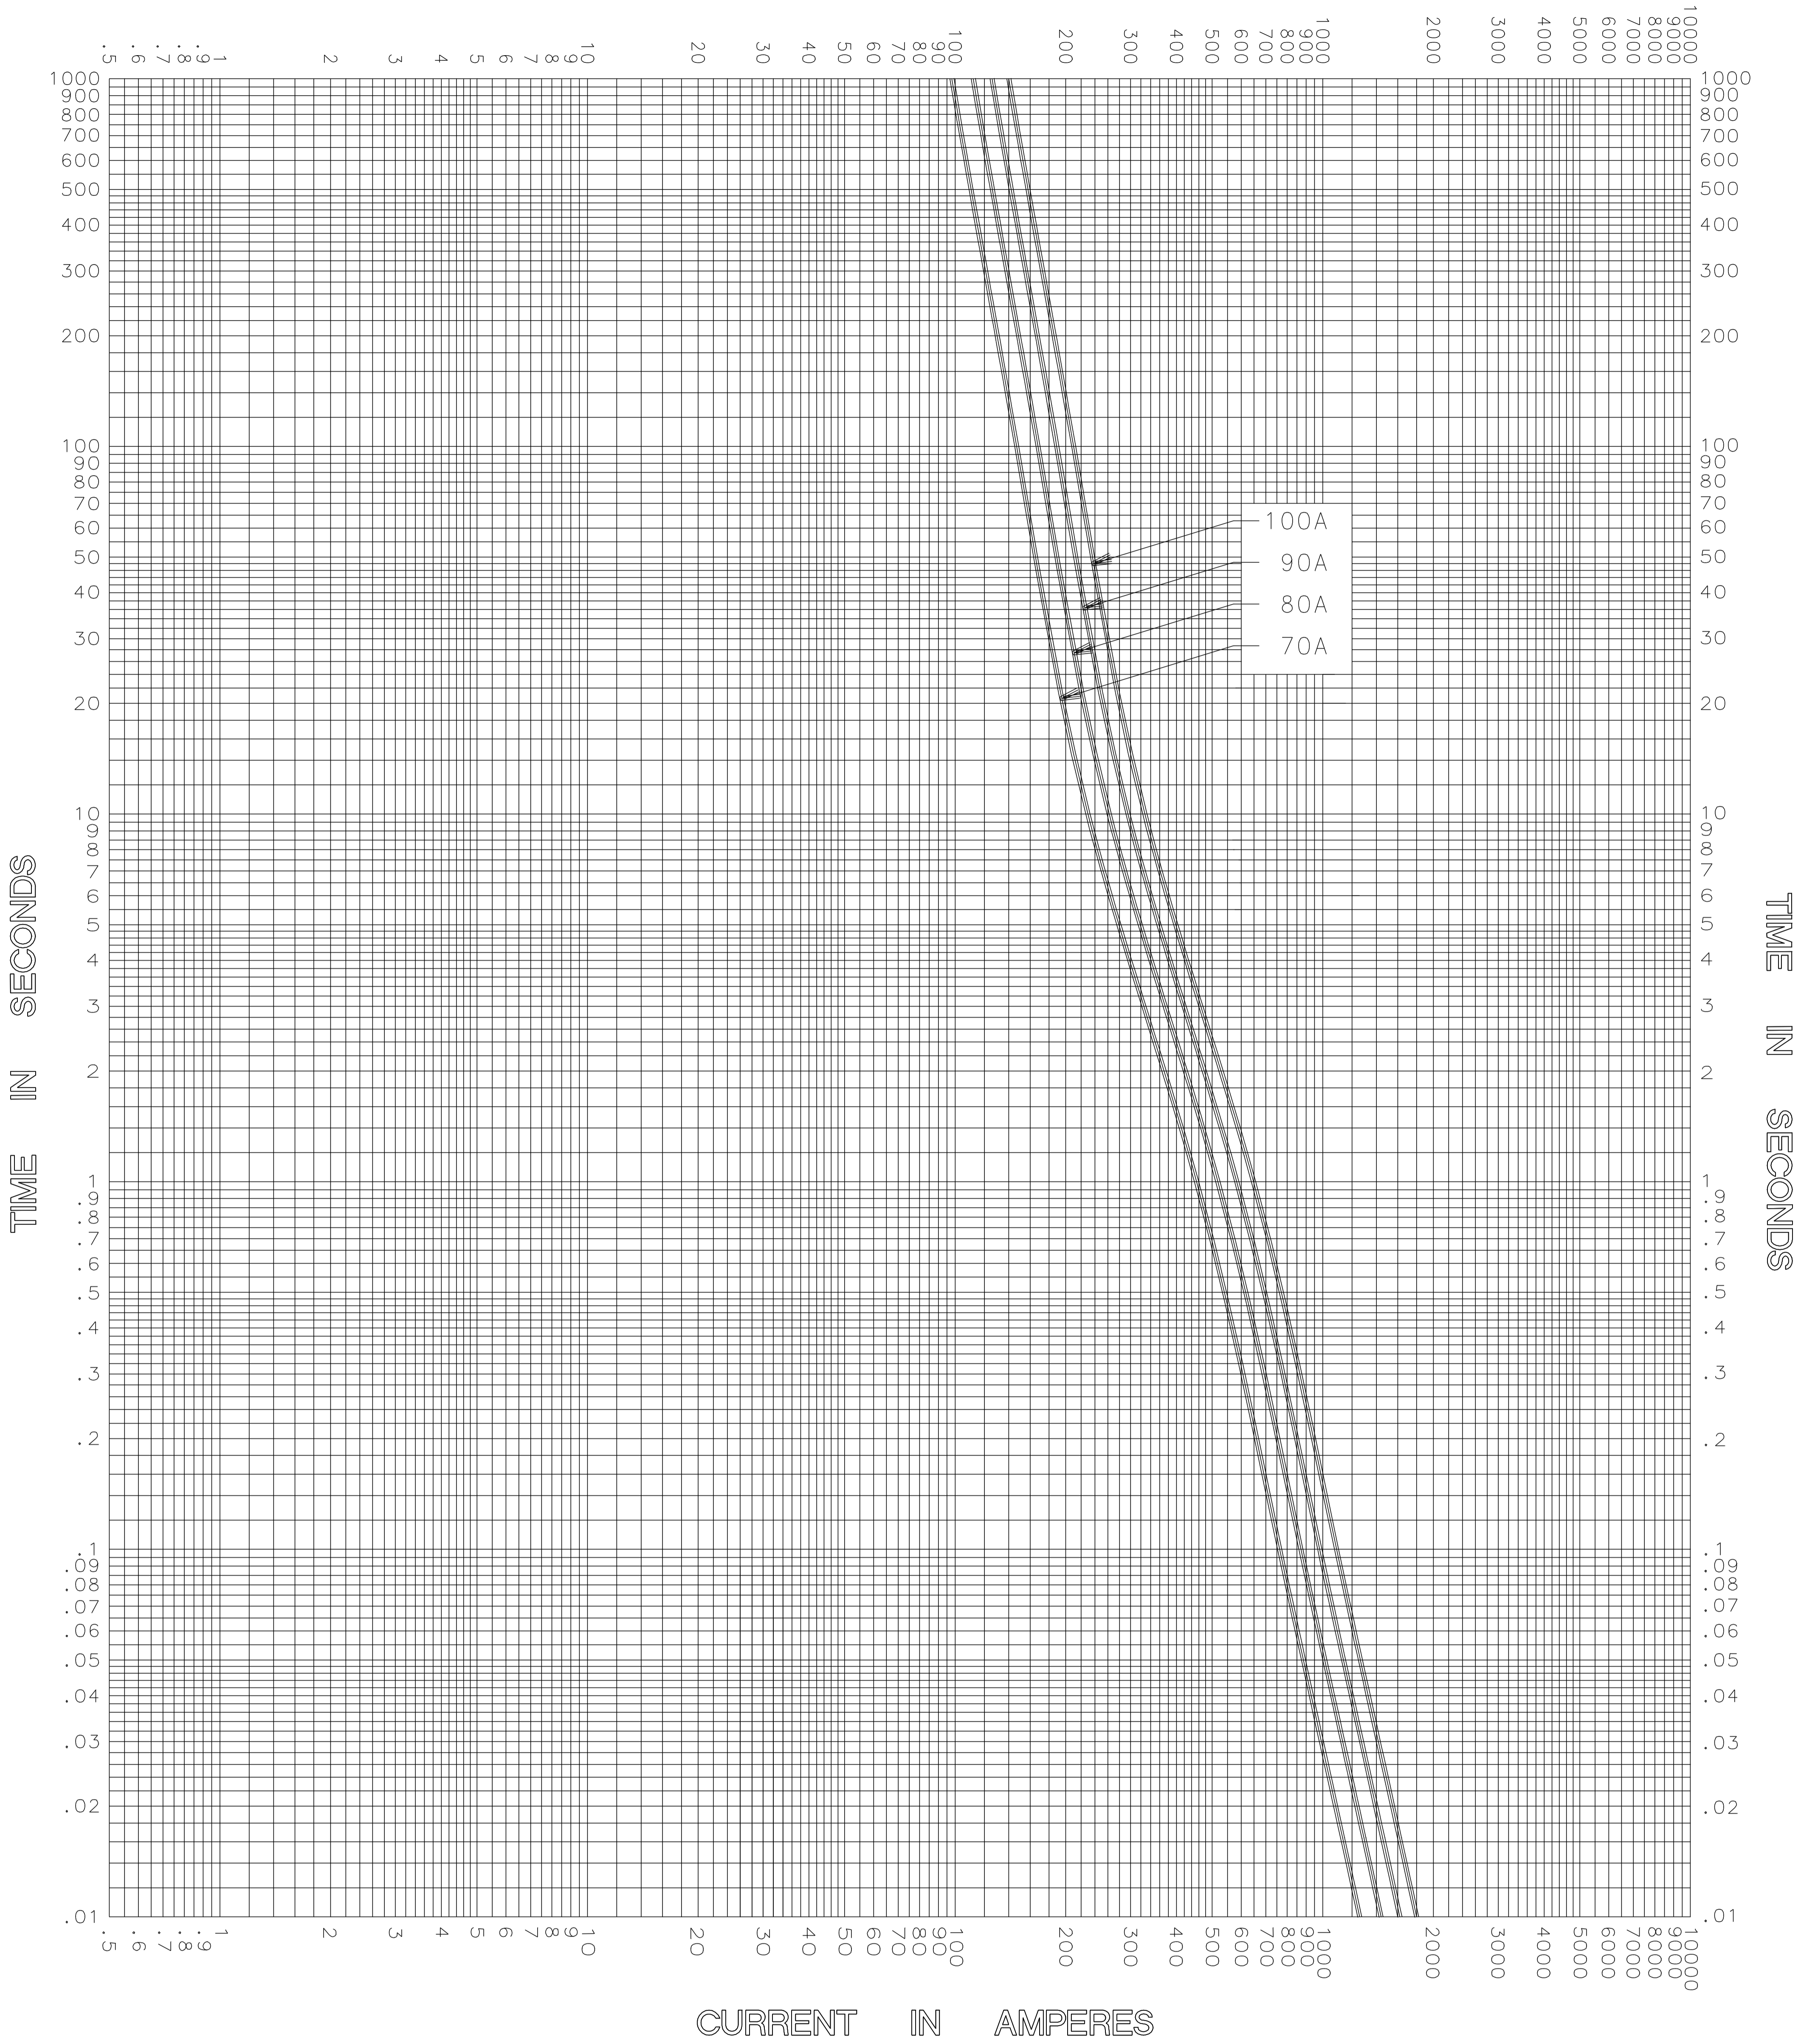

CURRENT IN AMPERES

|                      |                                    |                                         |
|----------------------|------------------------------------|-----------------------------------------|
| TEST VOLTAGE _____   | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER<br>NLN (70A - 100A) |
| BASIS FOR DATA _____ |                                    |                                         |


|                                                                                                                     |                                                                     |
|---------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------|
| <br>DES PLAINES, ILLINOIS 60016 | DRAWN BY <u>LLL</u><br>DATE <u>08/18/04</u><br>CHECKED BY <u>MP</u> |
|                                                                                                                     | DRAWING NO.<br>A - FCC0111104                                       |

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

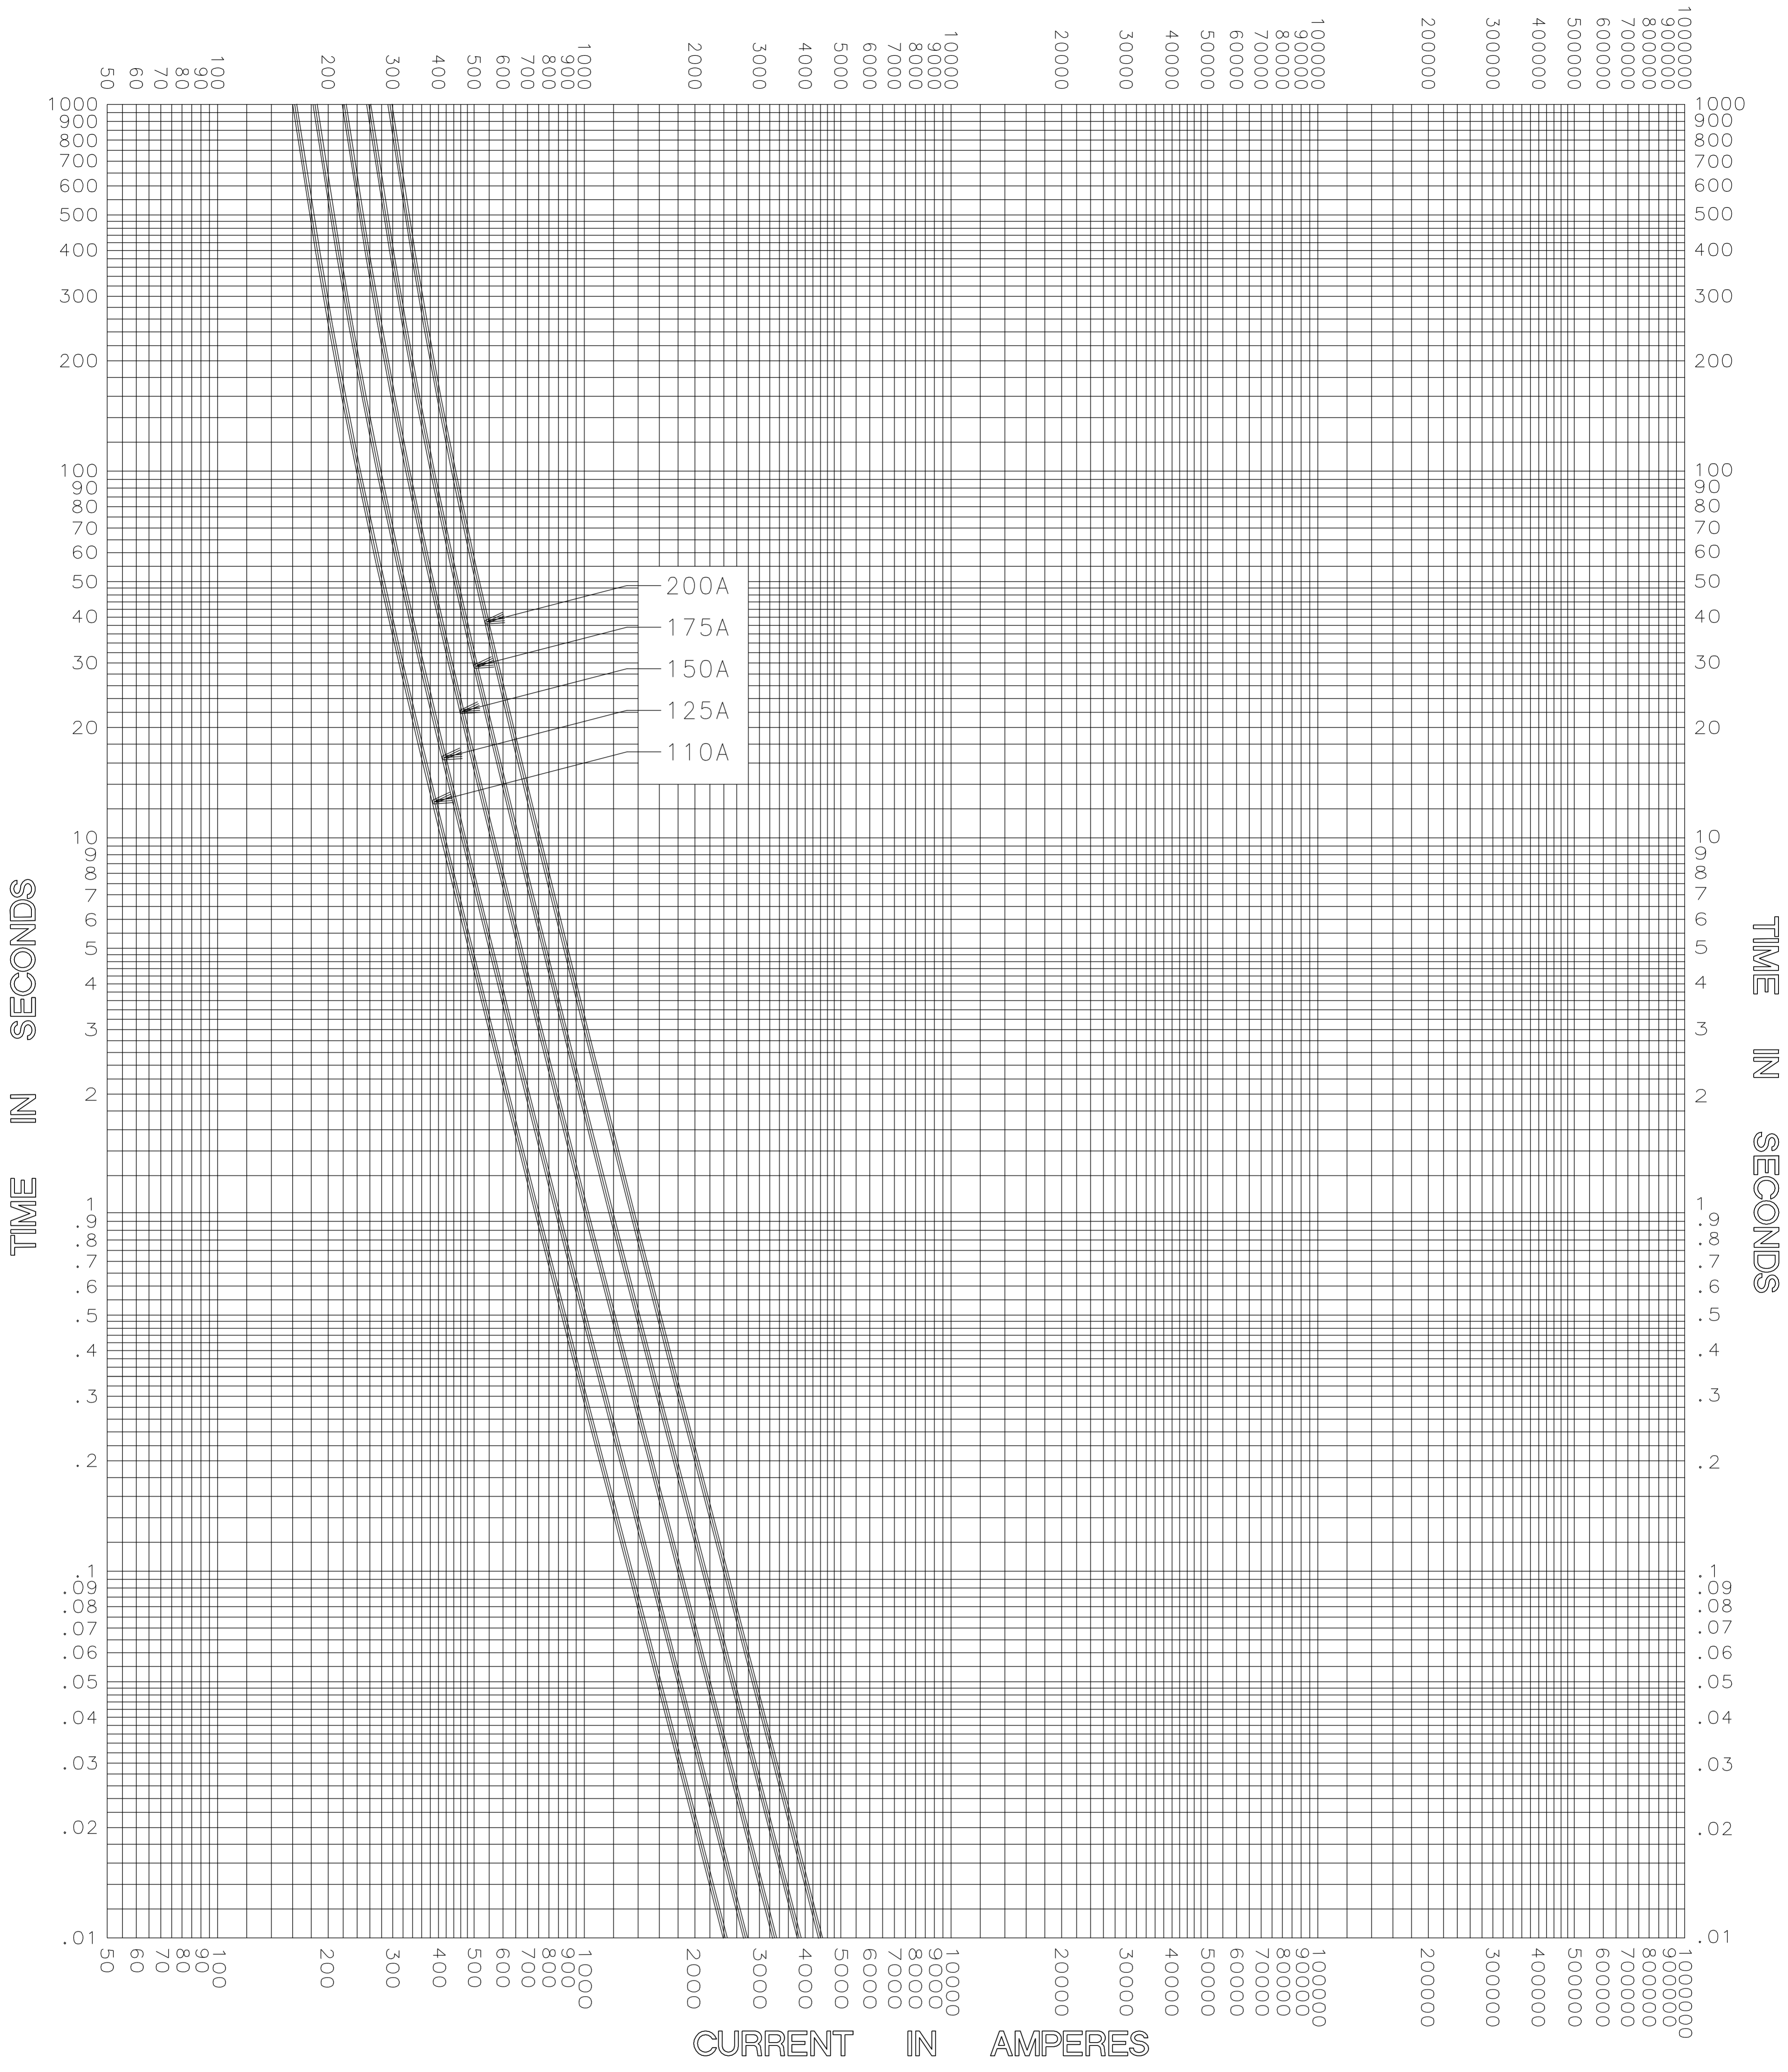

CURRENT IN AMPERES

|                      |                                    |                                          |
|----------------------|------------------------------------|------------------------------------------|
| TEST VOLTAGE _____   | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER<br>NLN (110A - 200A) |
| BASIS FOR DATA _____ |                                    |                                          |




|               |
|---------------|
| DRAWN BY LLL  |
| DATE 08/18/04 |
| CHECKED BY MP |

|                                    |                                |
|------------------------------------|--------------------------------|
| TIME CURRENT CHARACTERISTIC CURVES | DRAWING NO.<br>A FCC02-111-005 |
|------------------------------------|--------------------------------|

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

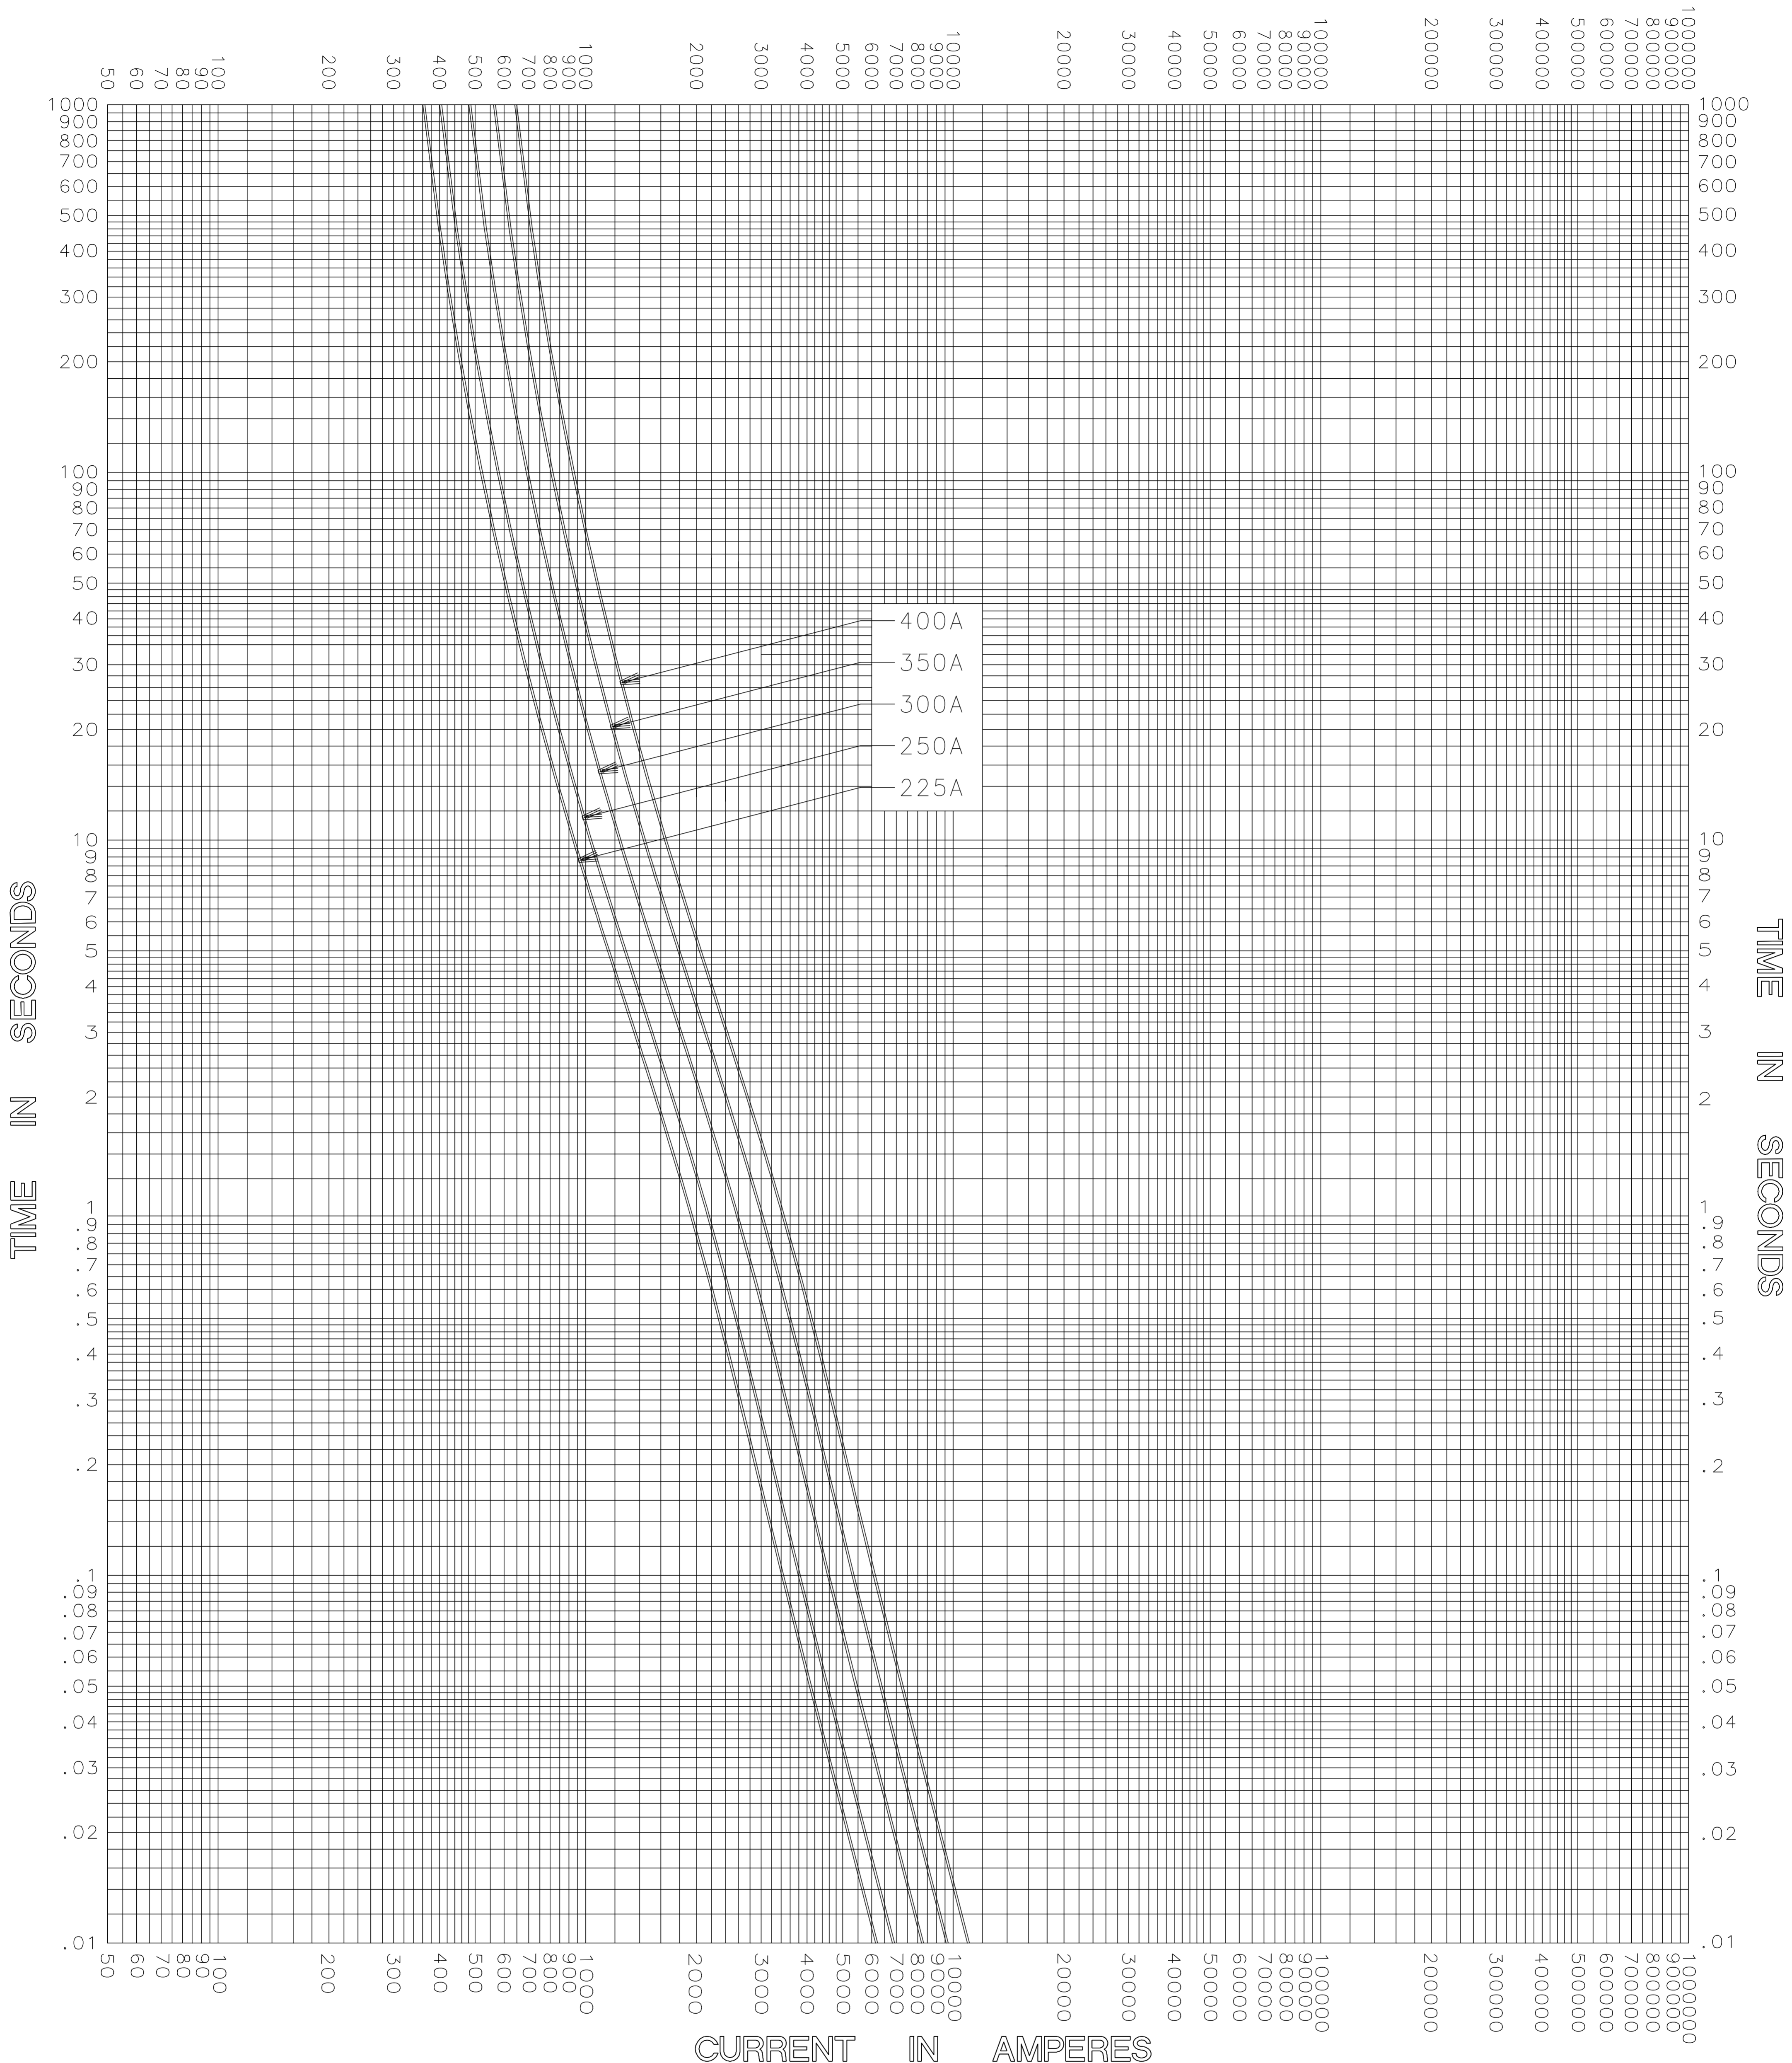

|                      |                                    |                                          |
|----------------------|------------------------------------|------------------------------------------|
| TEST VOLTAGE _____   | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER<br>NLN (225A - 400A) |
| BASIS FOR DATA _____ |                                    |                                          |




|            |          |
|------------|----------|
| DRAWN BY   | LLL      |
| DATE       | 08/18/04 |
| CHECKED BY | MP       |

|                                           |                                |
|-------------------------------------------|--------------------------------|
| <b>TIME CURRENT CHARACTERISTIC CURVES</b> | DRAWING NO.<br>A FCC02 1111006 |
|-------------------------------------------|--------------------------------|

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

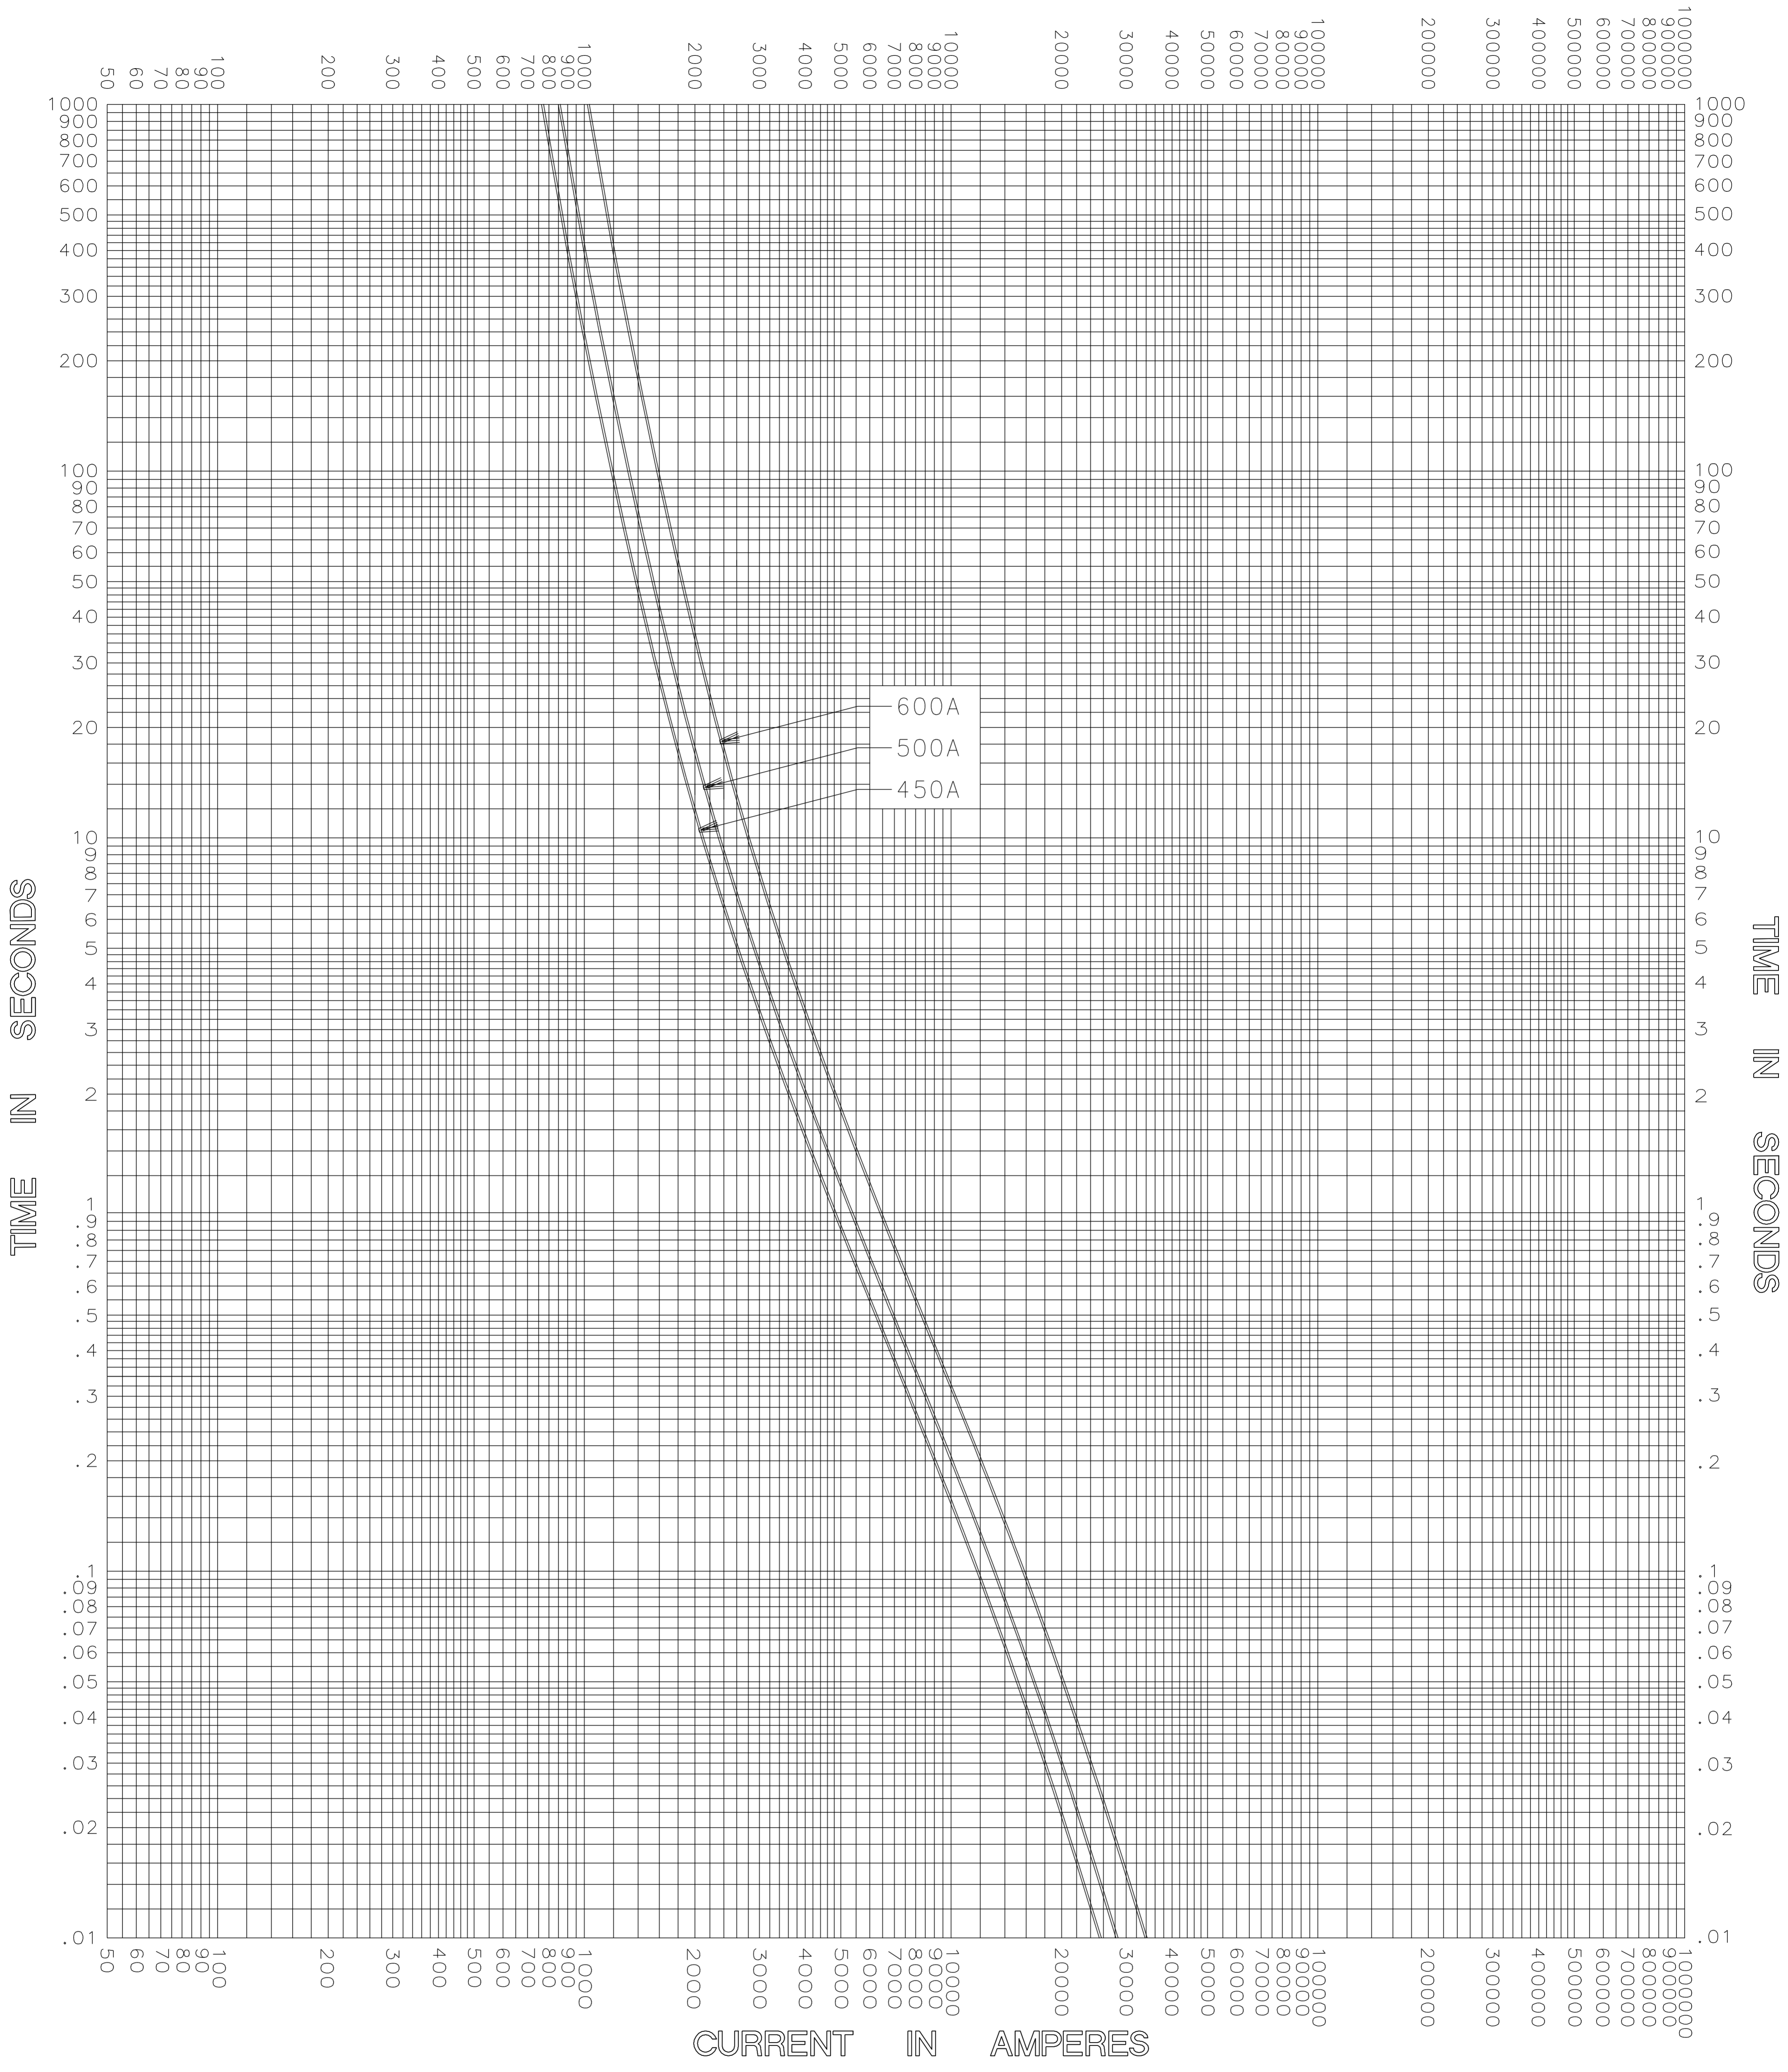

|                      |                                    |                                          |
|----------------------|------------------------------------|------------------------------------------|
| TEST VOLTAGE _____   | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER<br>NLN (450A - 600A) |
| BASIS FOR DATA _____ |                                    |                                          |




DRAWN BY LLL  
DATE 08/18/04  
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A FCC02 11/1/07

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

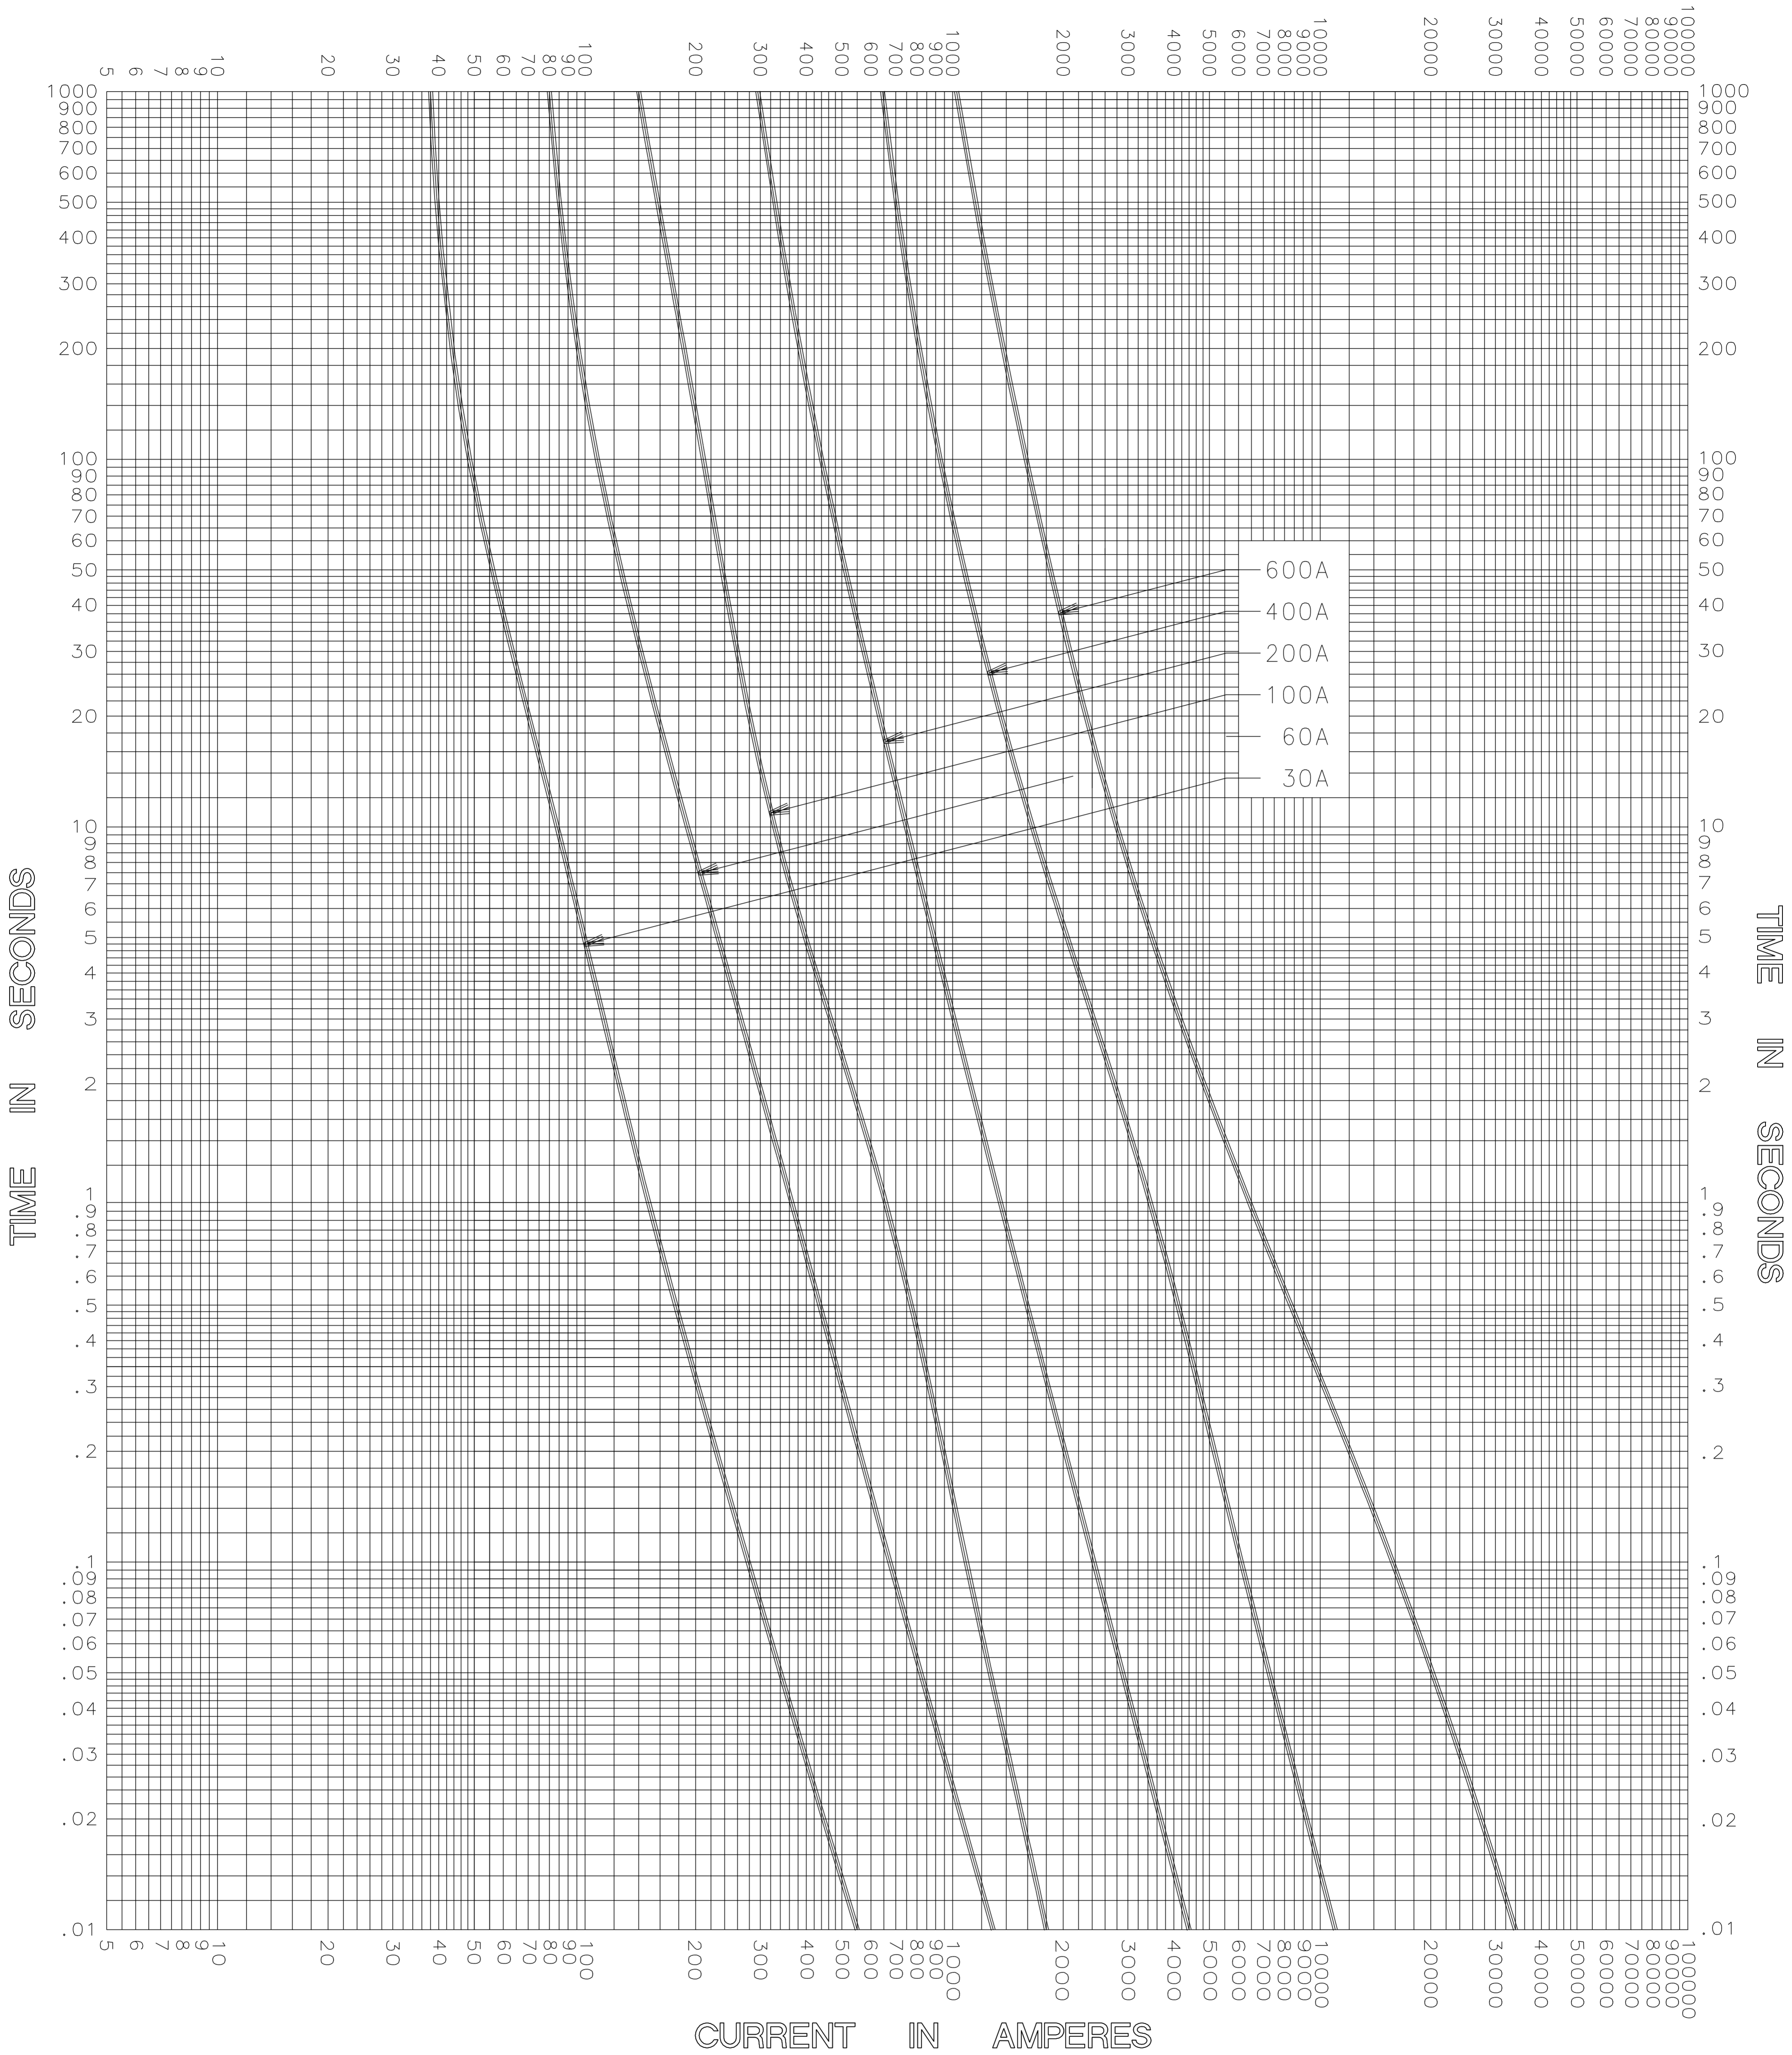

CURRENT IN AMPERES

|                      |                                    |                                         |
|----------------------|------------------------------------|-----------------------------------------|
| TEST VOLTAGE _____   | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER<br>NLN (30A - 600A) |
| BASIS FOR DATA _____ |                                    |                                         |



DRAWN BY LLL  
DATE 08/18/04  
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.  
A FCC02-111-008

UNCONTROLLED DOCUMENT