



AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES

PEAK LET-THRU IN AMPERES

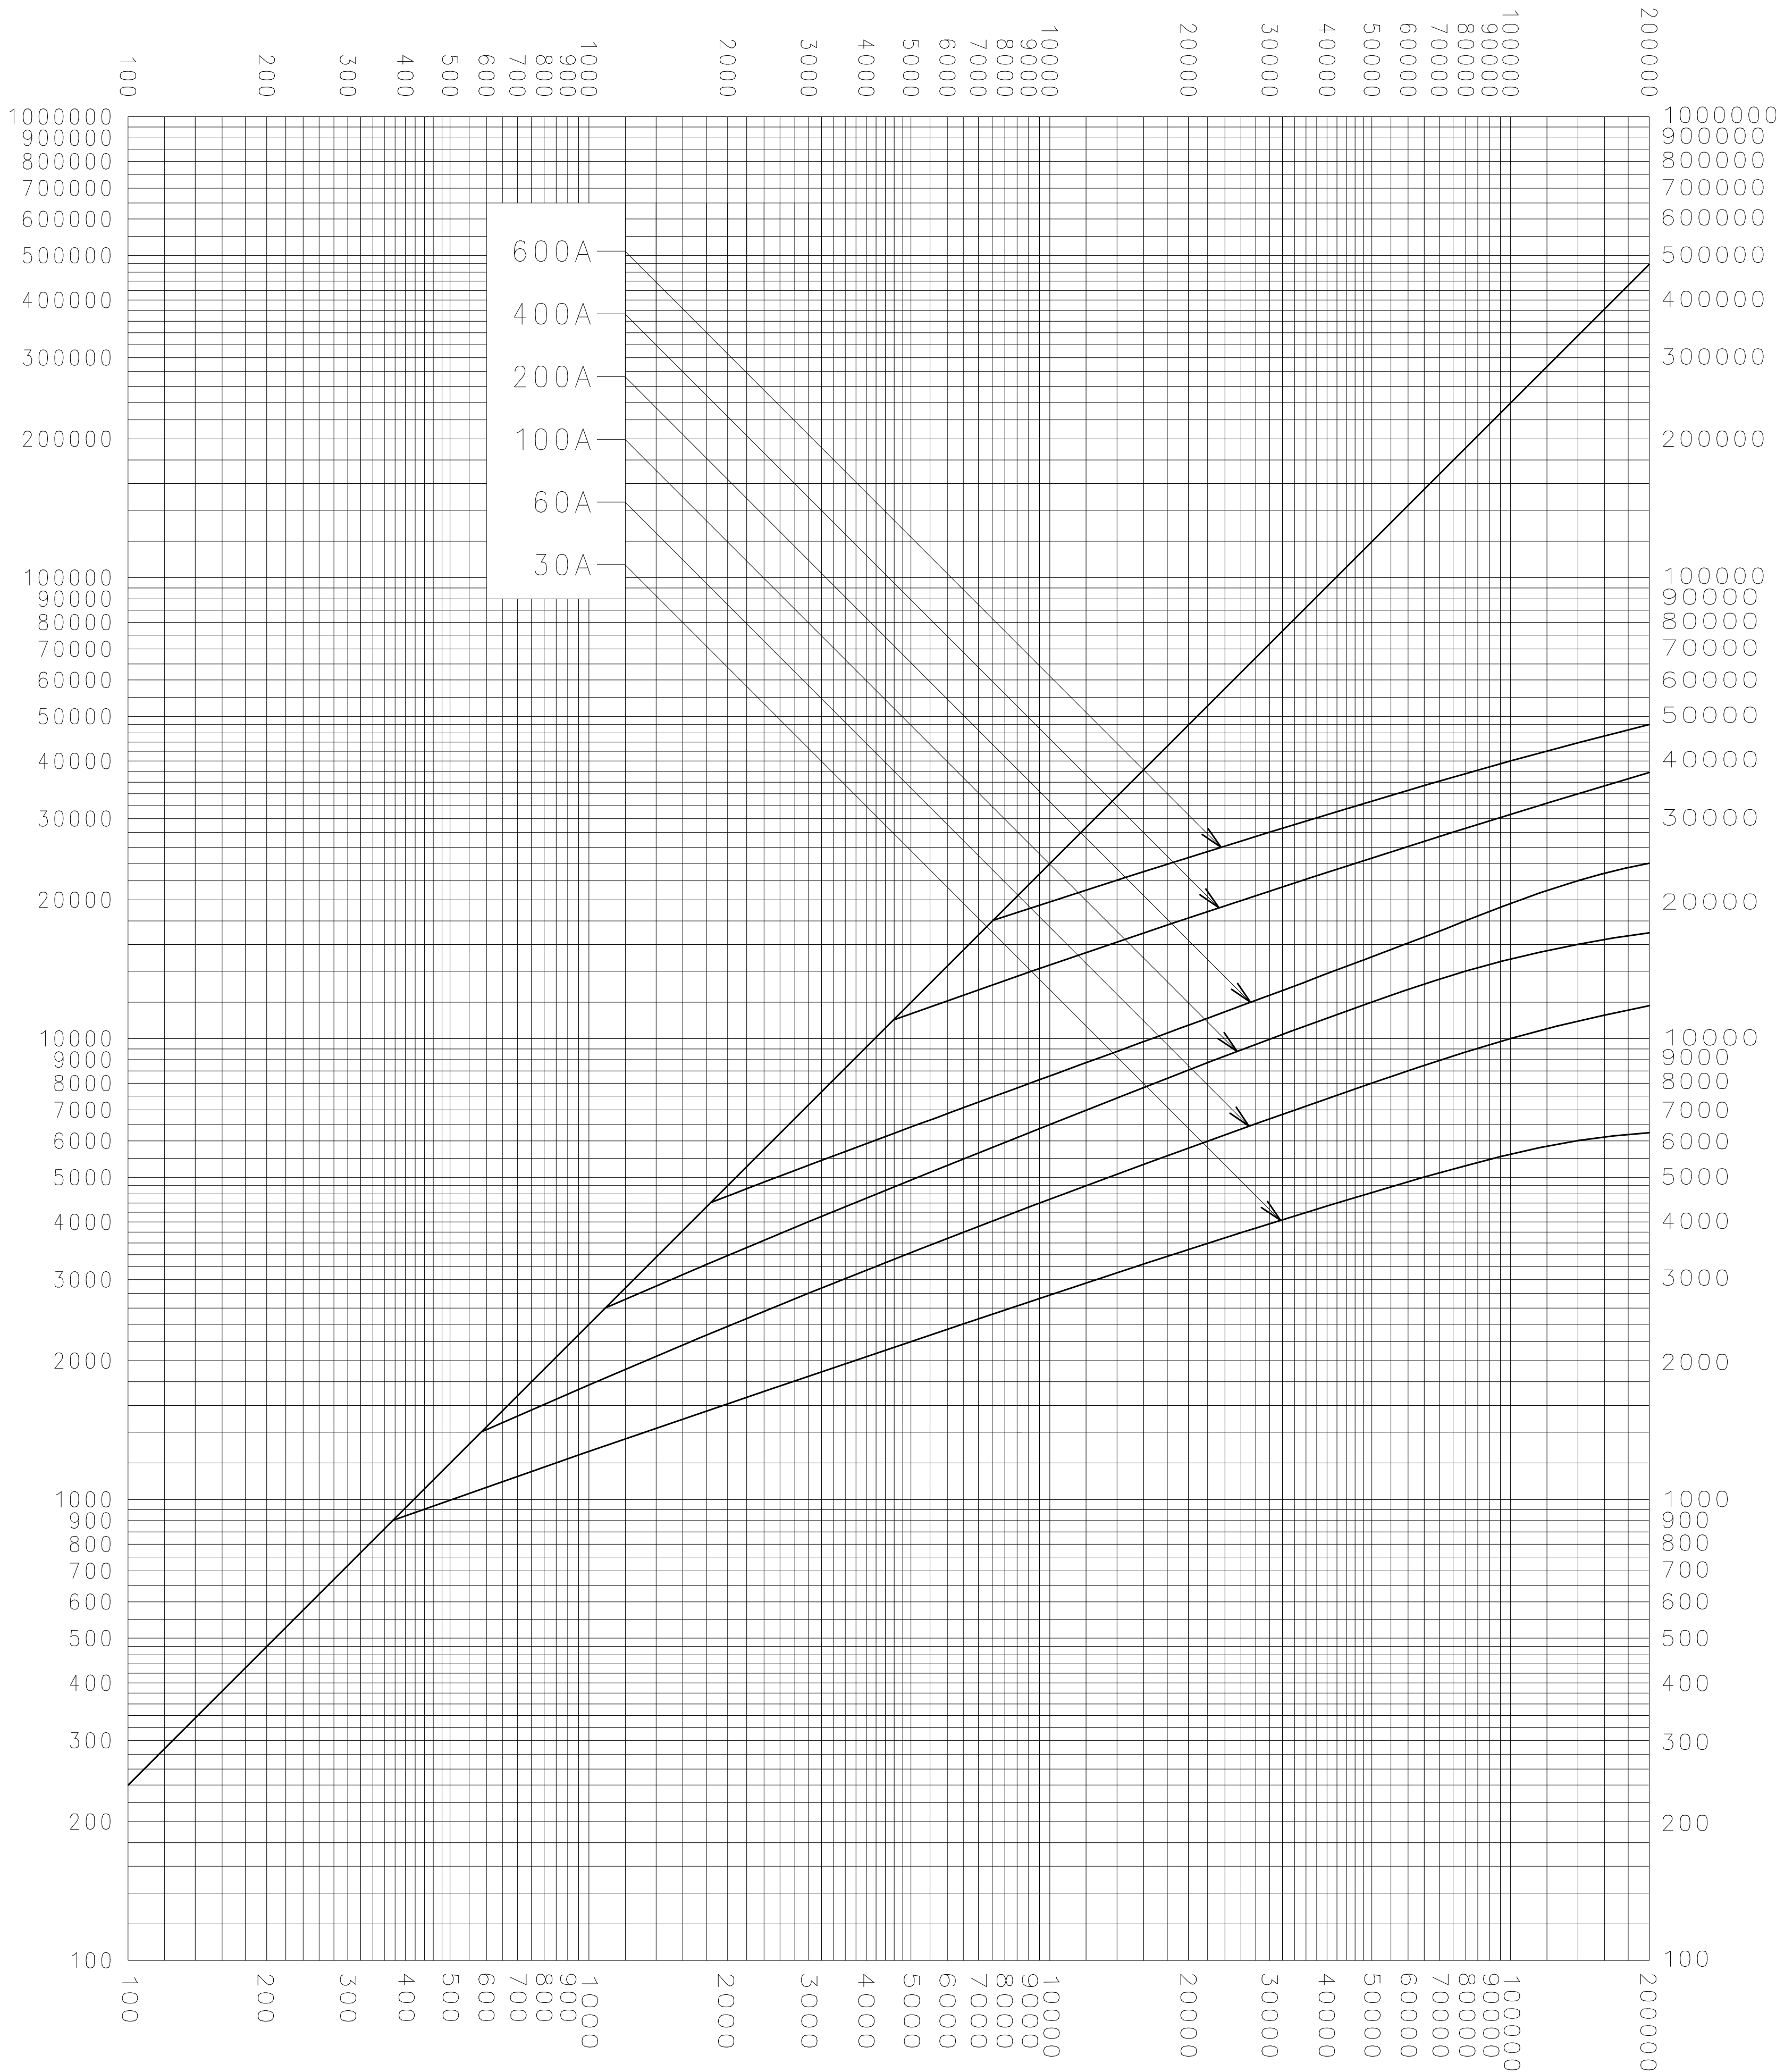

PEAK LET-THRU IN AMPERES

AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER LLNRK (30A - 600A)
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY LLL DATE 09/06/06 CHECKED BY MP
PEAK LET-THRU CHARACTERISTIC CURVES	DRAWING NO. A-FCC05-LLNRK-001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT