


CURRENT IN AMPERES

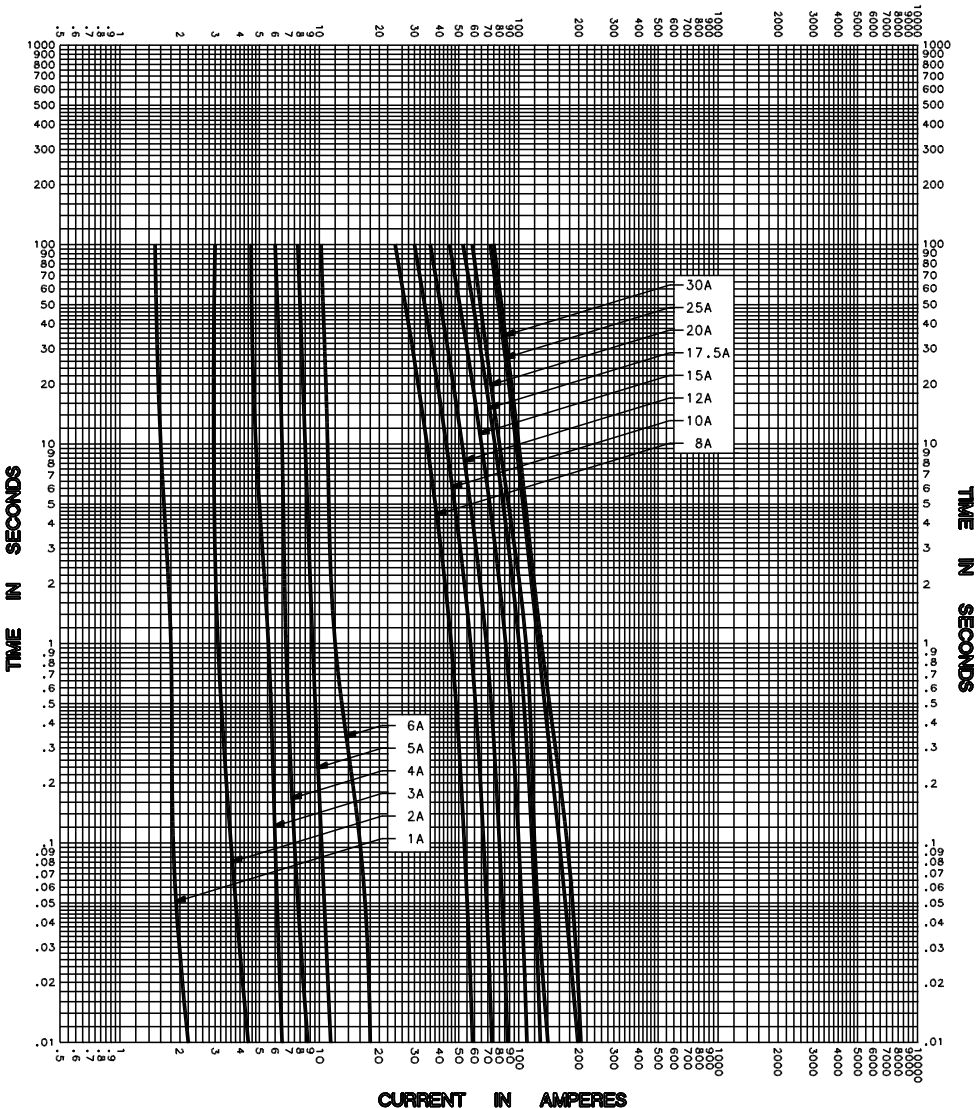

CURRENT IN AMPERES


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (1A - 30A)
BASIS FOR DATA _____		

 DES PLAINES, ILLINOIS 60016	DRAWN BY BJJ
	DATE 3/14/02
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY _____
	DRAWING NO. B - FCC01-0001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

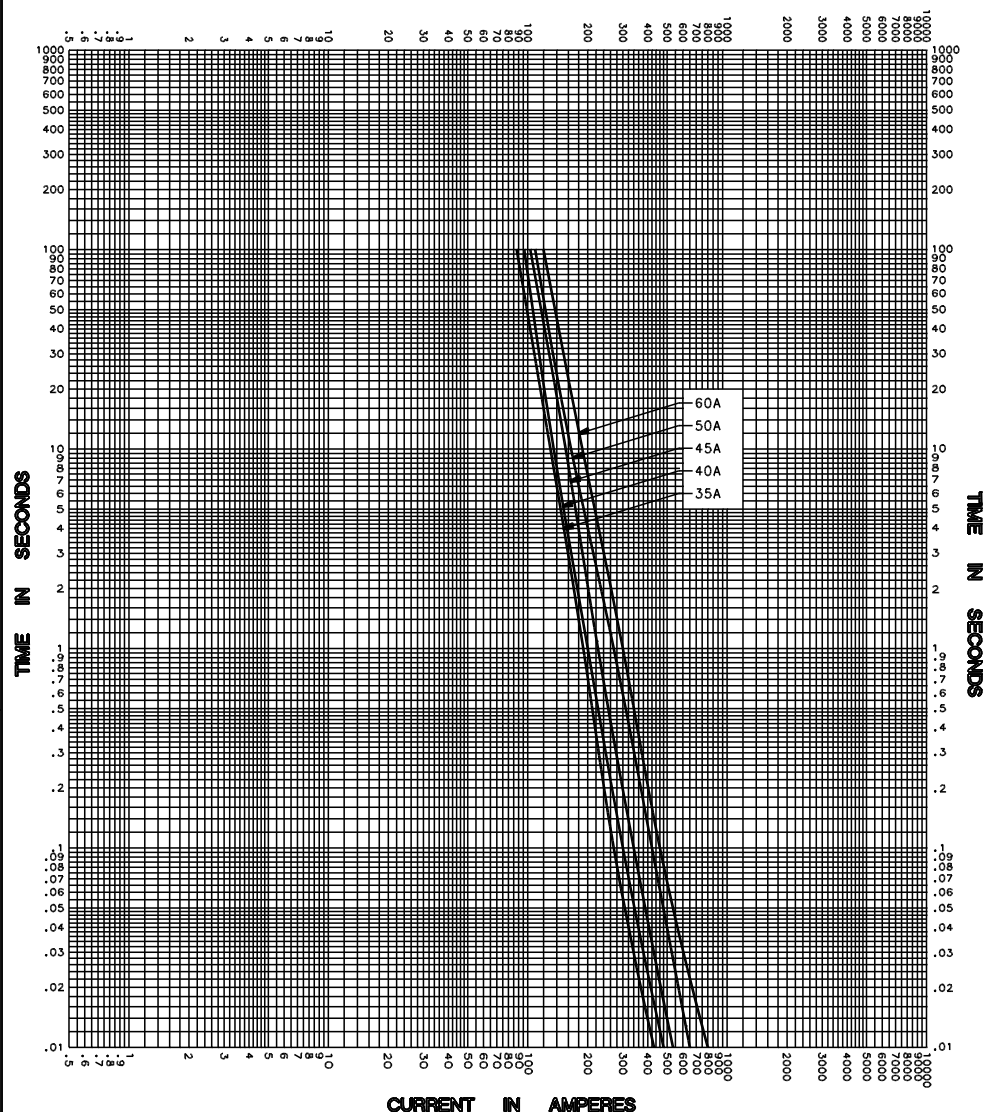


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (35A - 60A)
BASIS FOR DATA _____		

 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 08/16/04
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY MP
	DRAWING NO. A FCC01 08/16/04

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

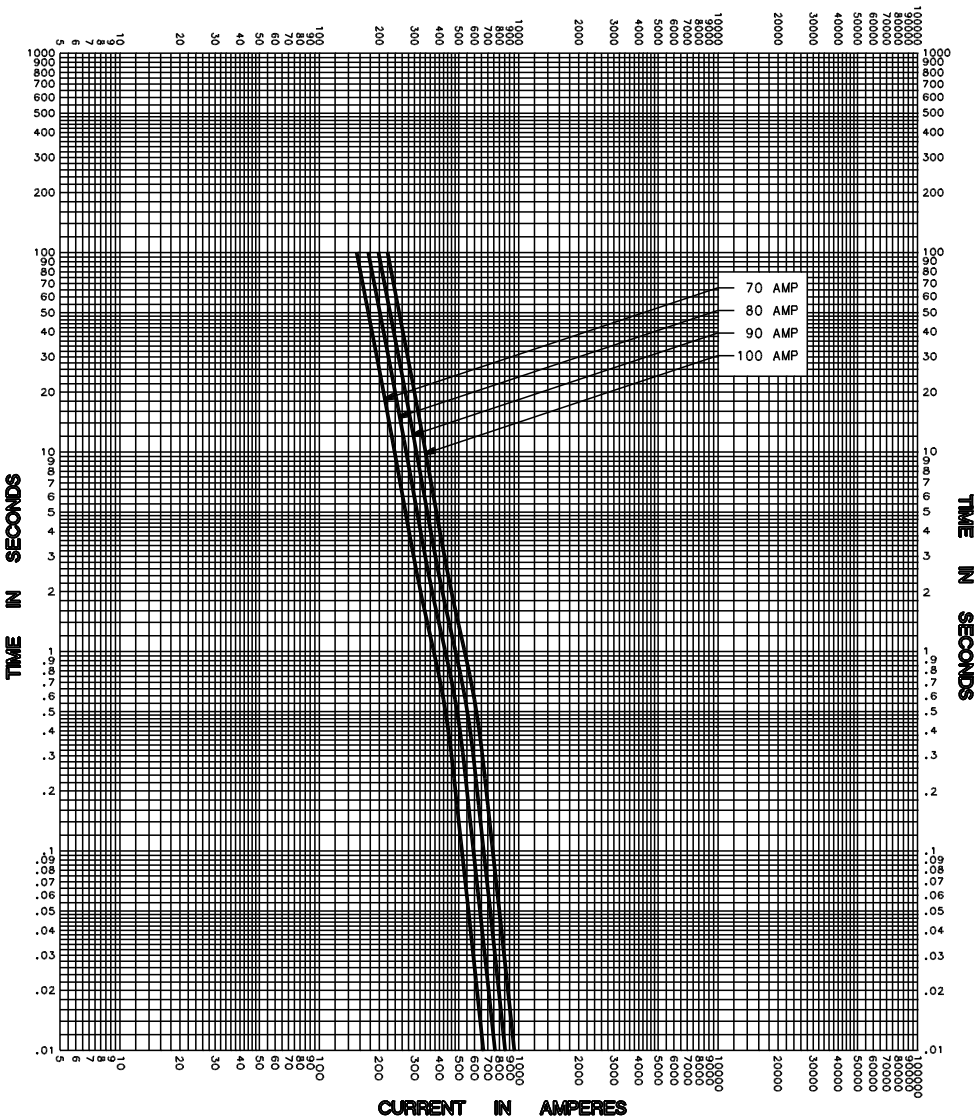


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (70A - 100A)
BASIS FOR DATA _____		

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY MRD
	DATE 02/19/03
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY TN
	DRAWING NO. B-FCC003

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

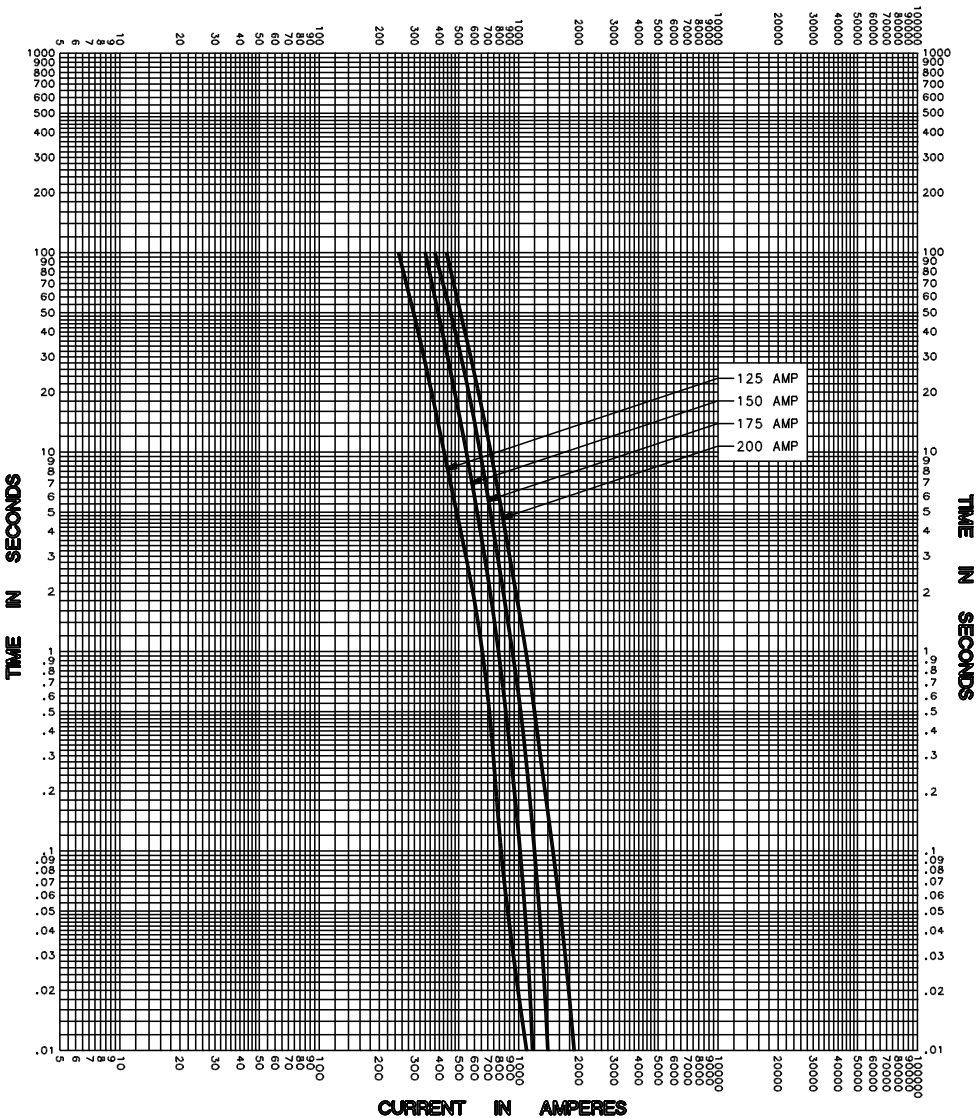


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (125A - 200A)
BASIS FOR DATA _____	
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>08/16/04</u> CHECKED BY <u>MP</u>
	TIME CURRENT CHARACTERISTIC CURVES DRAWING NO. <u>A-FCC004</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

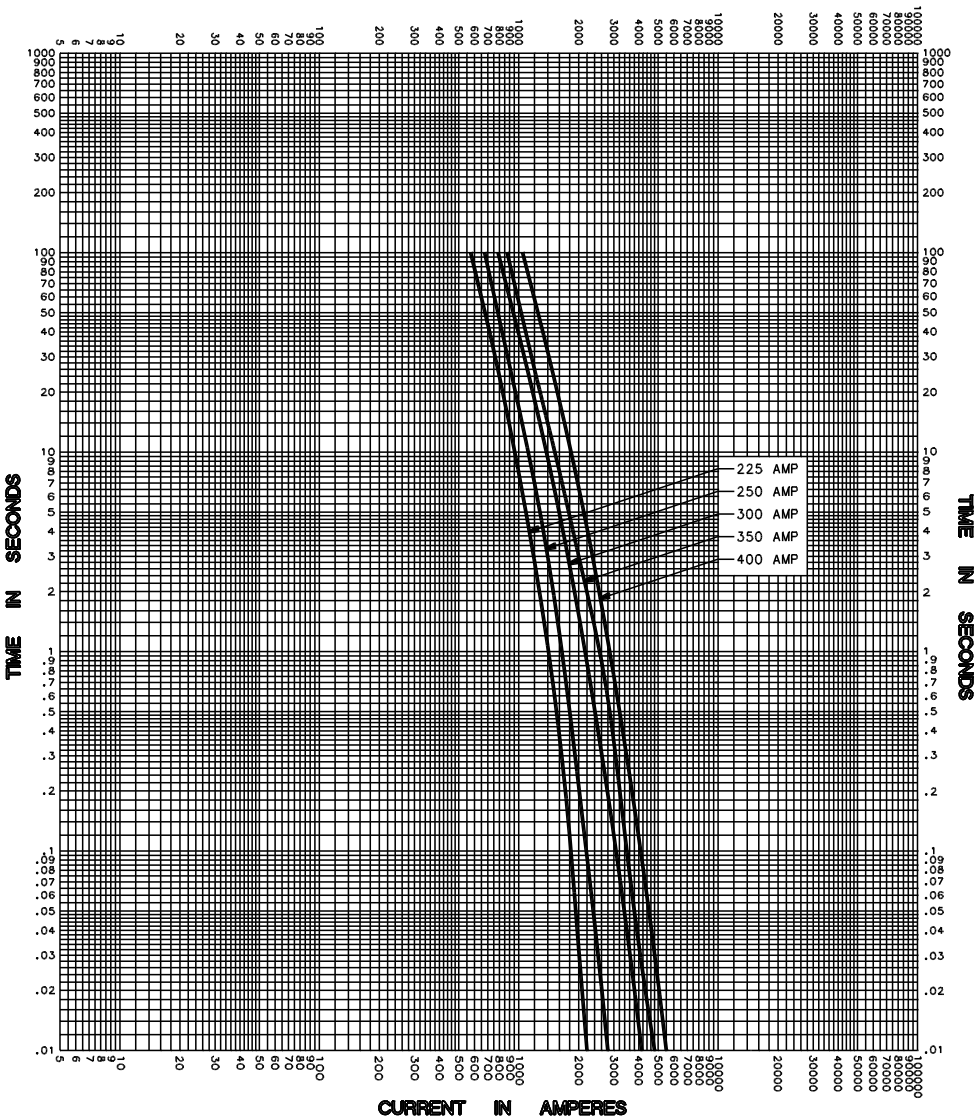

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
L60S (225A - 400A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 08/16/04
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC005

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

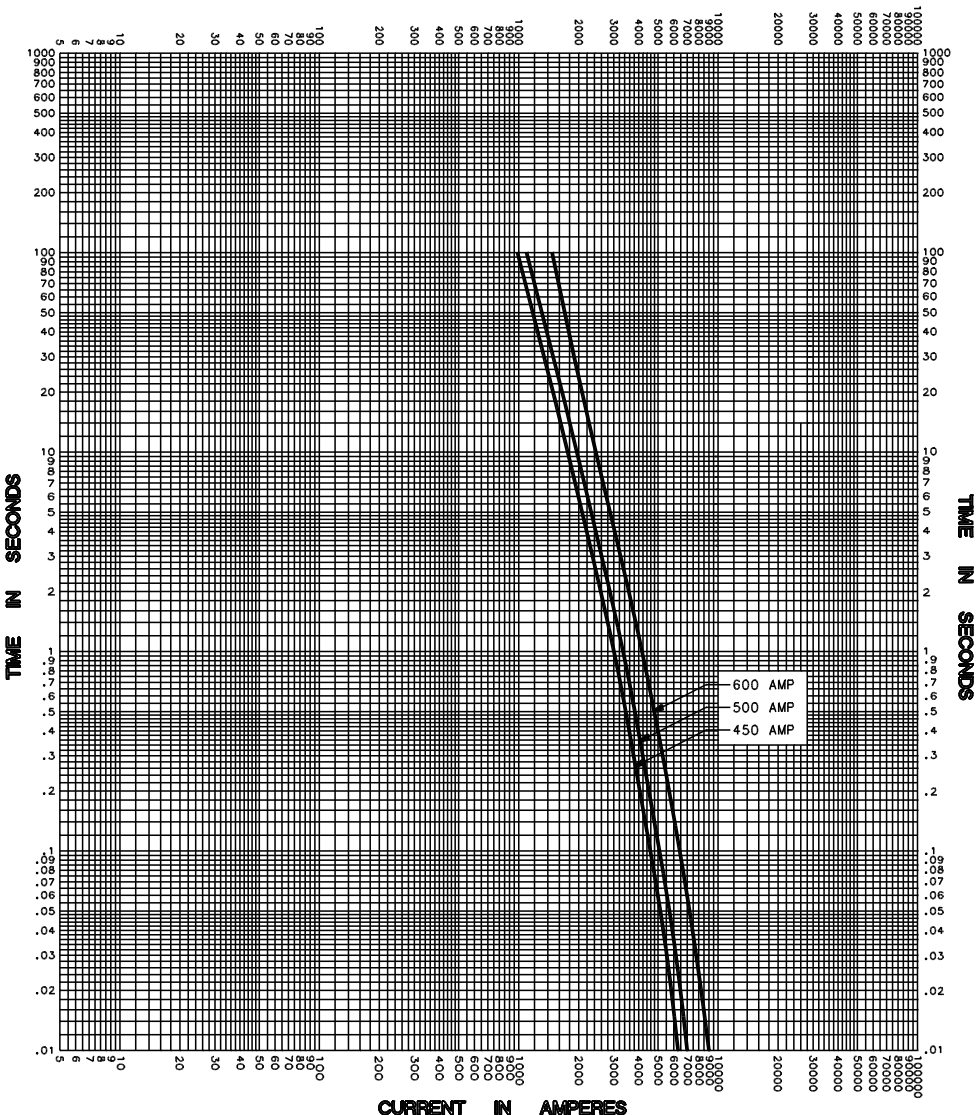

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (450A - 600A)
BASIS FOR DATA _____		


 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>08/16/04</u> CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC006</u>

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

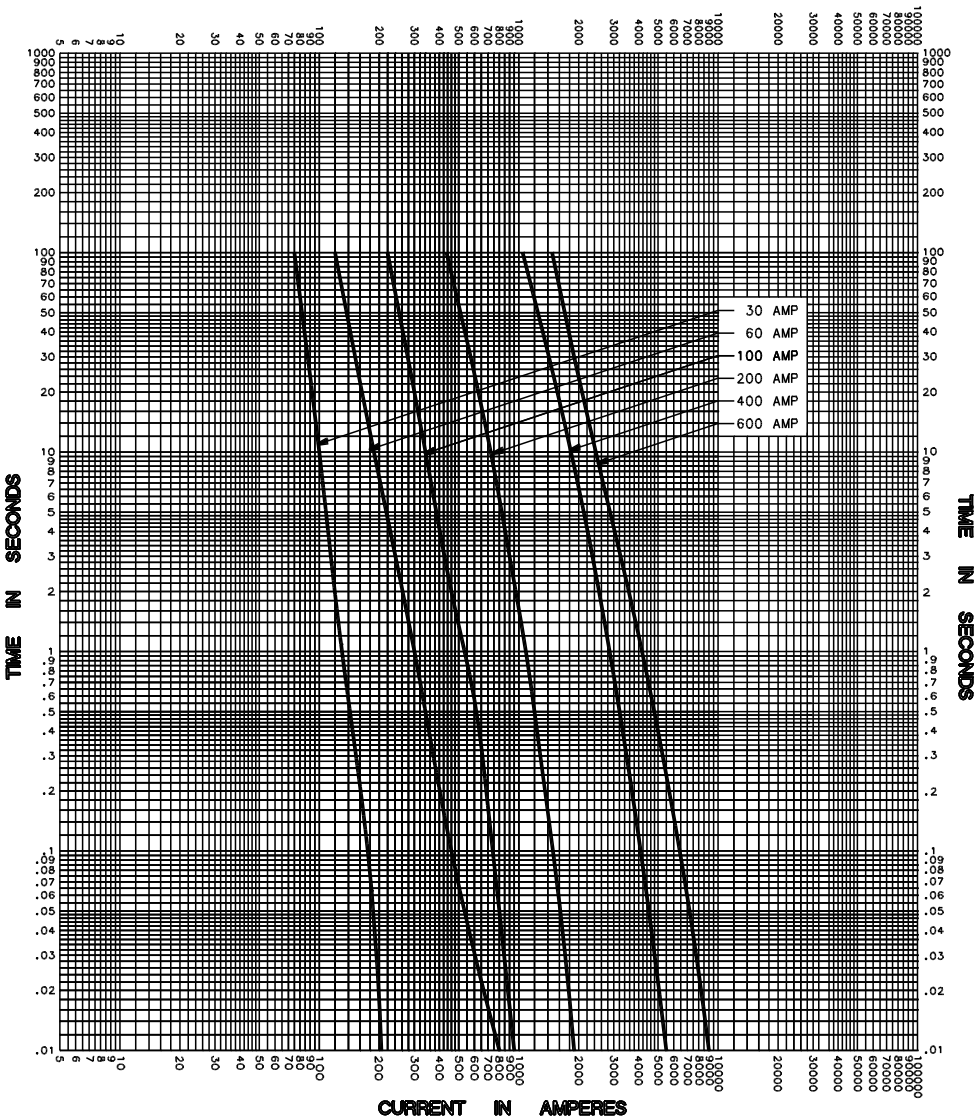

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (30A - 600A)
BASIS FOR DATA _____		



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 08/16/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC008

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT