


TIME IN SECONDS



TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
SLC (1/2A - 8A)

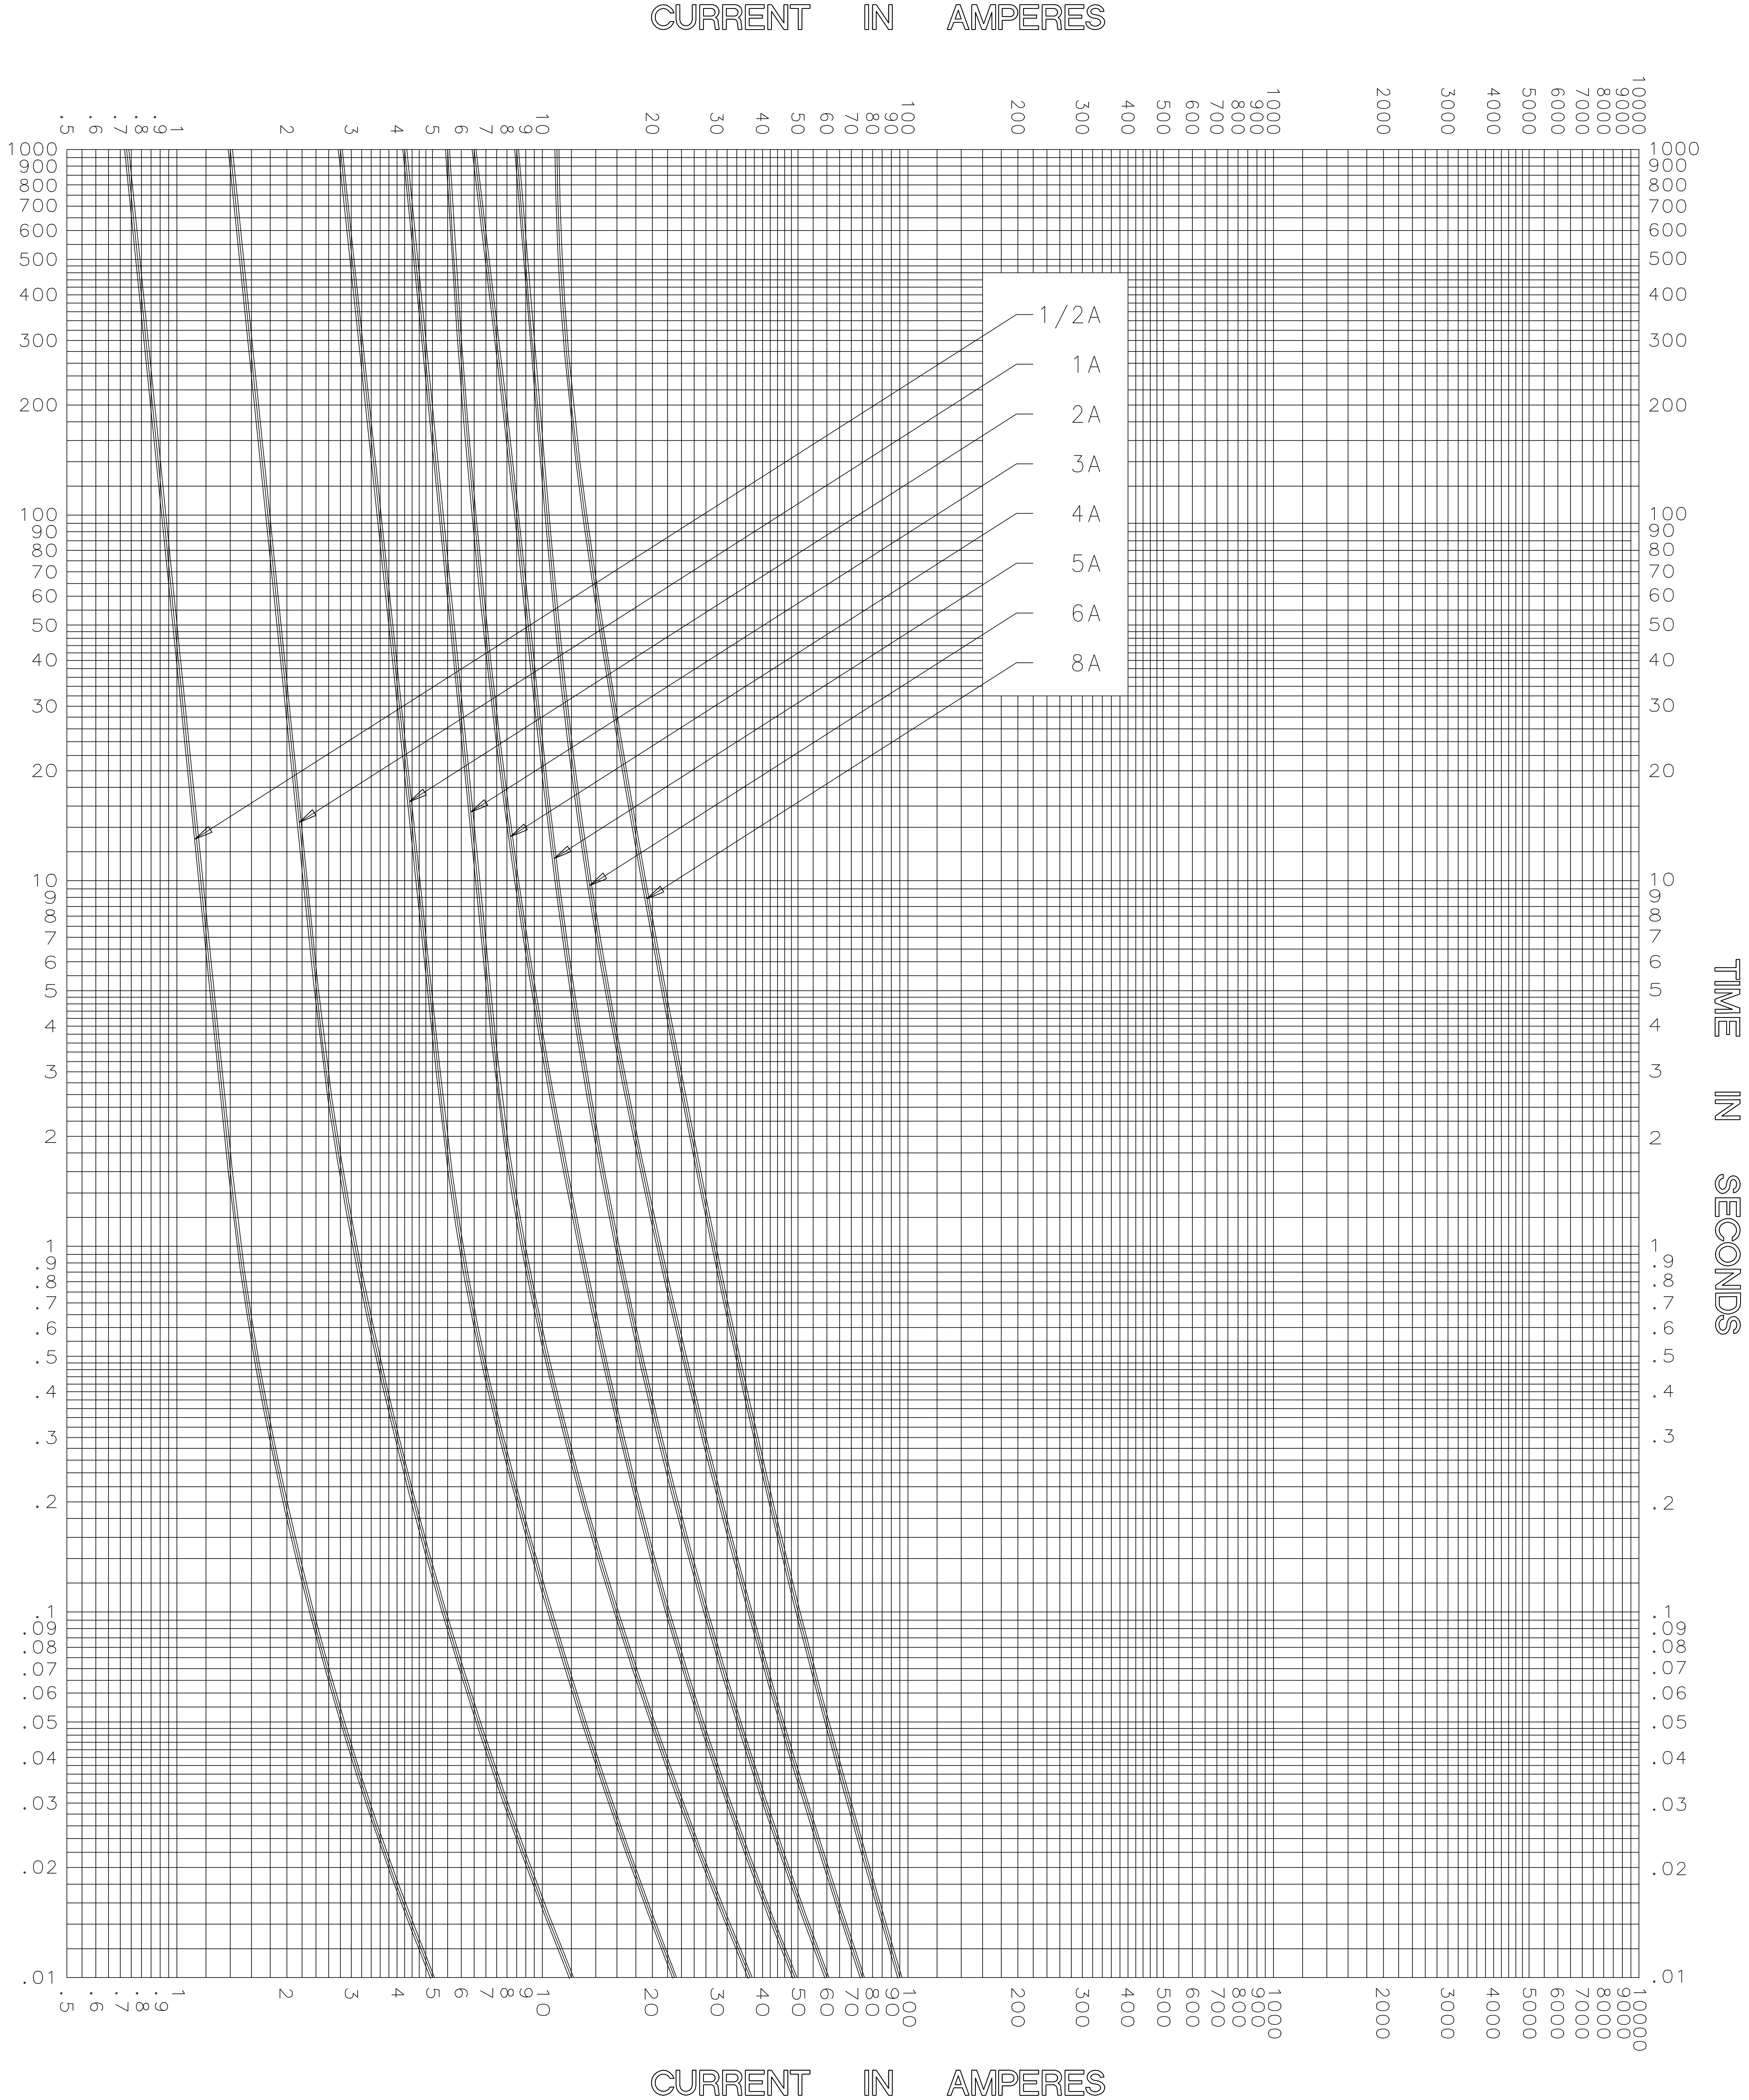

LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY MRD
DATE 02/17/03
CHECKED BY TN


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. B-FCC03C01

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

TIME IN SECONDS

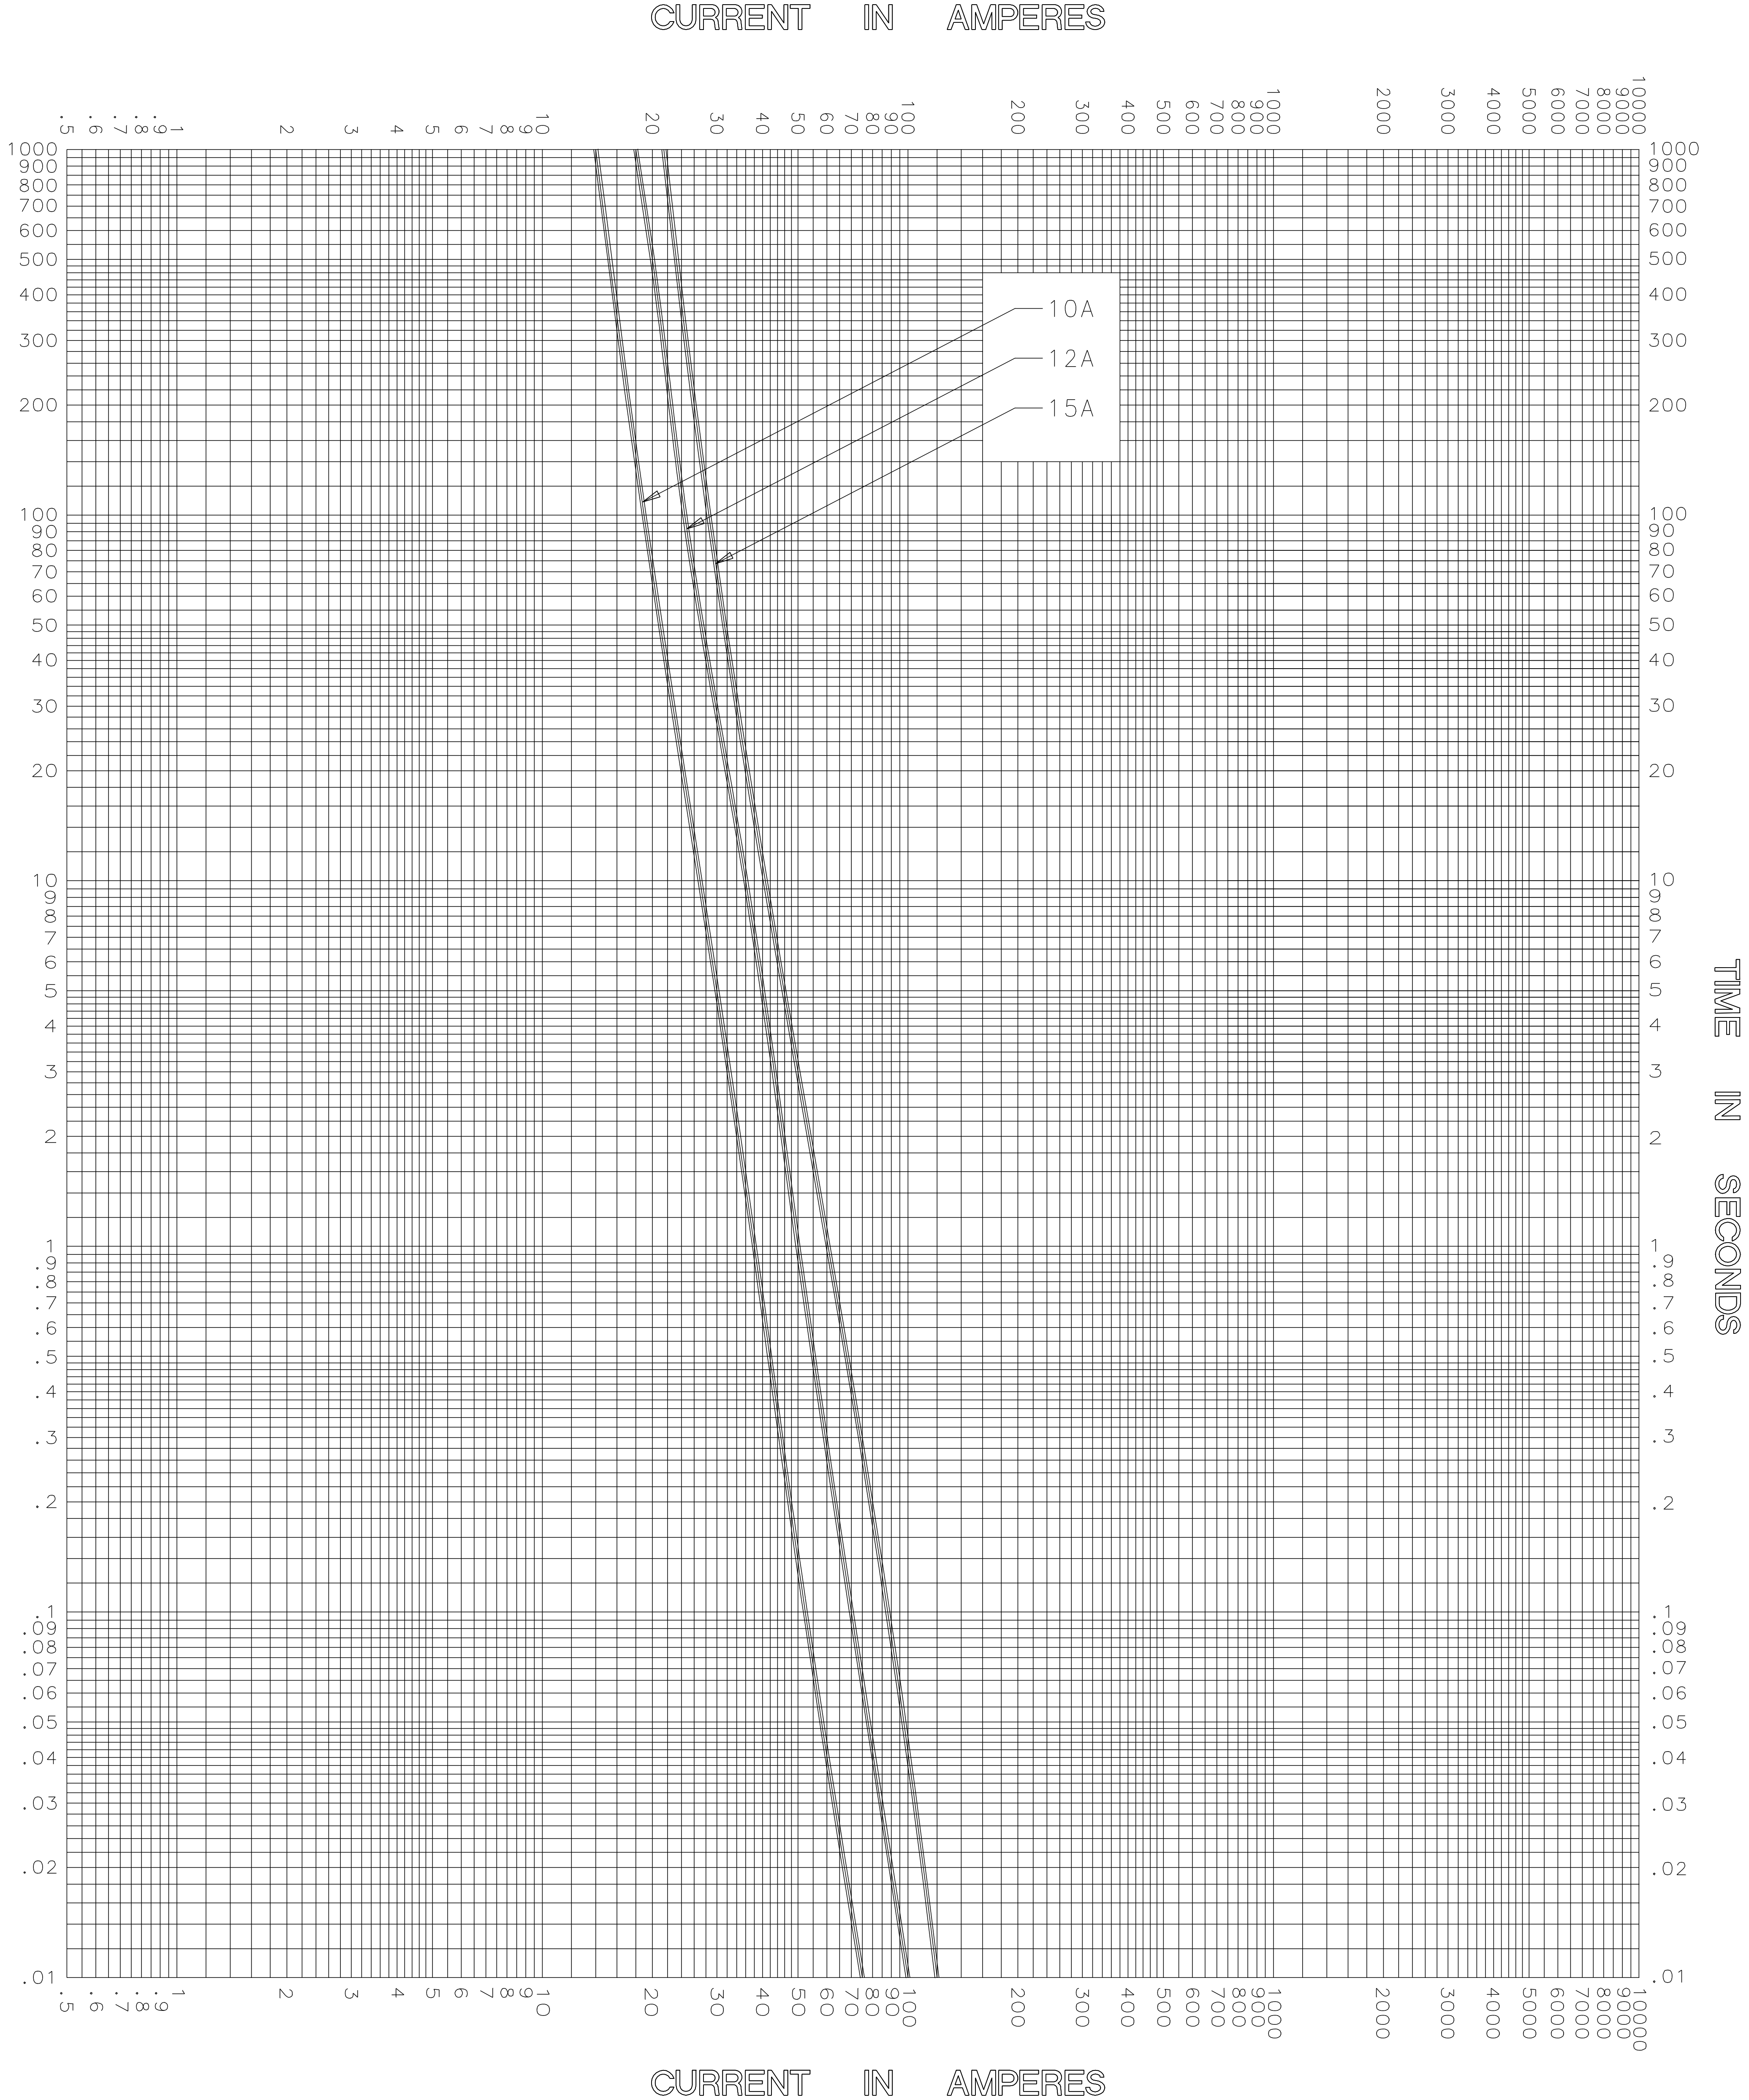

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
SLC (10A - 15A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 04/28/05
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC0 SLC 02

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

TIME IN SECONDS

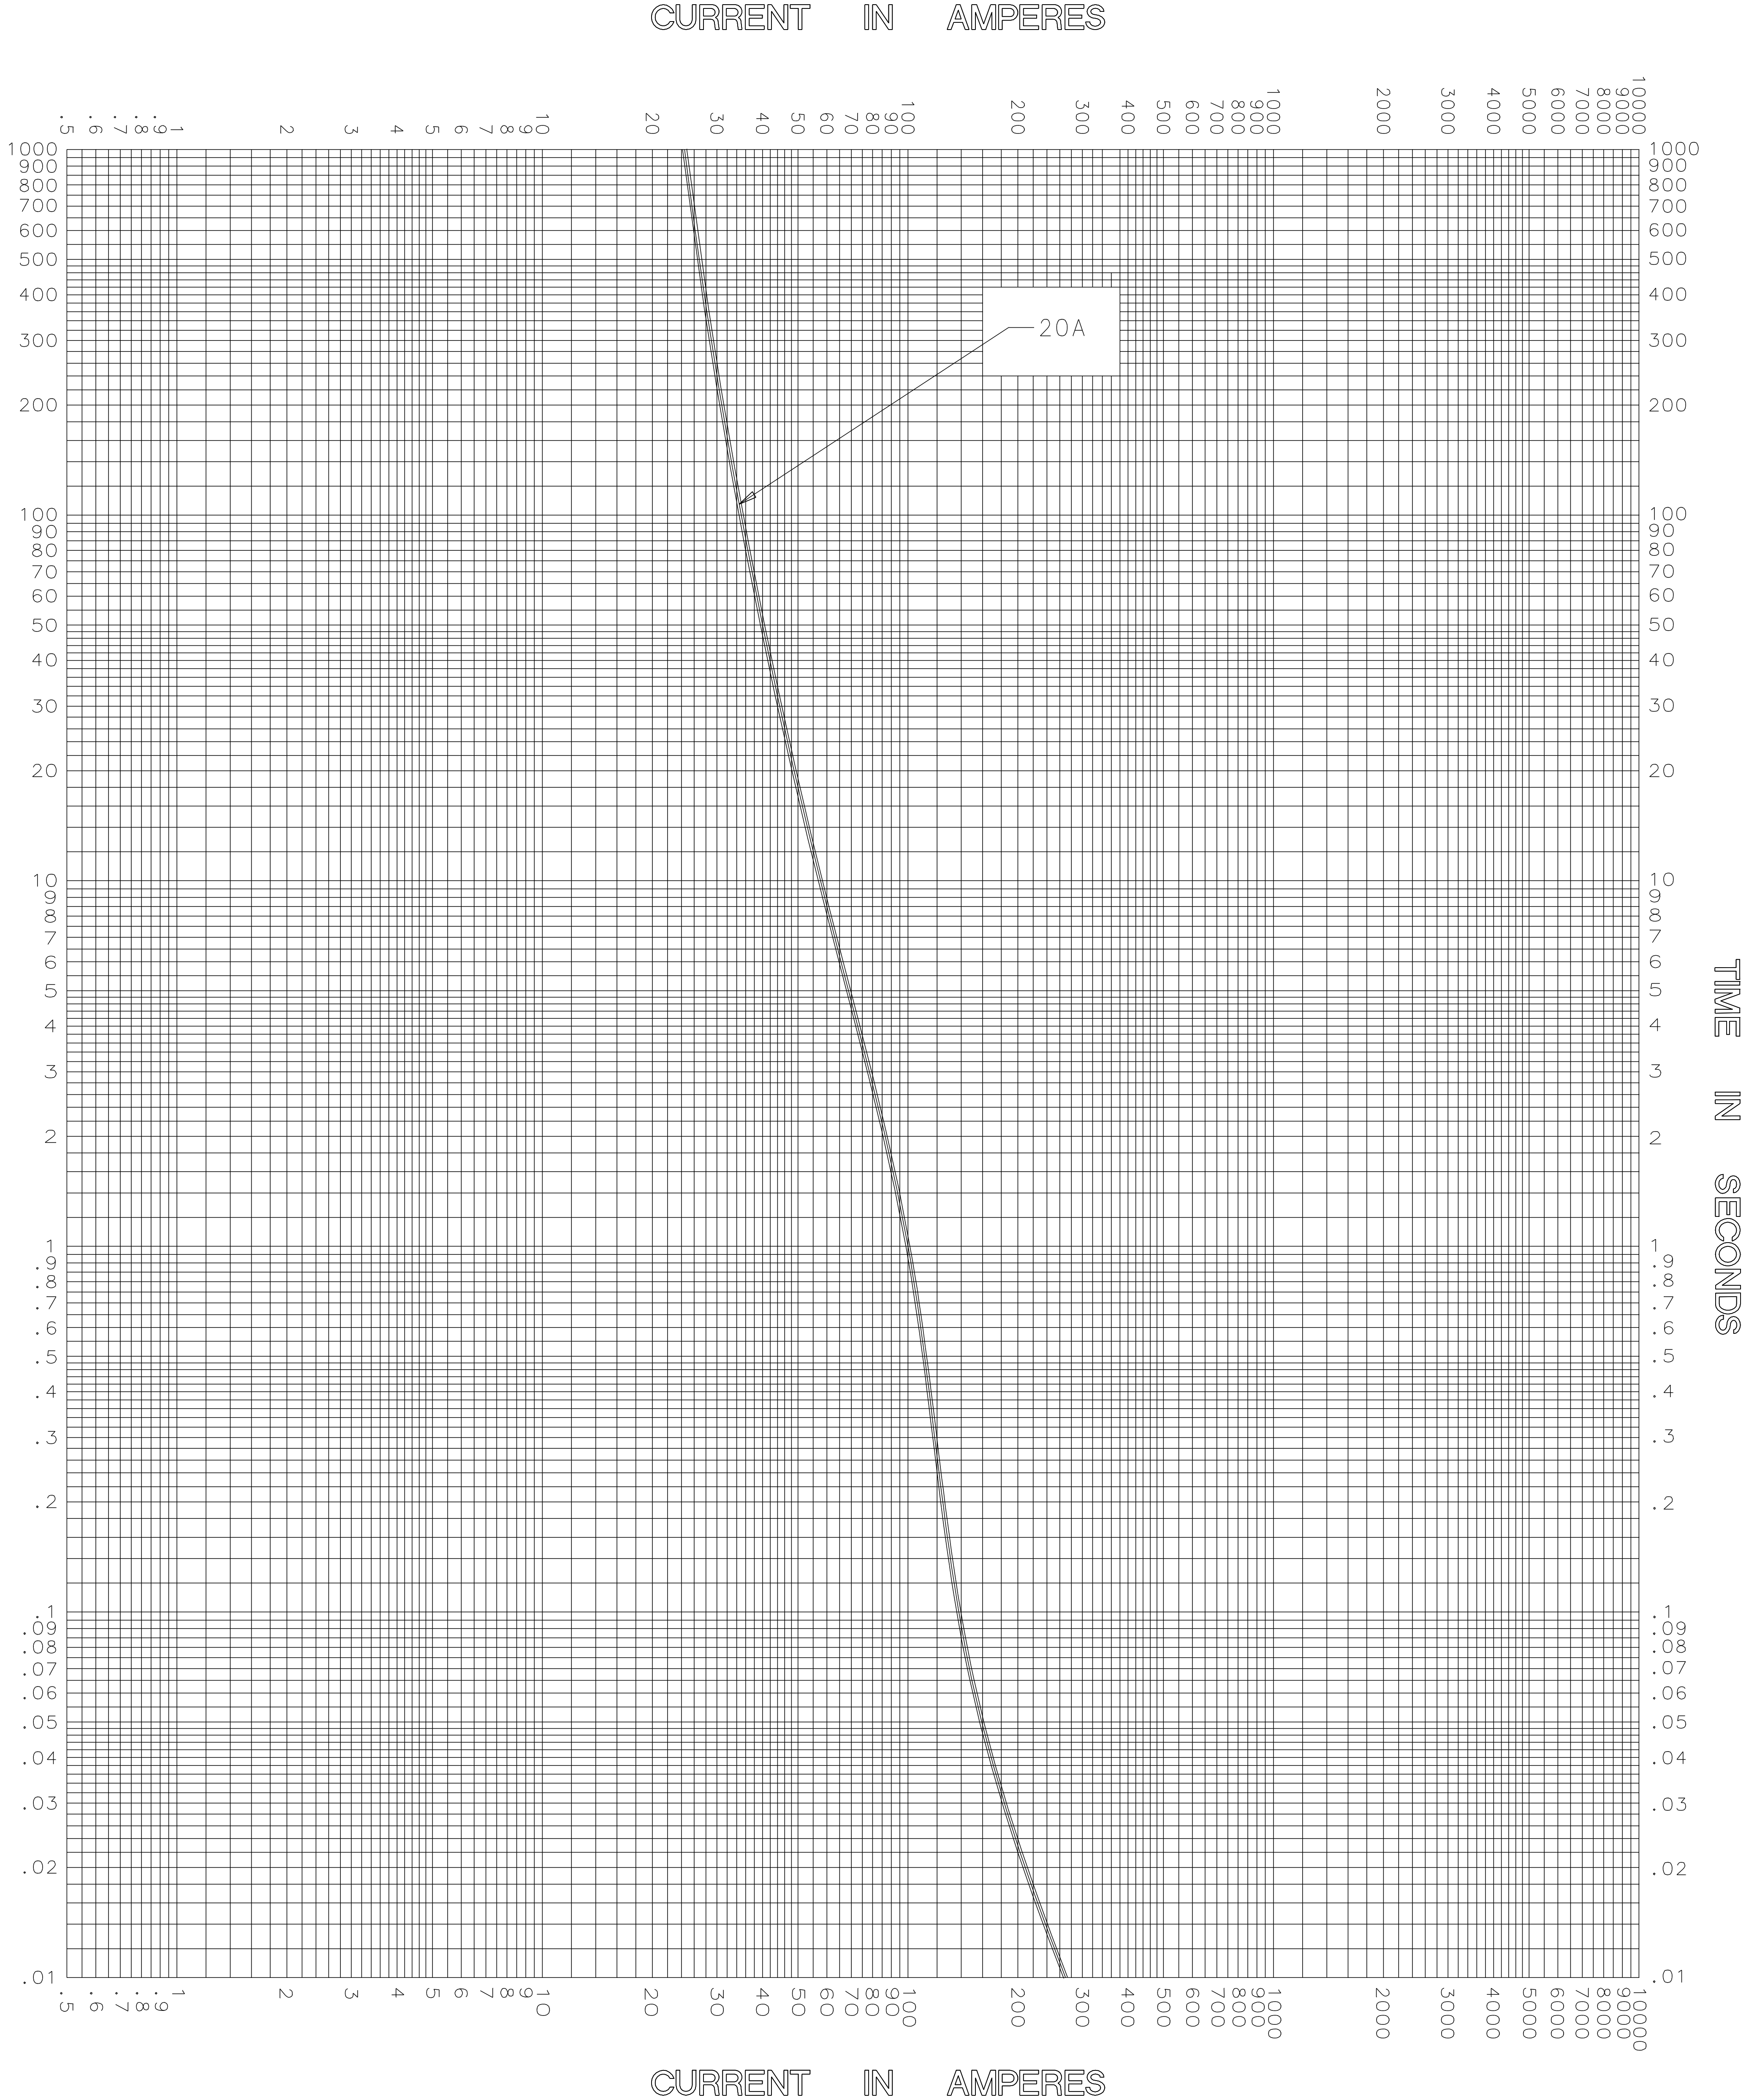

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
SLC (20A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 04/28/05
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC0 SLC 20A 03

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

TIME IN SECONDS

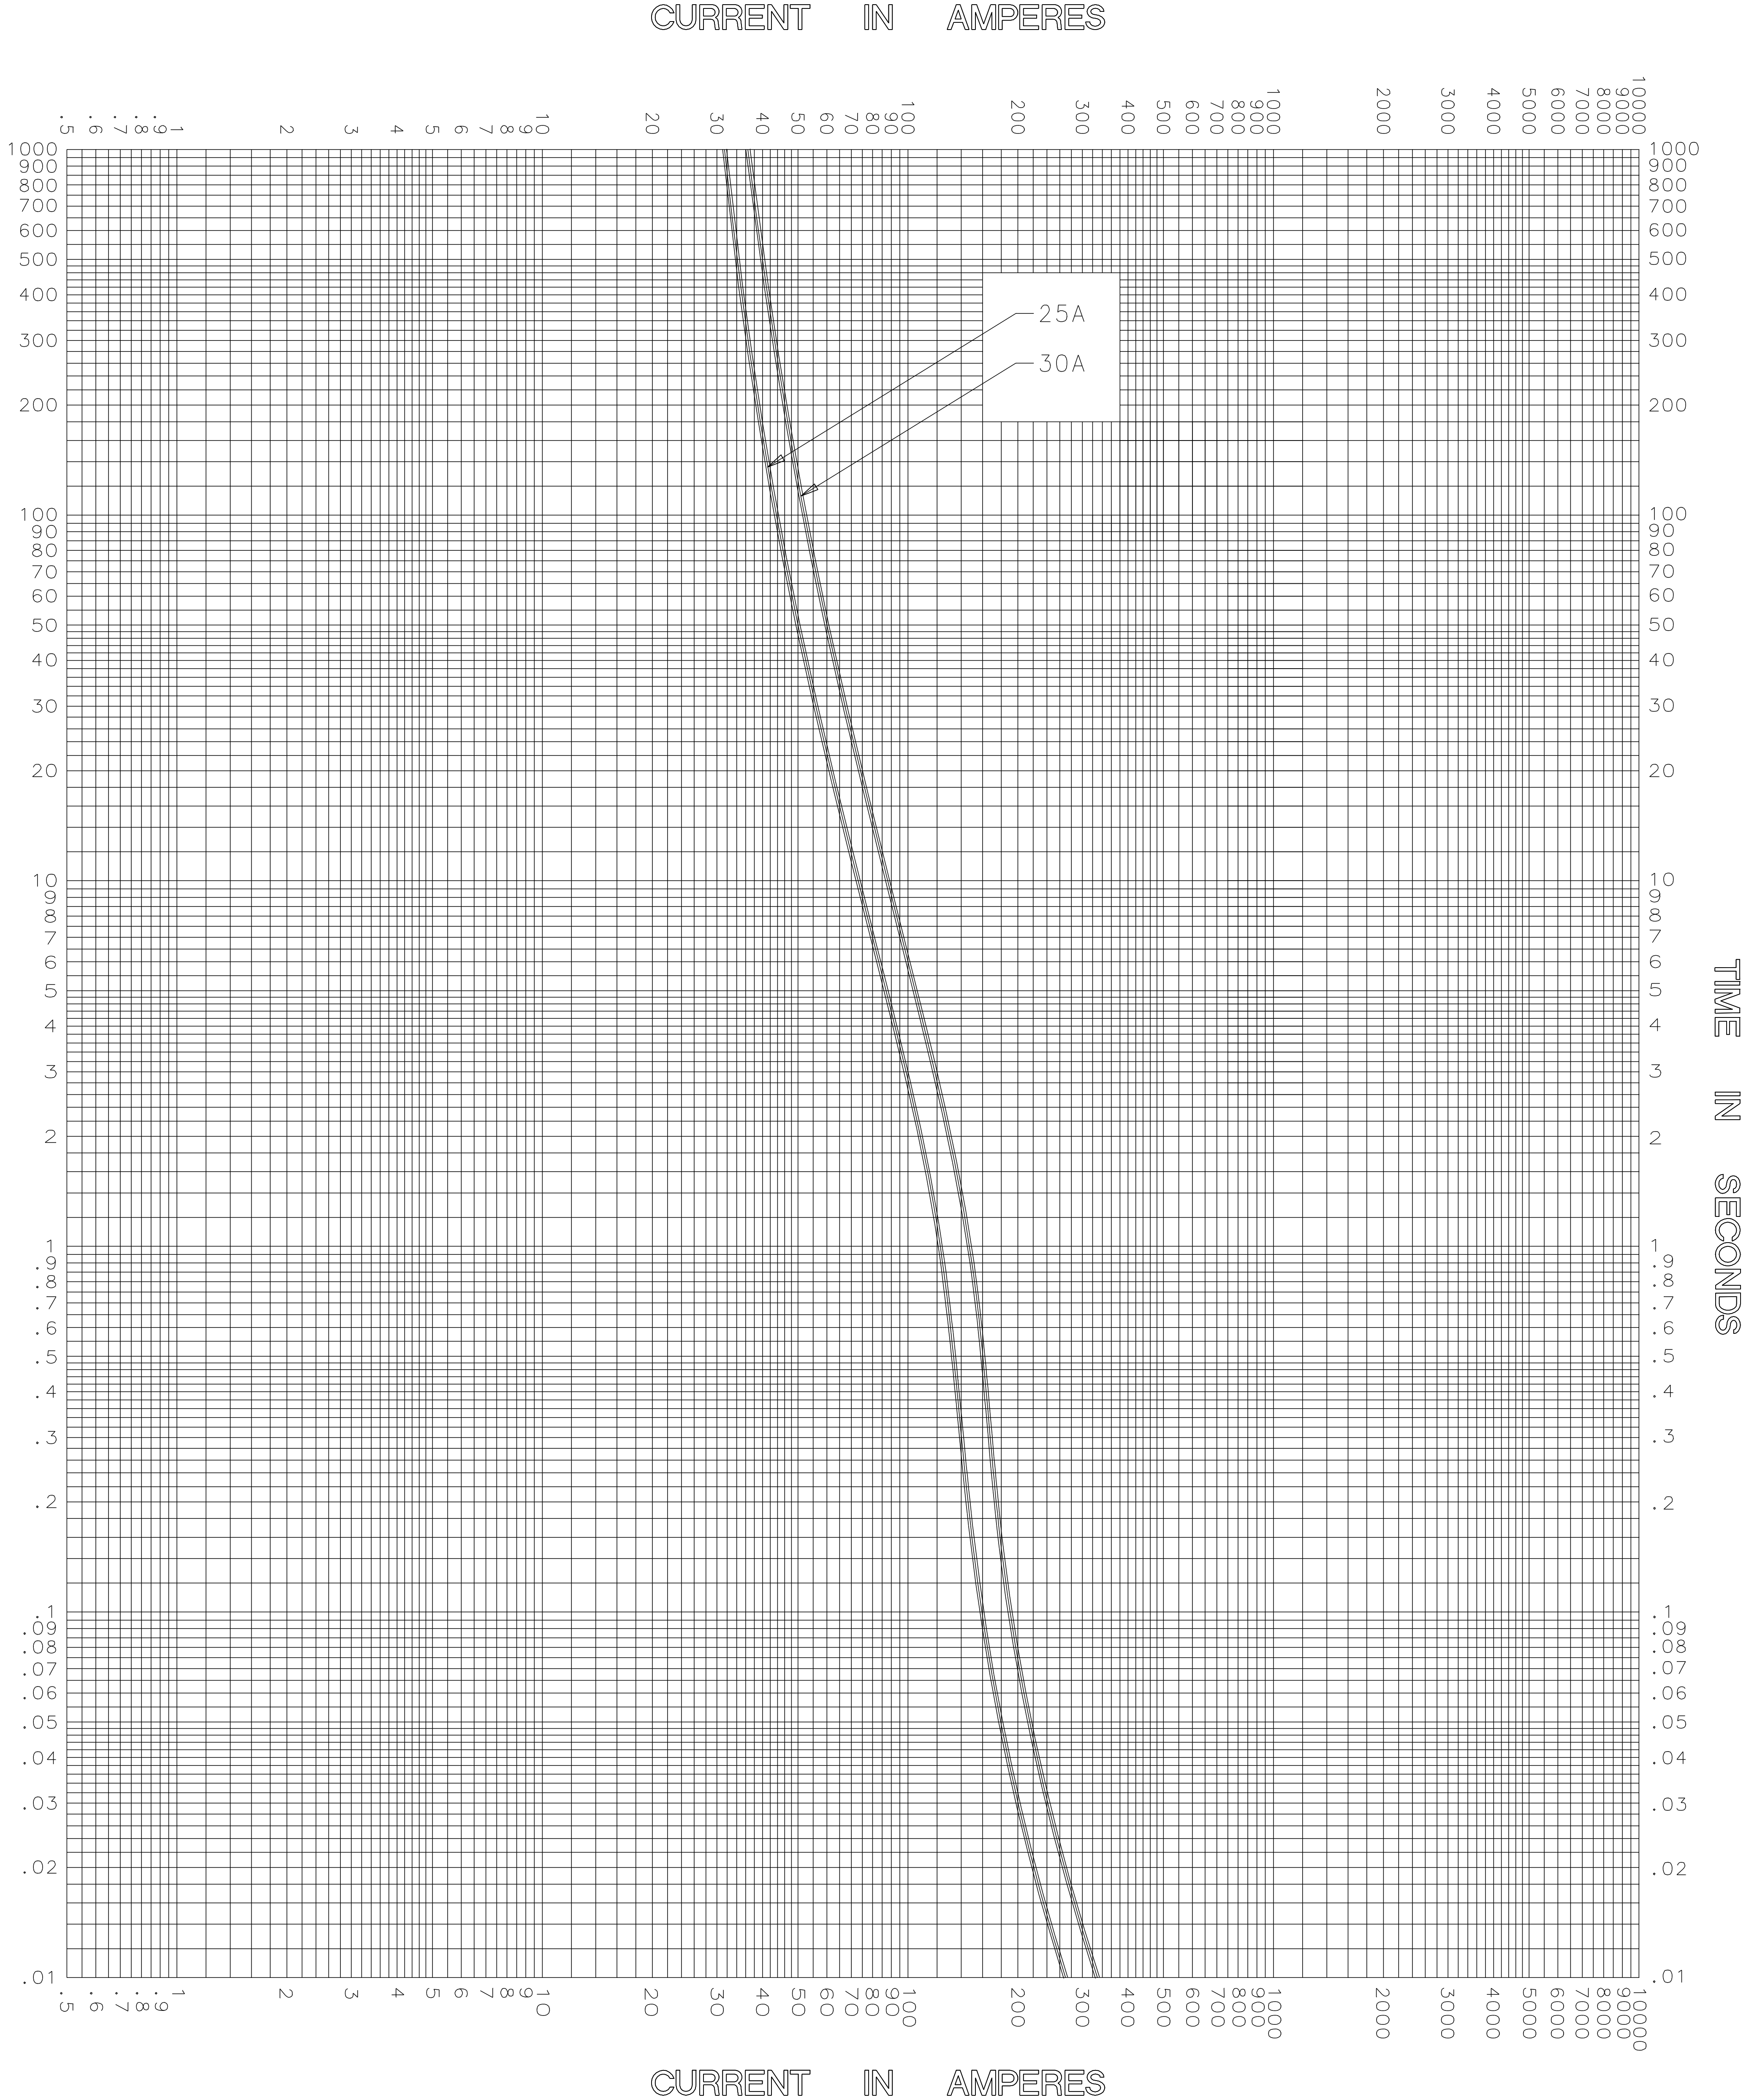

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
SLC (25A - 30A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 04/28/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC0 SLC 04

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

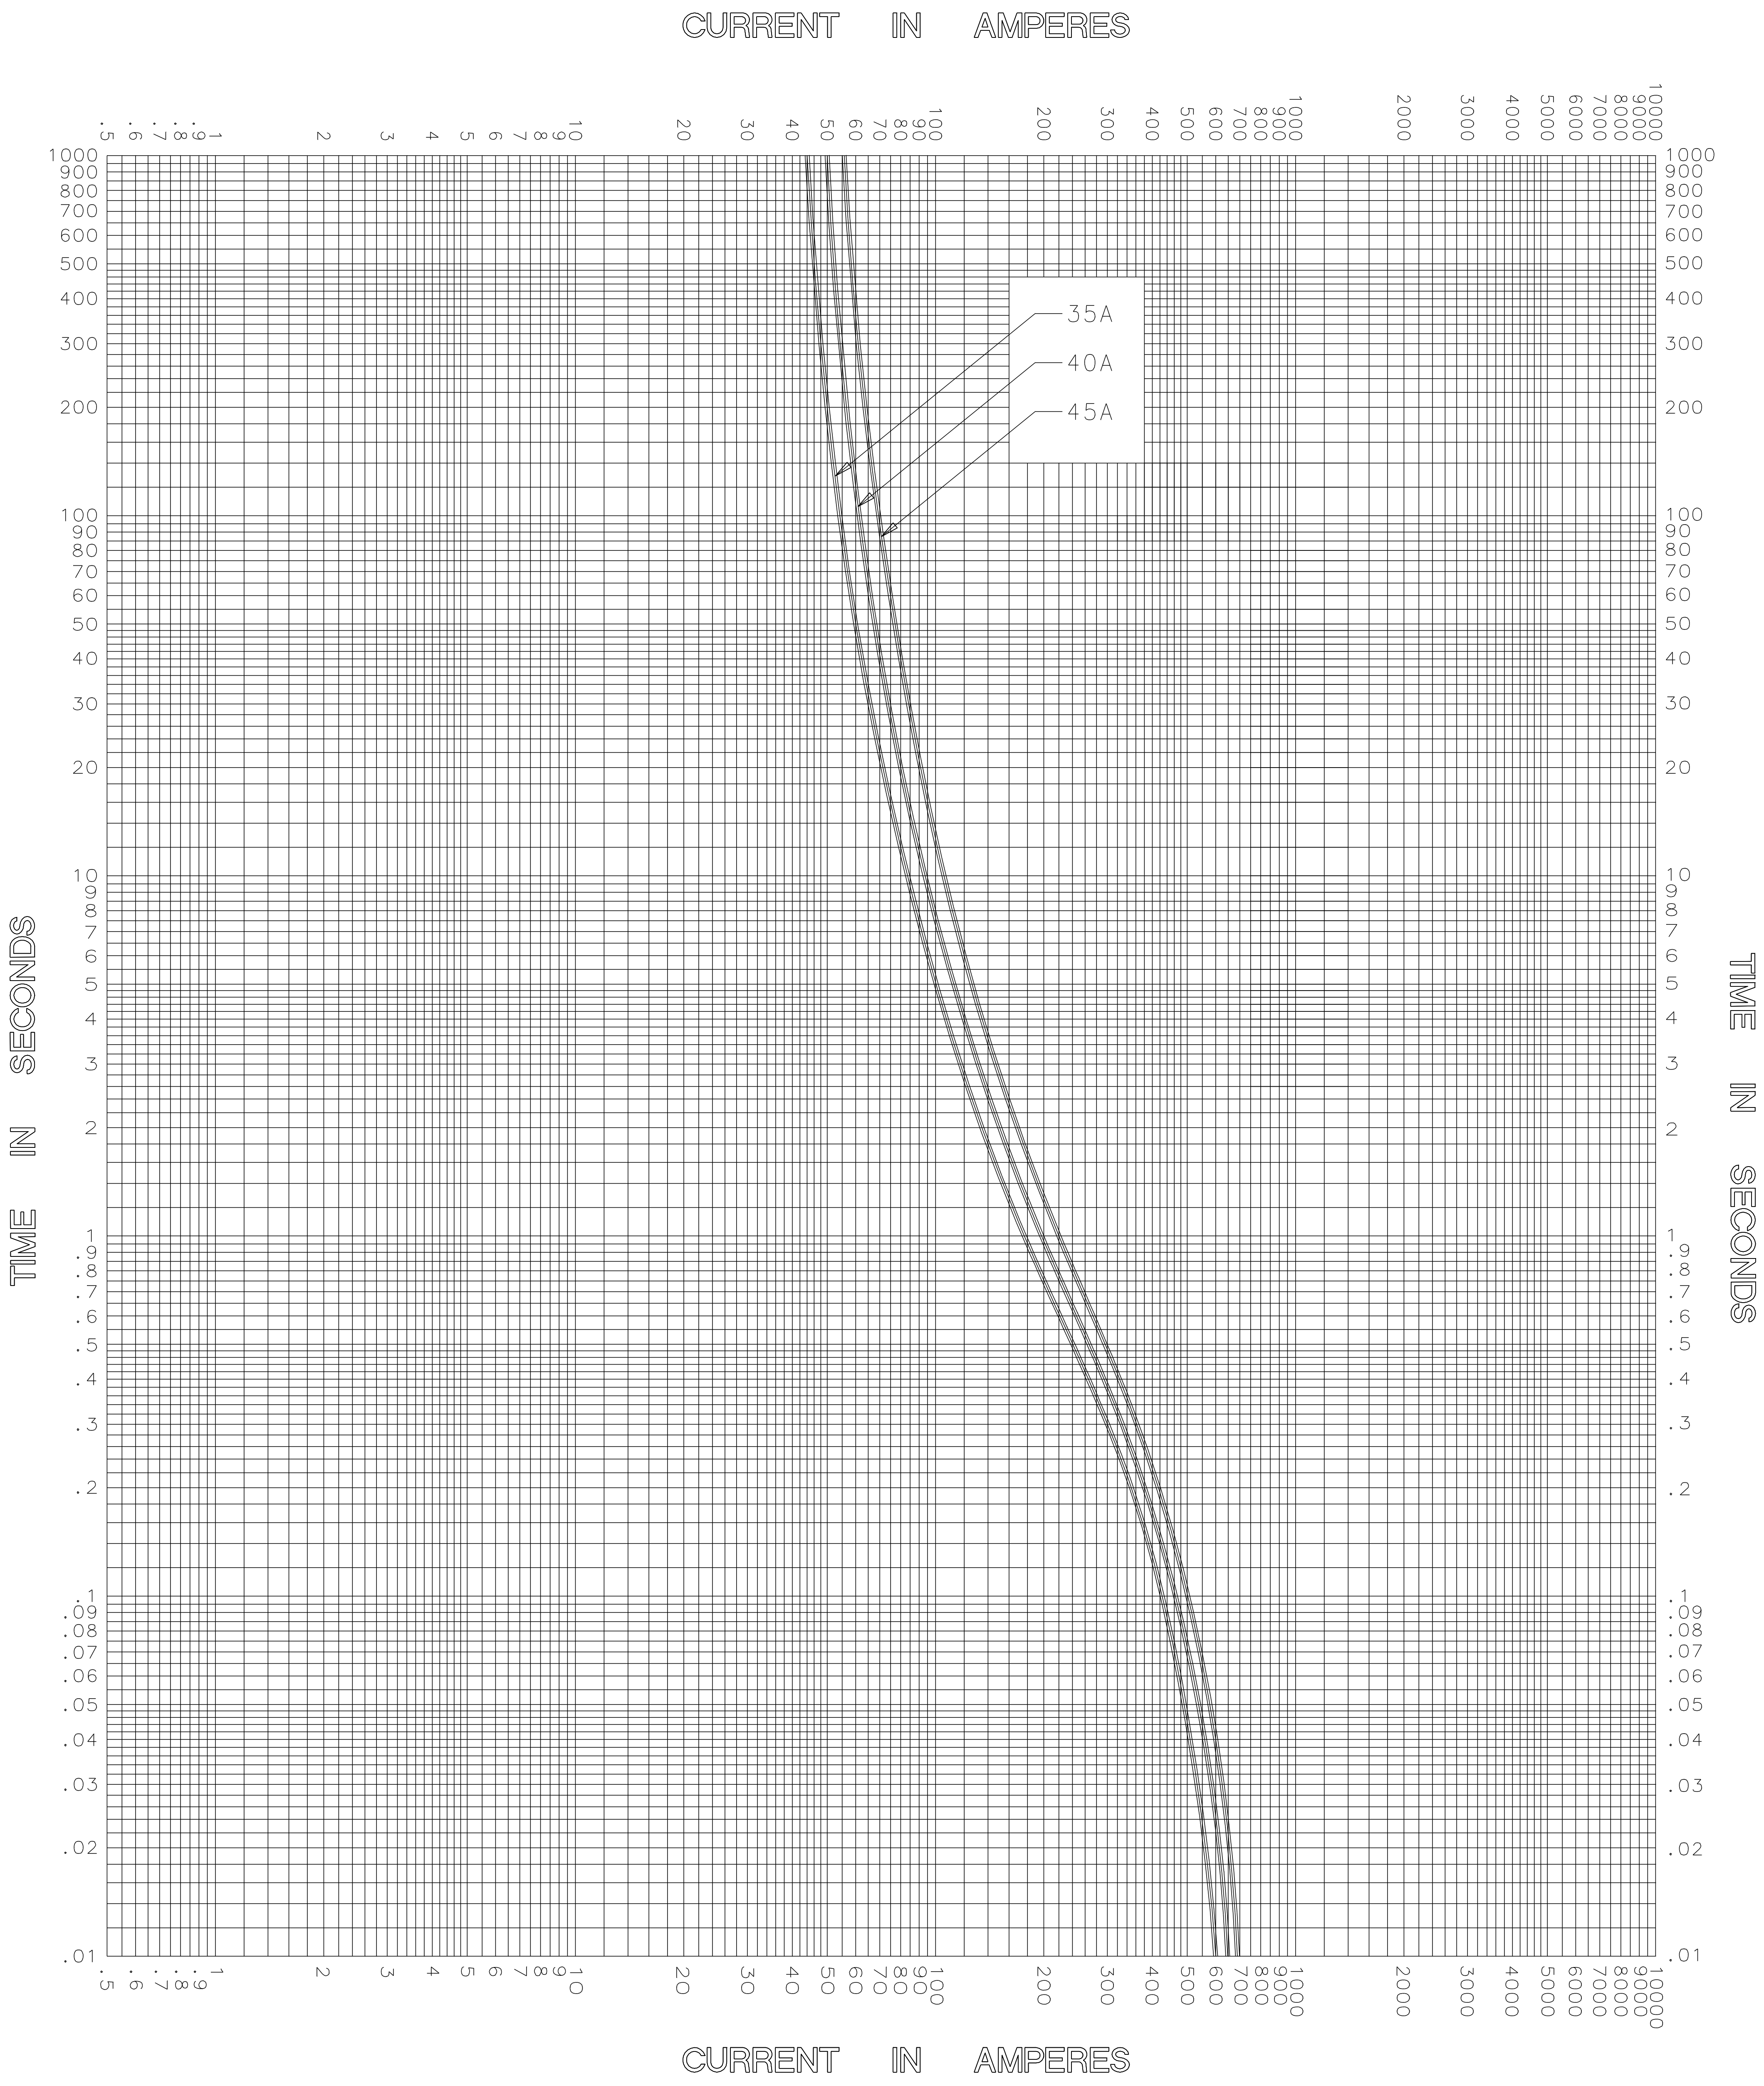


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER SLC (35A - 45A)
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY _____ DATE _____ 04/28/05 CHECKED BY _____ MP
	DRAWING NO. _____ A-FCC0 SLC 05

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

TIME IN SECONDS

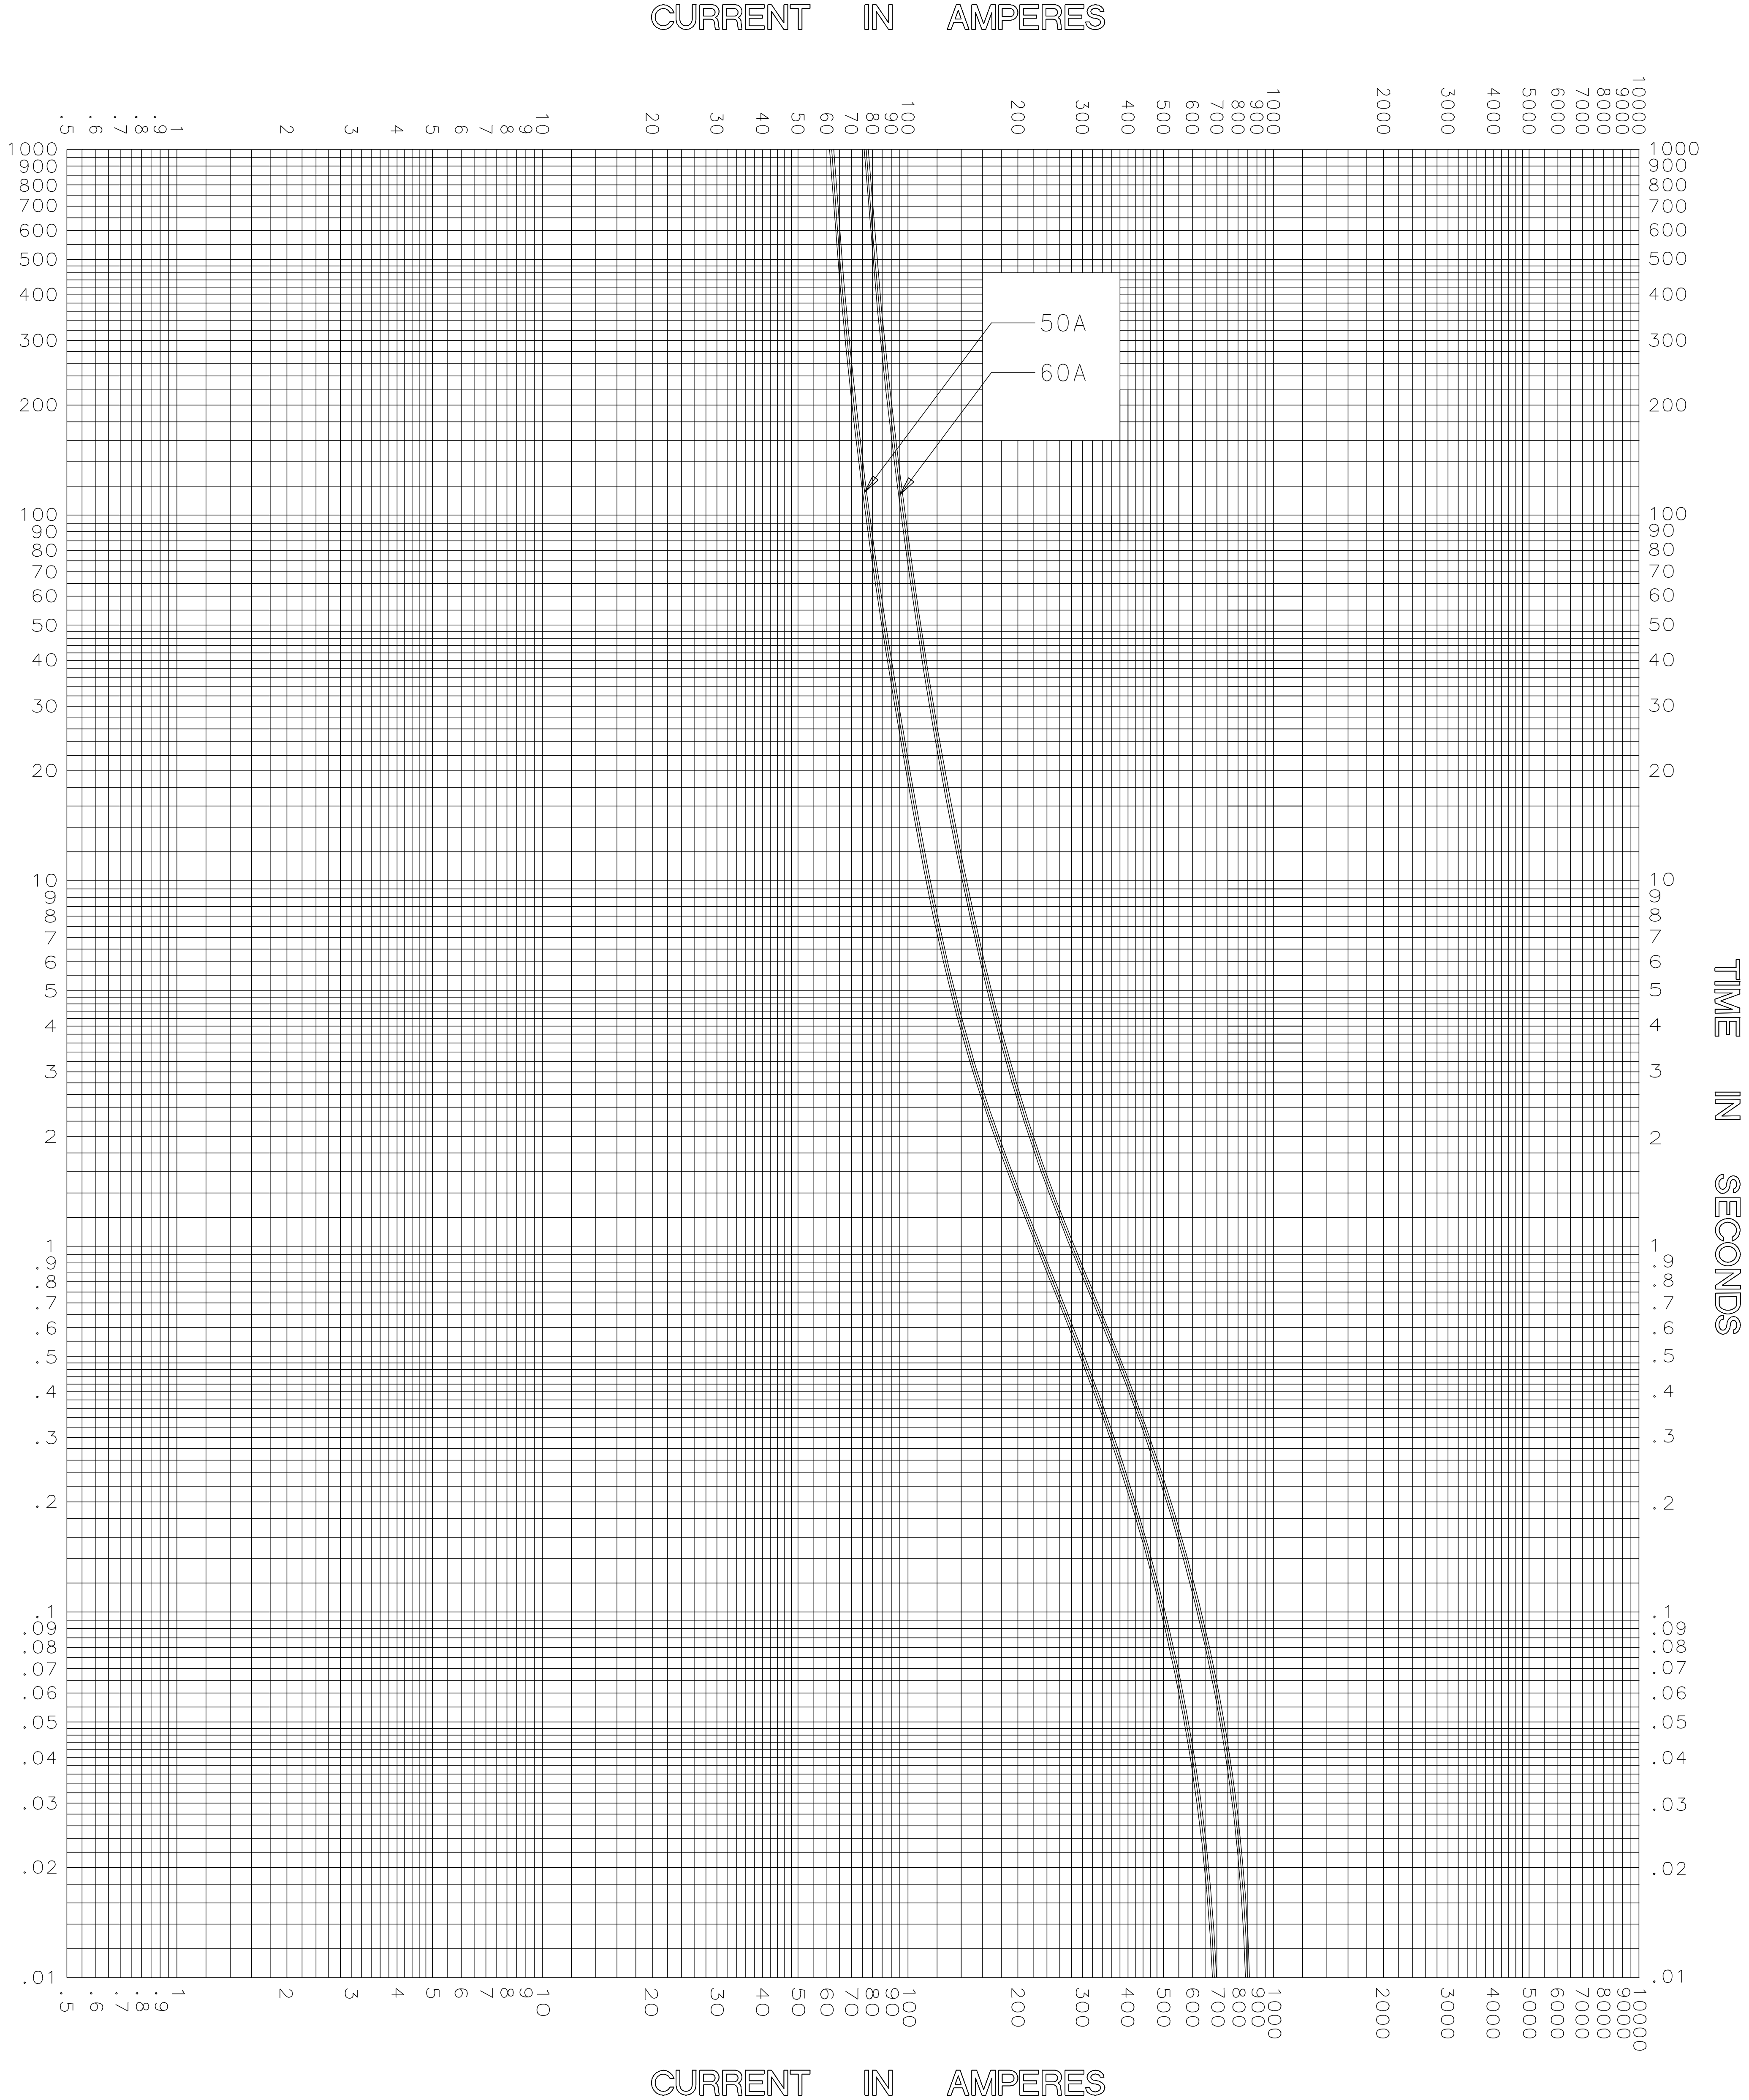


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER SLC (50A - 60A)
BASIS FOR DATA _____		

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>04/28/05</u>
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC03C06</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

TIME IN SECONDS

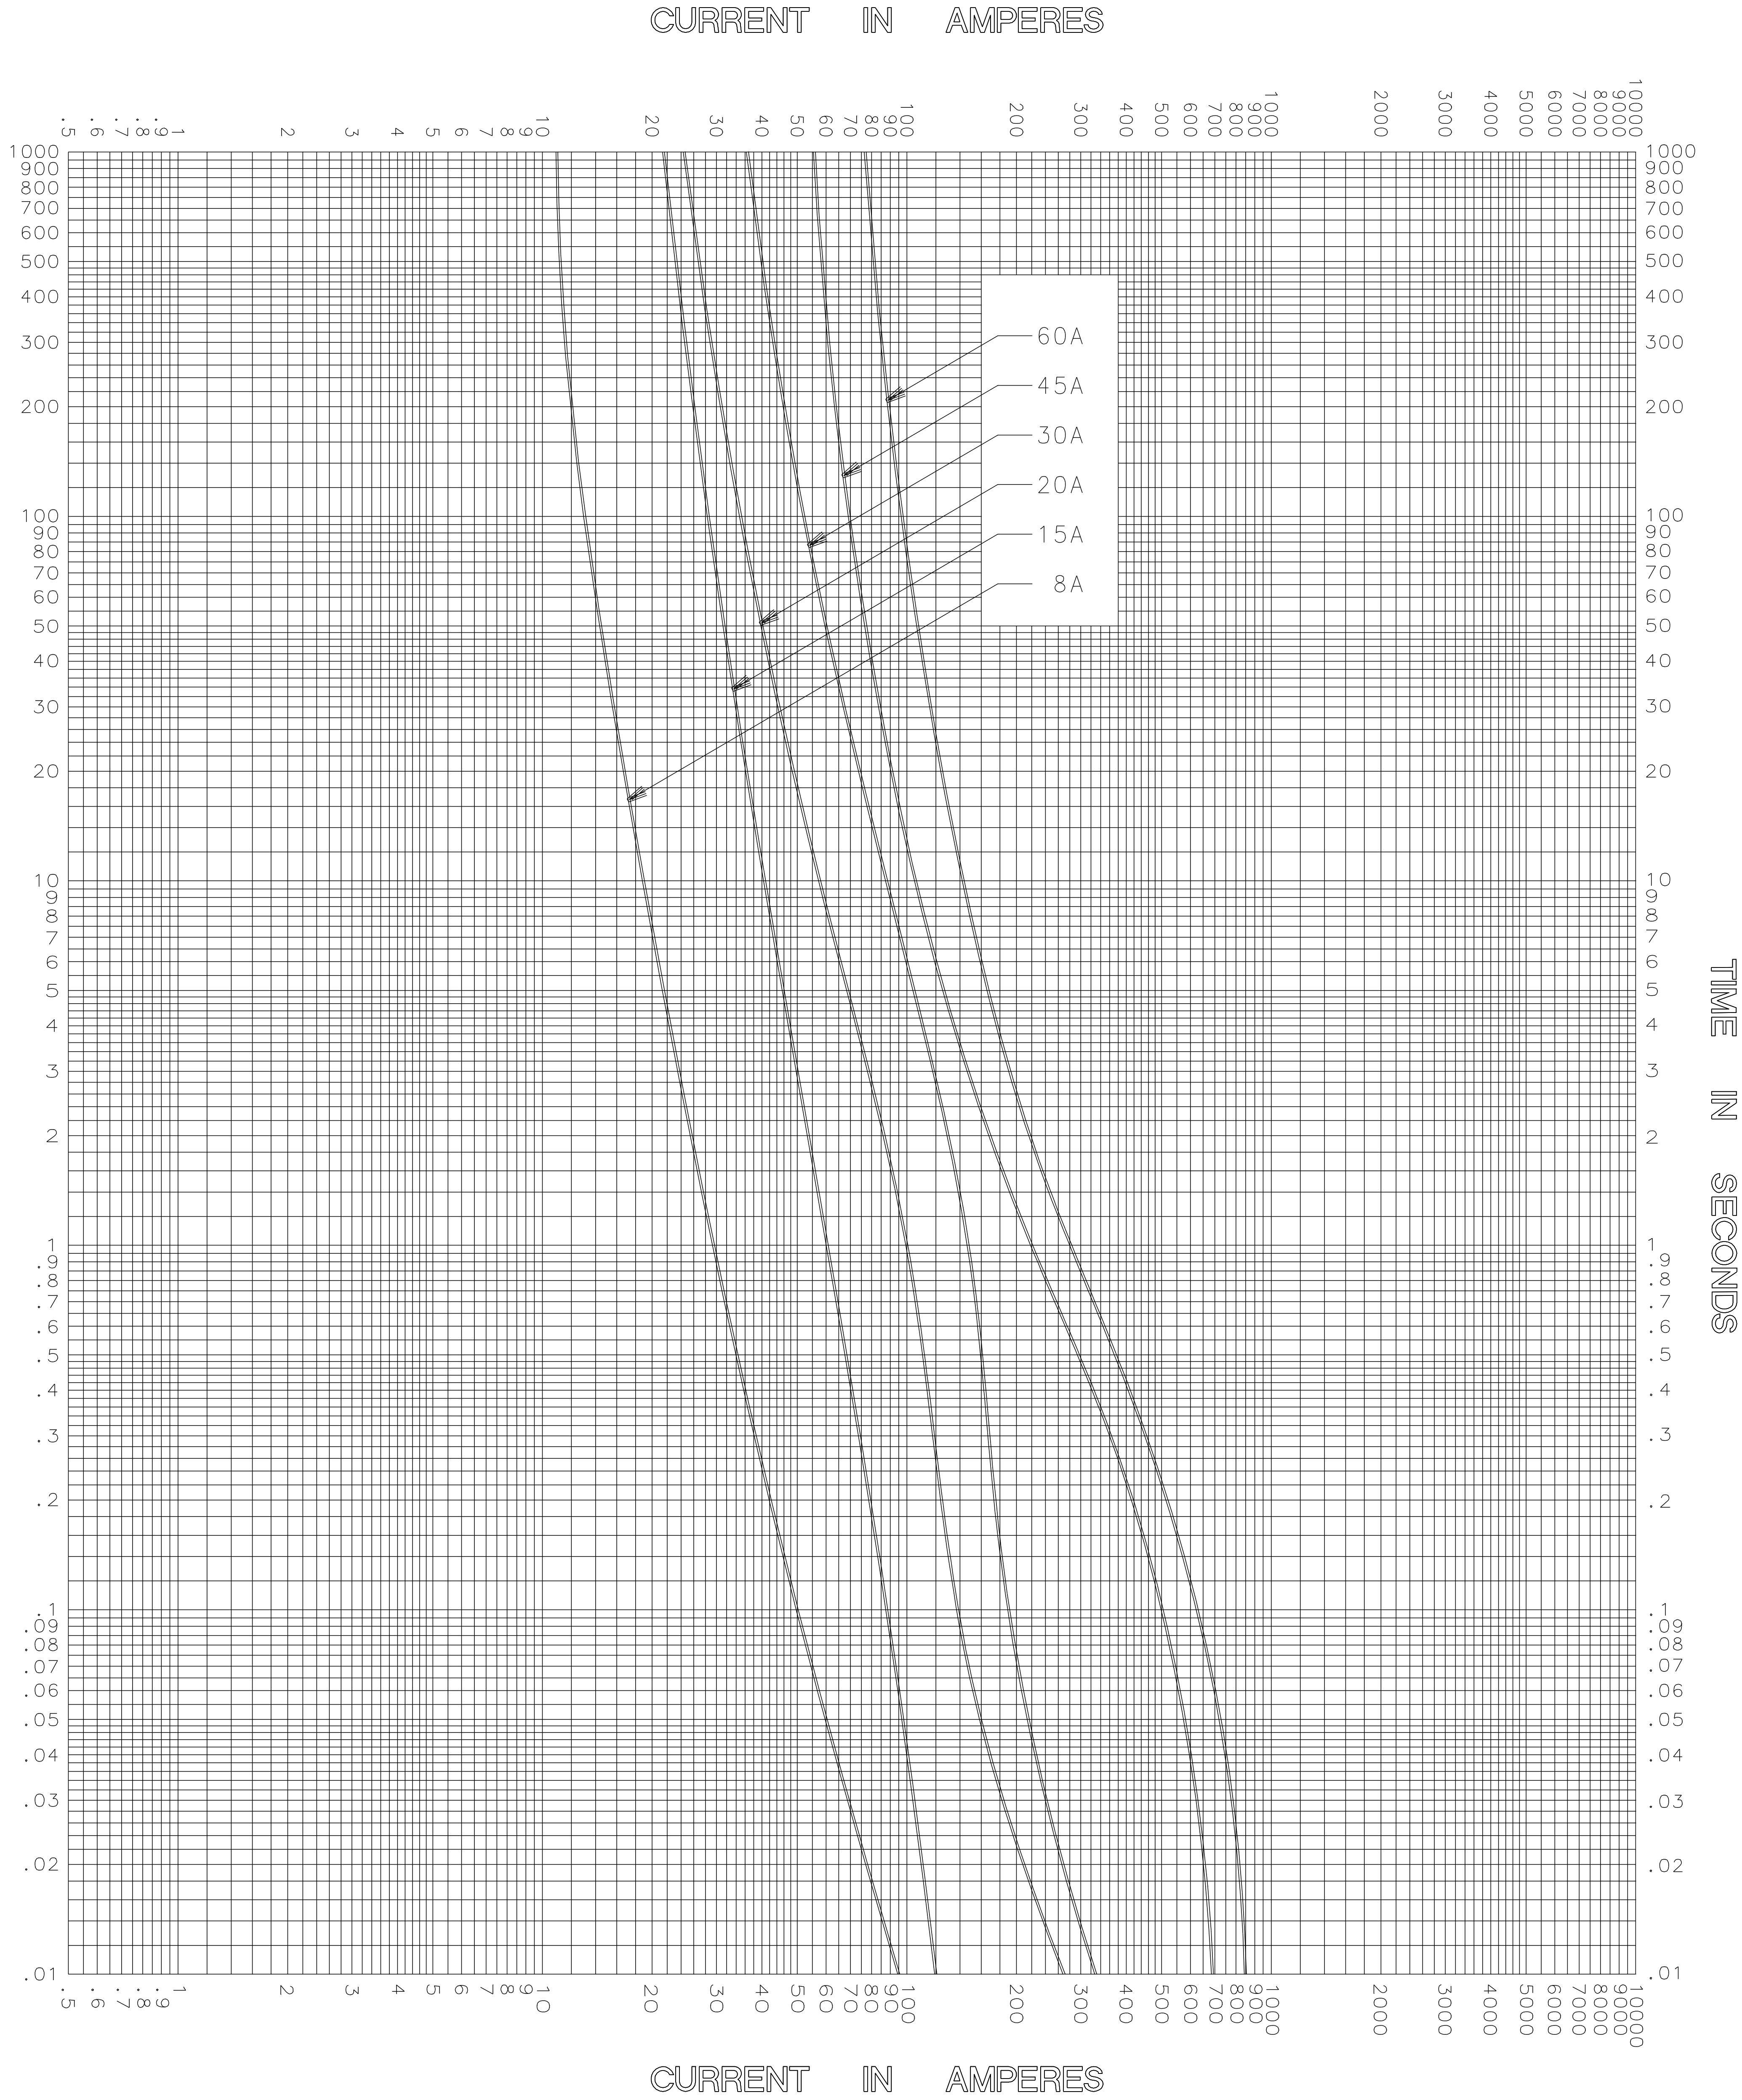

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		SLC (8A - 60A)

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>04/28/05</u>
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC03C007</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT