
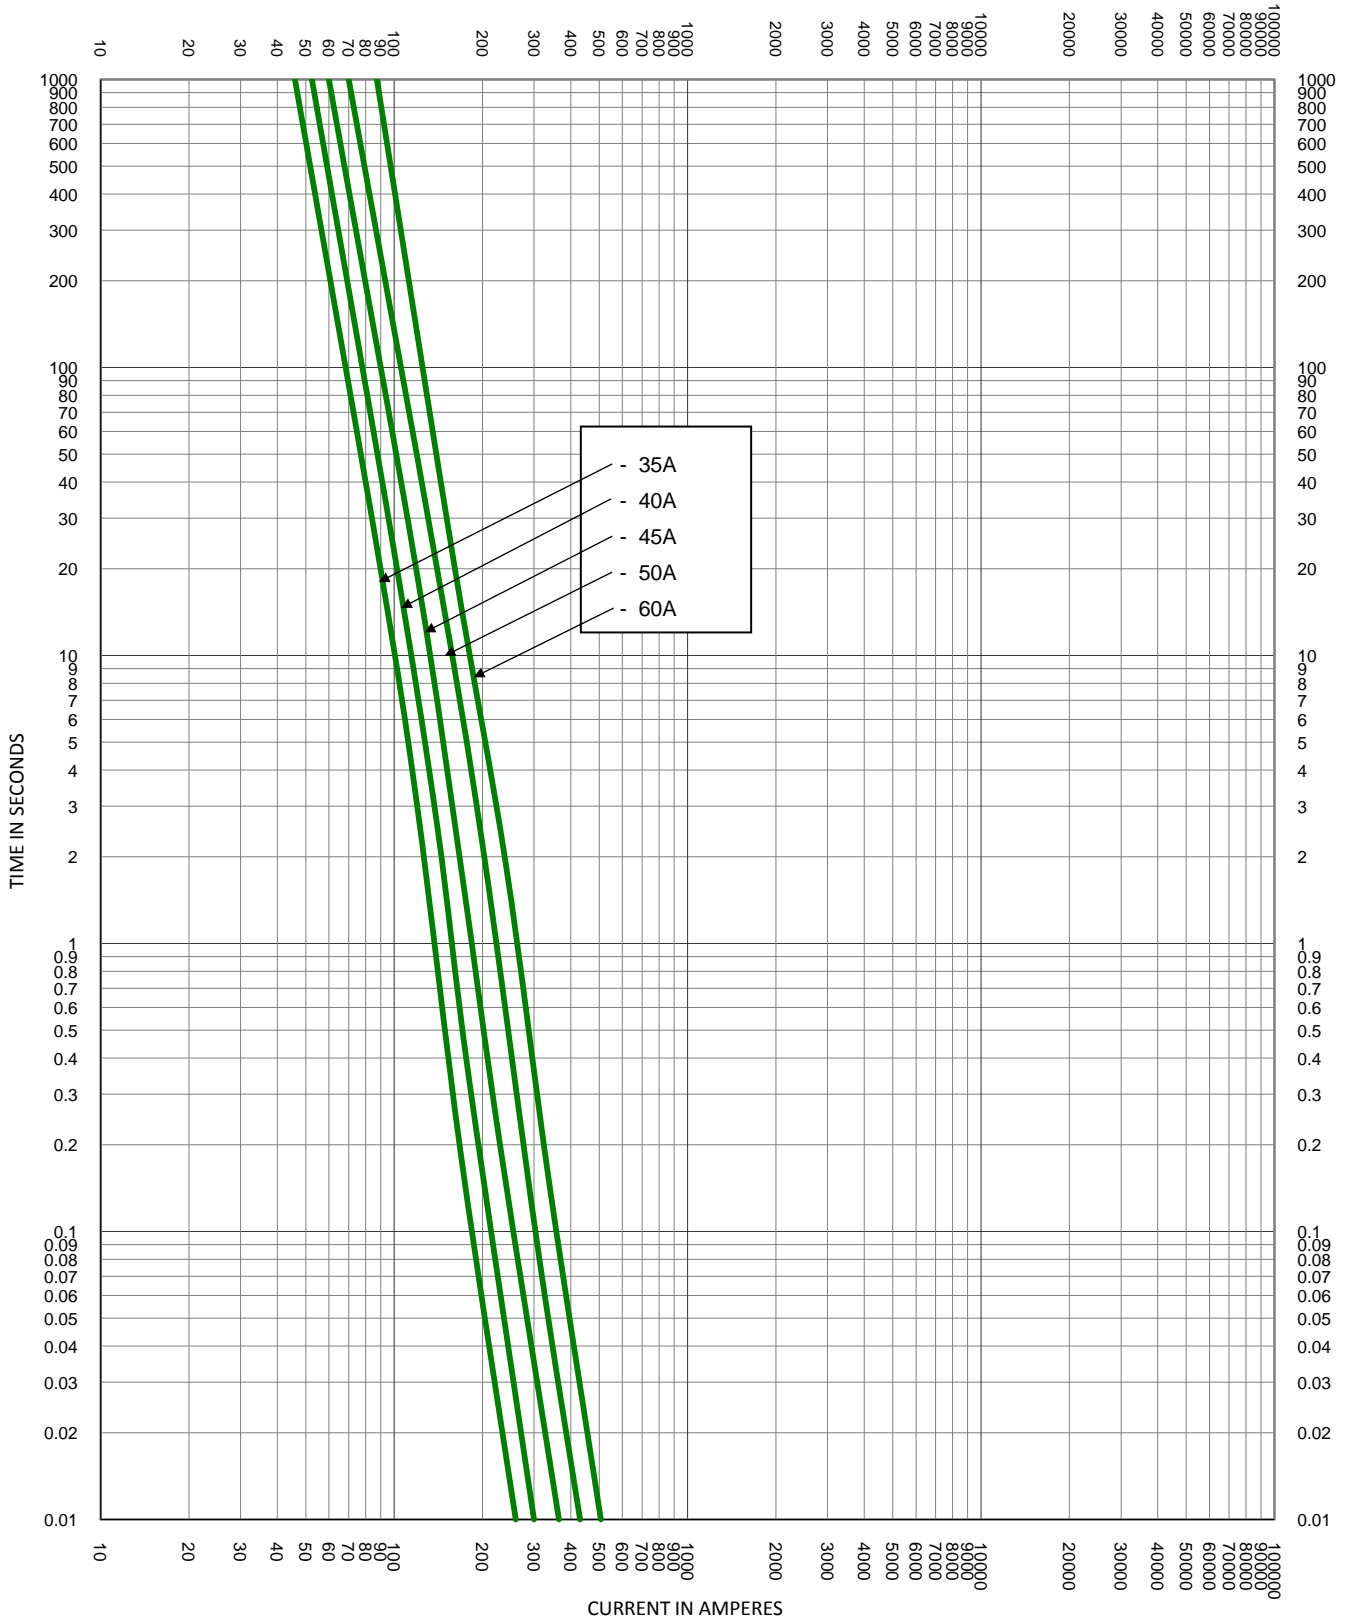

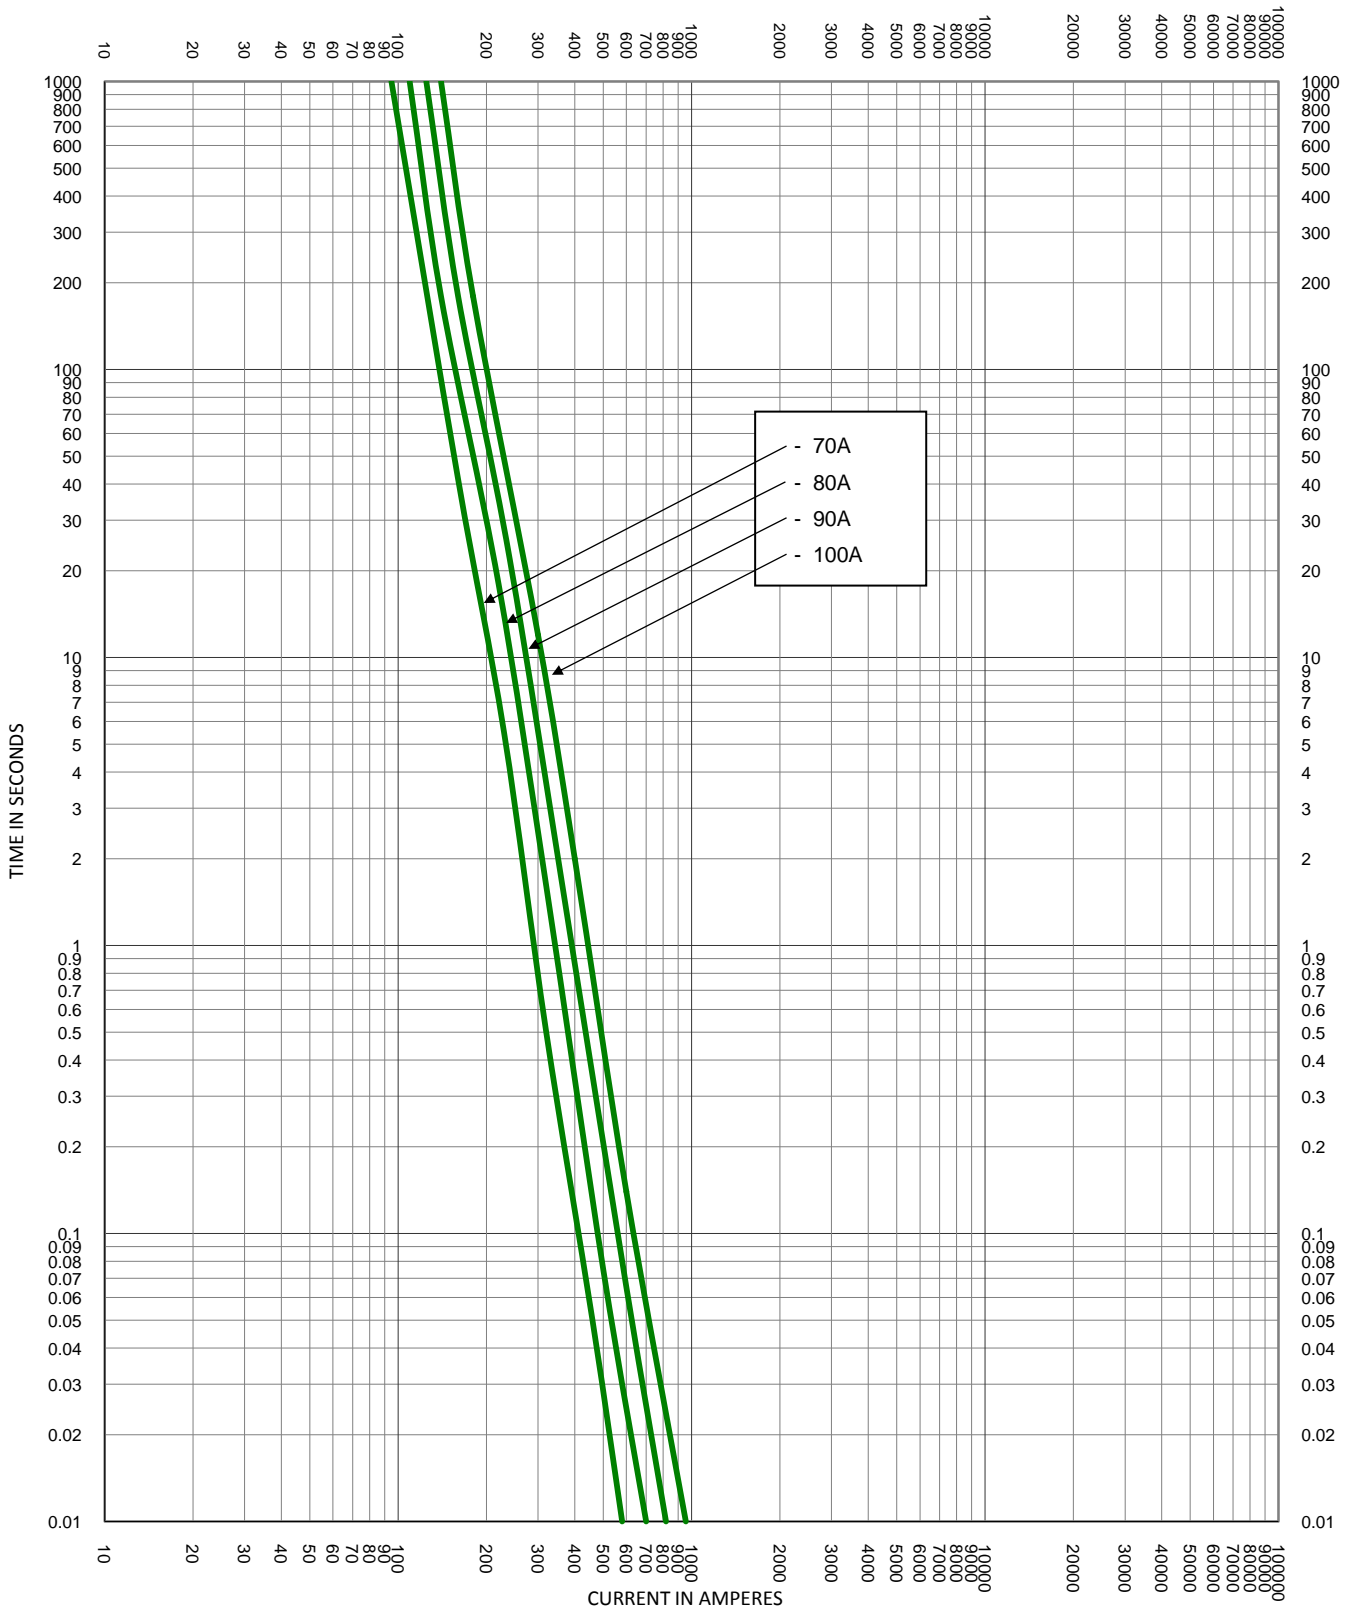



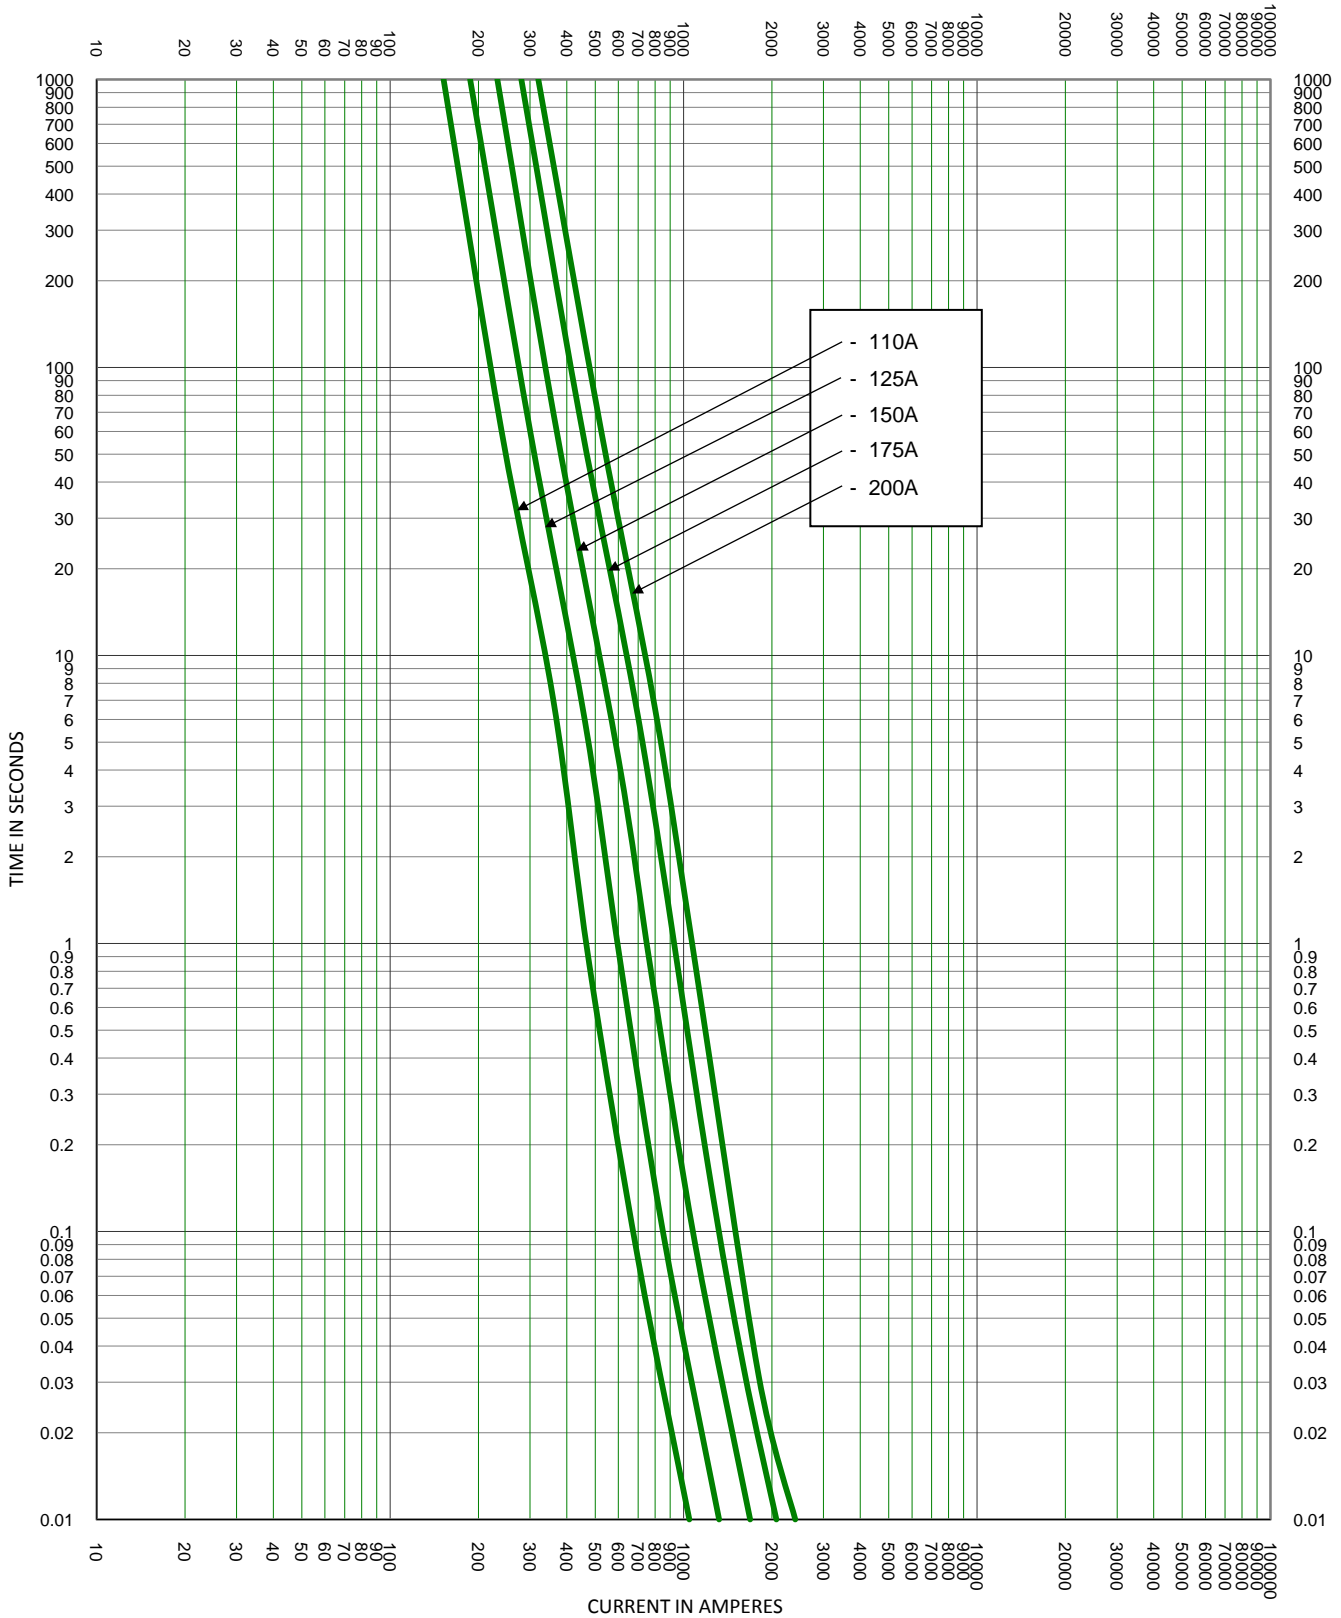
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLSP 1A - 1200A
		DRAWN BY: LLL
		DATE: 01/21/14
		REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 2 OF 8
		FCC01-JLLSP




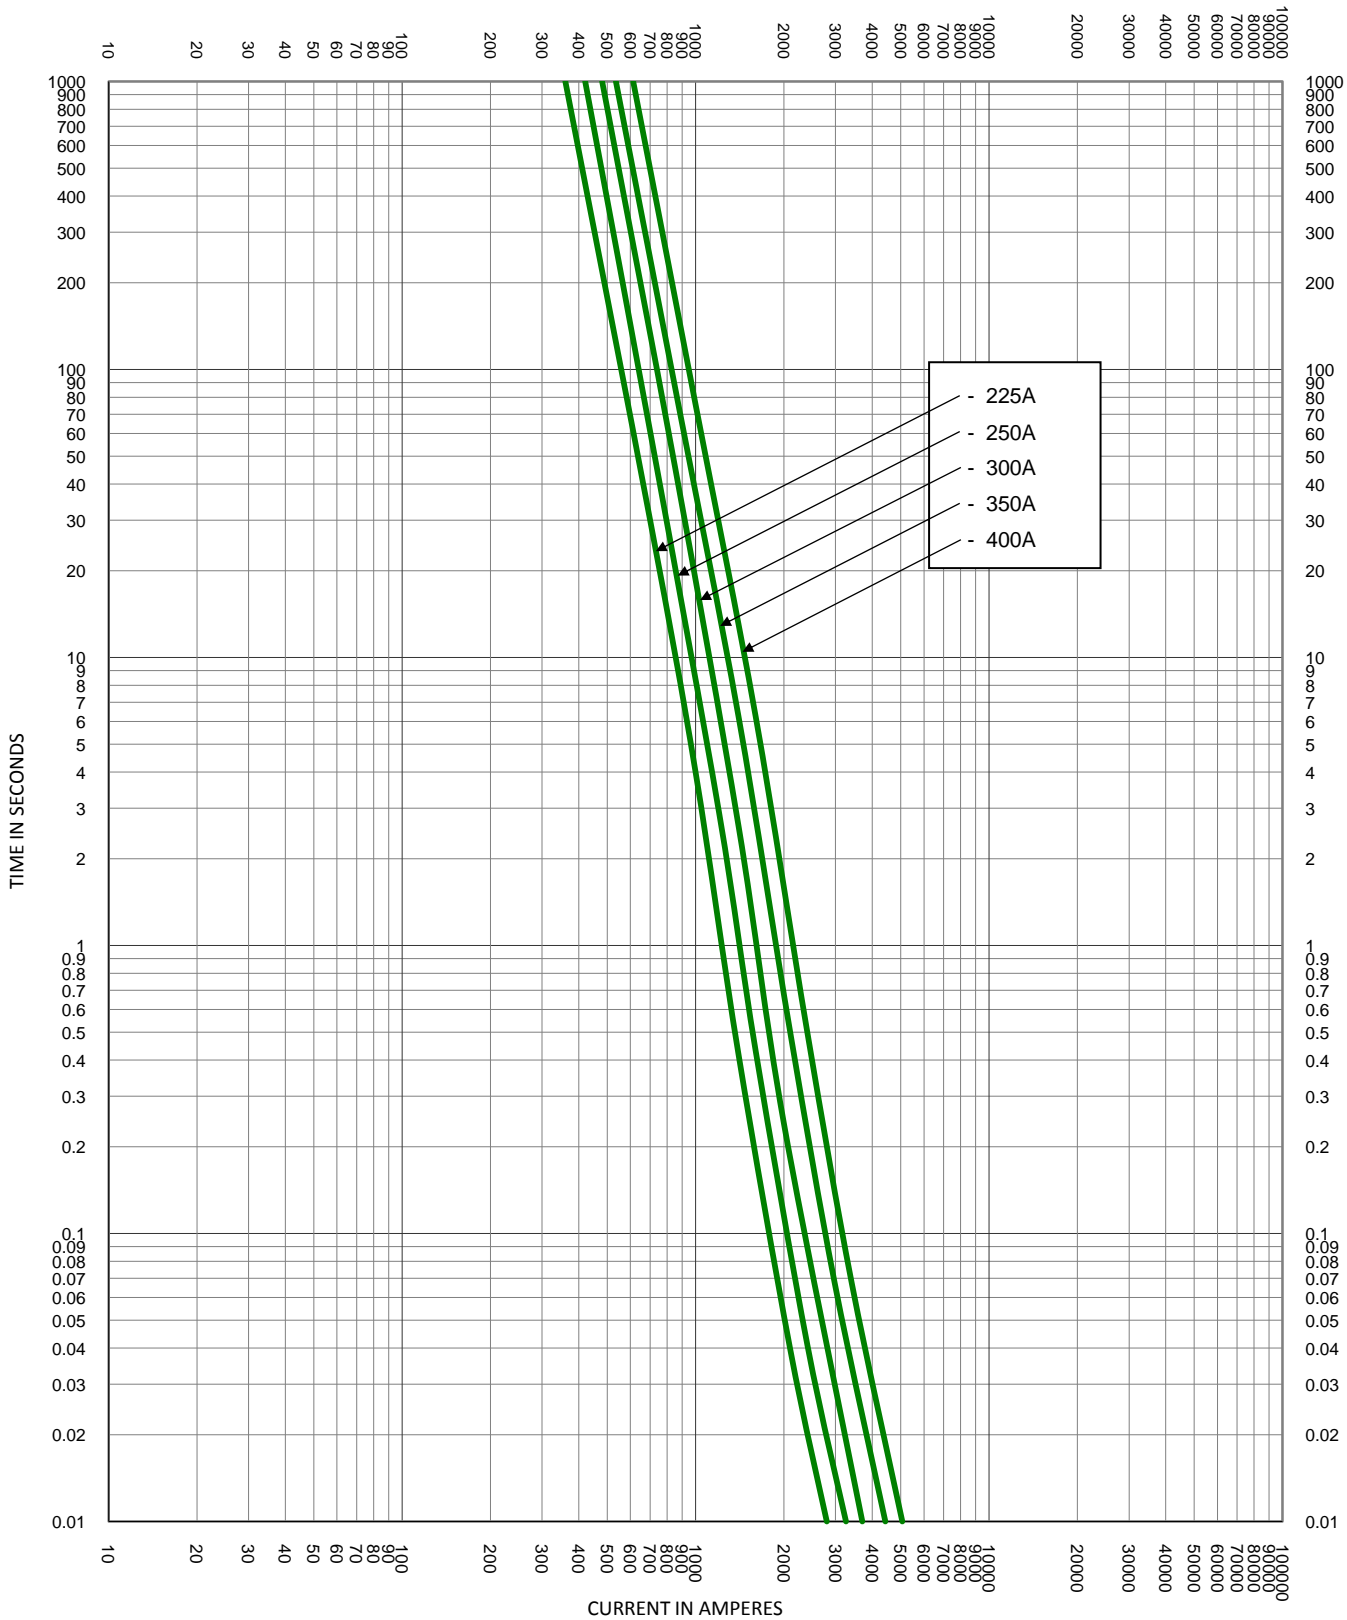
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLSP 1A - 1200A
		DRAWN BY: LLL
		DATE: 01/21/14
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		REVISION: A
		DRAWING NO.: FCC01-JLLSP SHEET 3 OF 8



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLSP 1A - 1200A
		DRAWN BY: LLL
		DATE: 01/21/14
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		REVISION: A
		DRAWING NO.: SHEET 4 OF 8
		FCC01-JLLSP



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLSP 1A - 1200A
		DRAWN BY: LLL
		DATE: 01/21/14
		REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-JLLSP SHEET 5 OF 8



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLSP 1A - 1200A





LITTELFUSE, INC.  
CHICAGO, IL. USA


DRAWN BY: LLL  
DATE: 01/21/14  
REVISION: A


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.: FCC01-JLLSP SHEET 6 OF 8

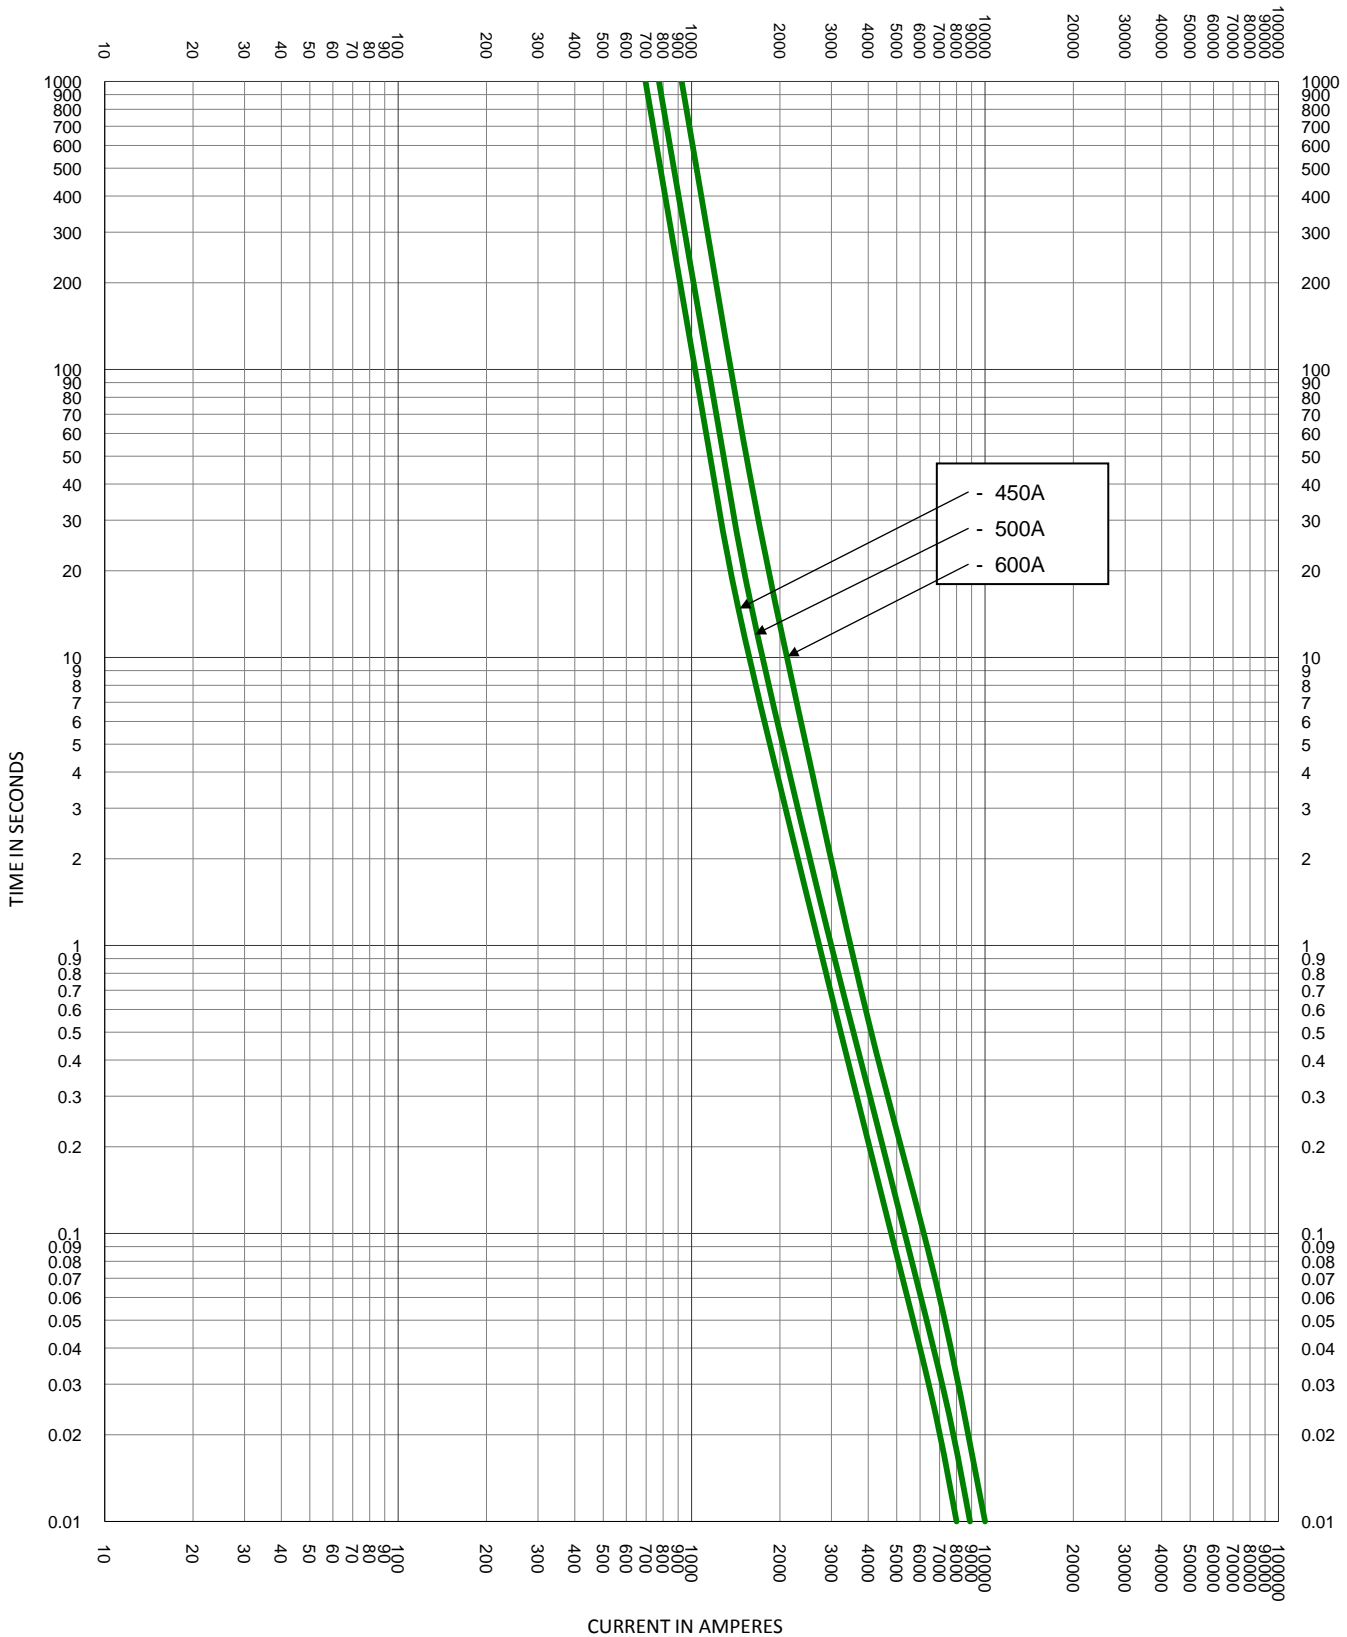

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLSP 1A - 1200A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL, USA		DRAWN BY: LLL DATE: 01/21/14 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-JLLSP SHEET 7 OF 8

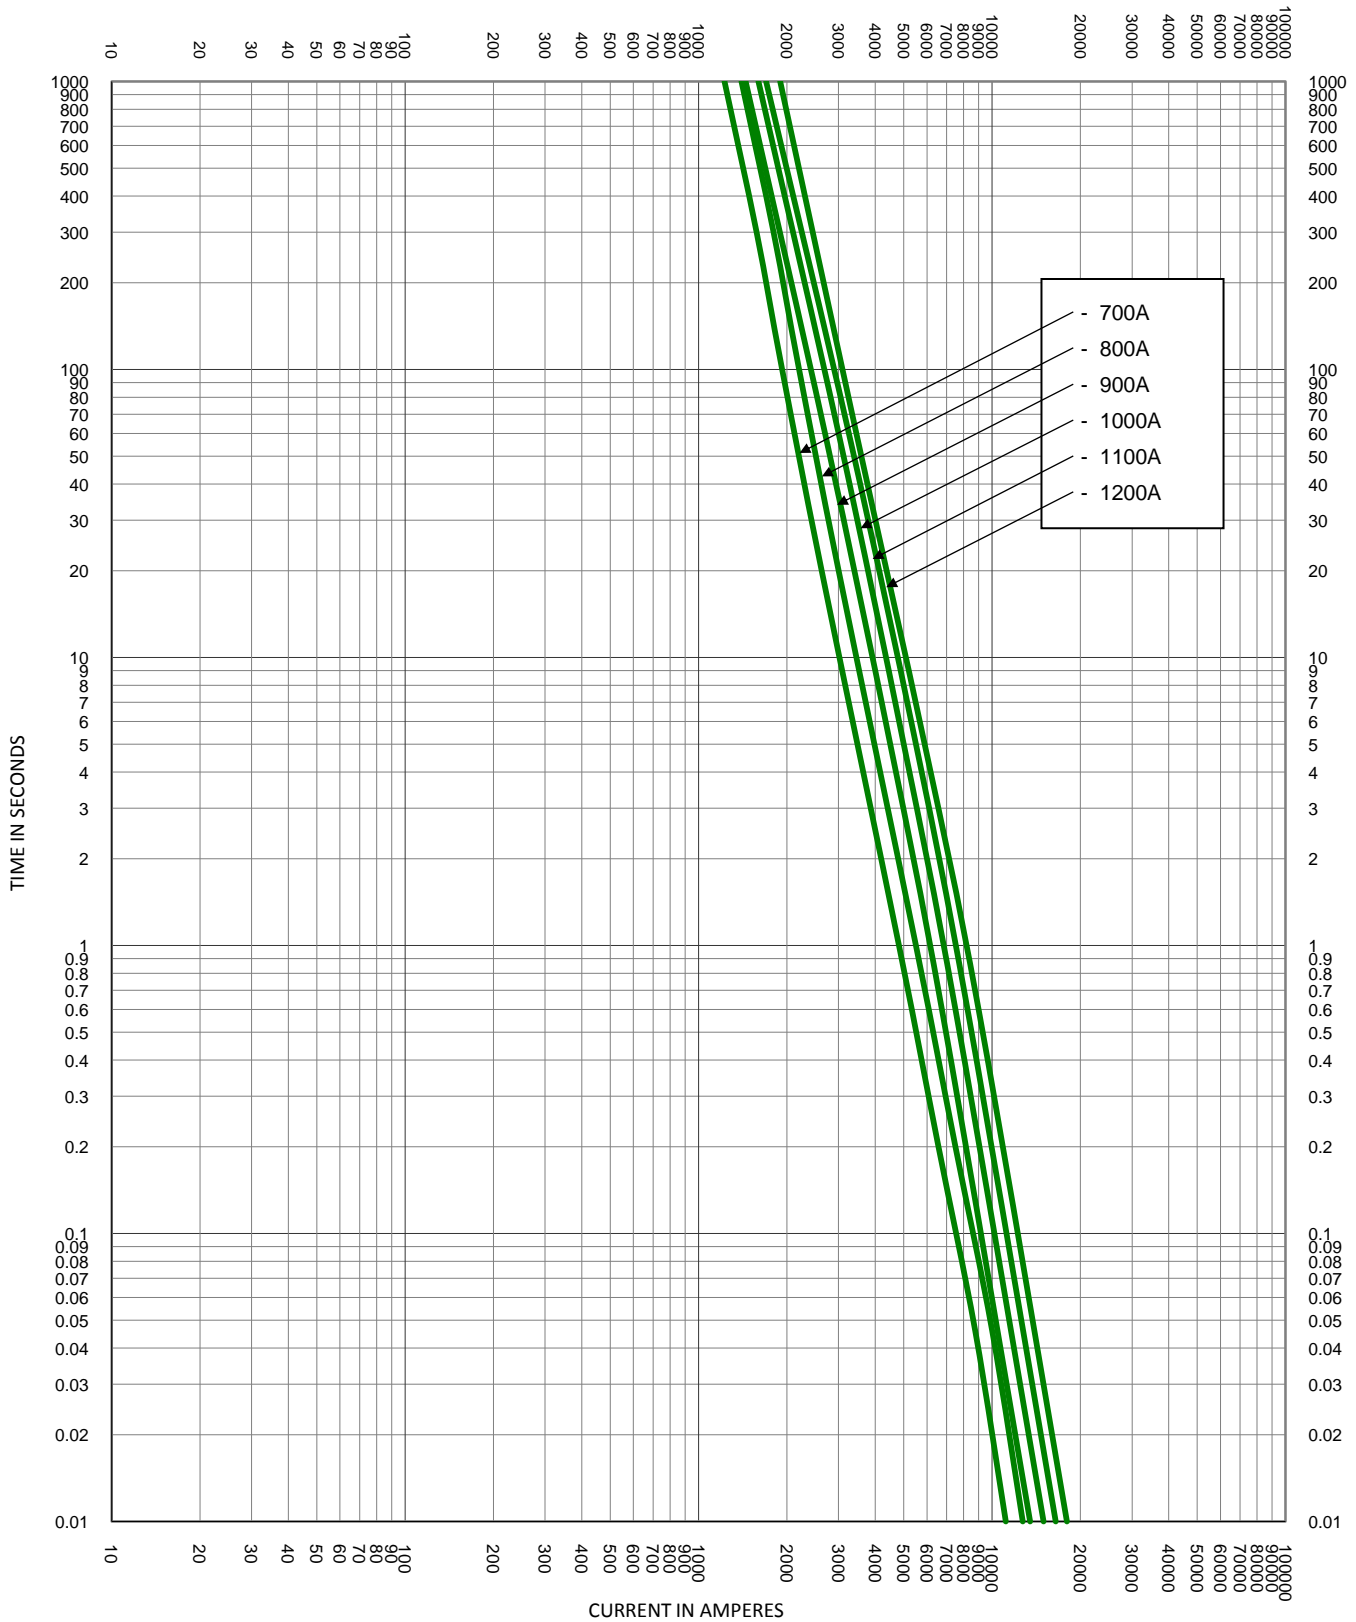

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLSP 1A - 1200A
		DRAWN BY: LLL
		DATE: 01/21/14
		REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 8 OF 8
		FCC01-JLLSP